LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 03/10/2020 Expiration Date: 03/10/2021

Property Owner: Daniel Silbermann c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work)

Installer: Self License No.

_X_ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Explain: Club house with bathrooms (4)

Describe: Four 100' Laterals using gravellss chambers

Parcel Description:

Legal: S34, T31 N, R33 W, C.O.S. PM 7063, PARCEL B, ACRES 99.98, *6771*

Address or Location: 1021 SWANSON LODGE RD

Geo/Assessors code: 0000006771

Approved Design Criteria:

Bedrooms Septic Tank Size 2000 gallons Drainfield Size: 400 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Joe Keiffer *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Joe Keiffer *Date:* 20 MARCH 2020

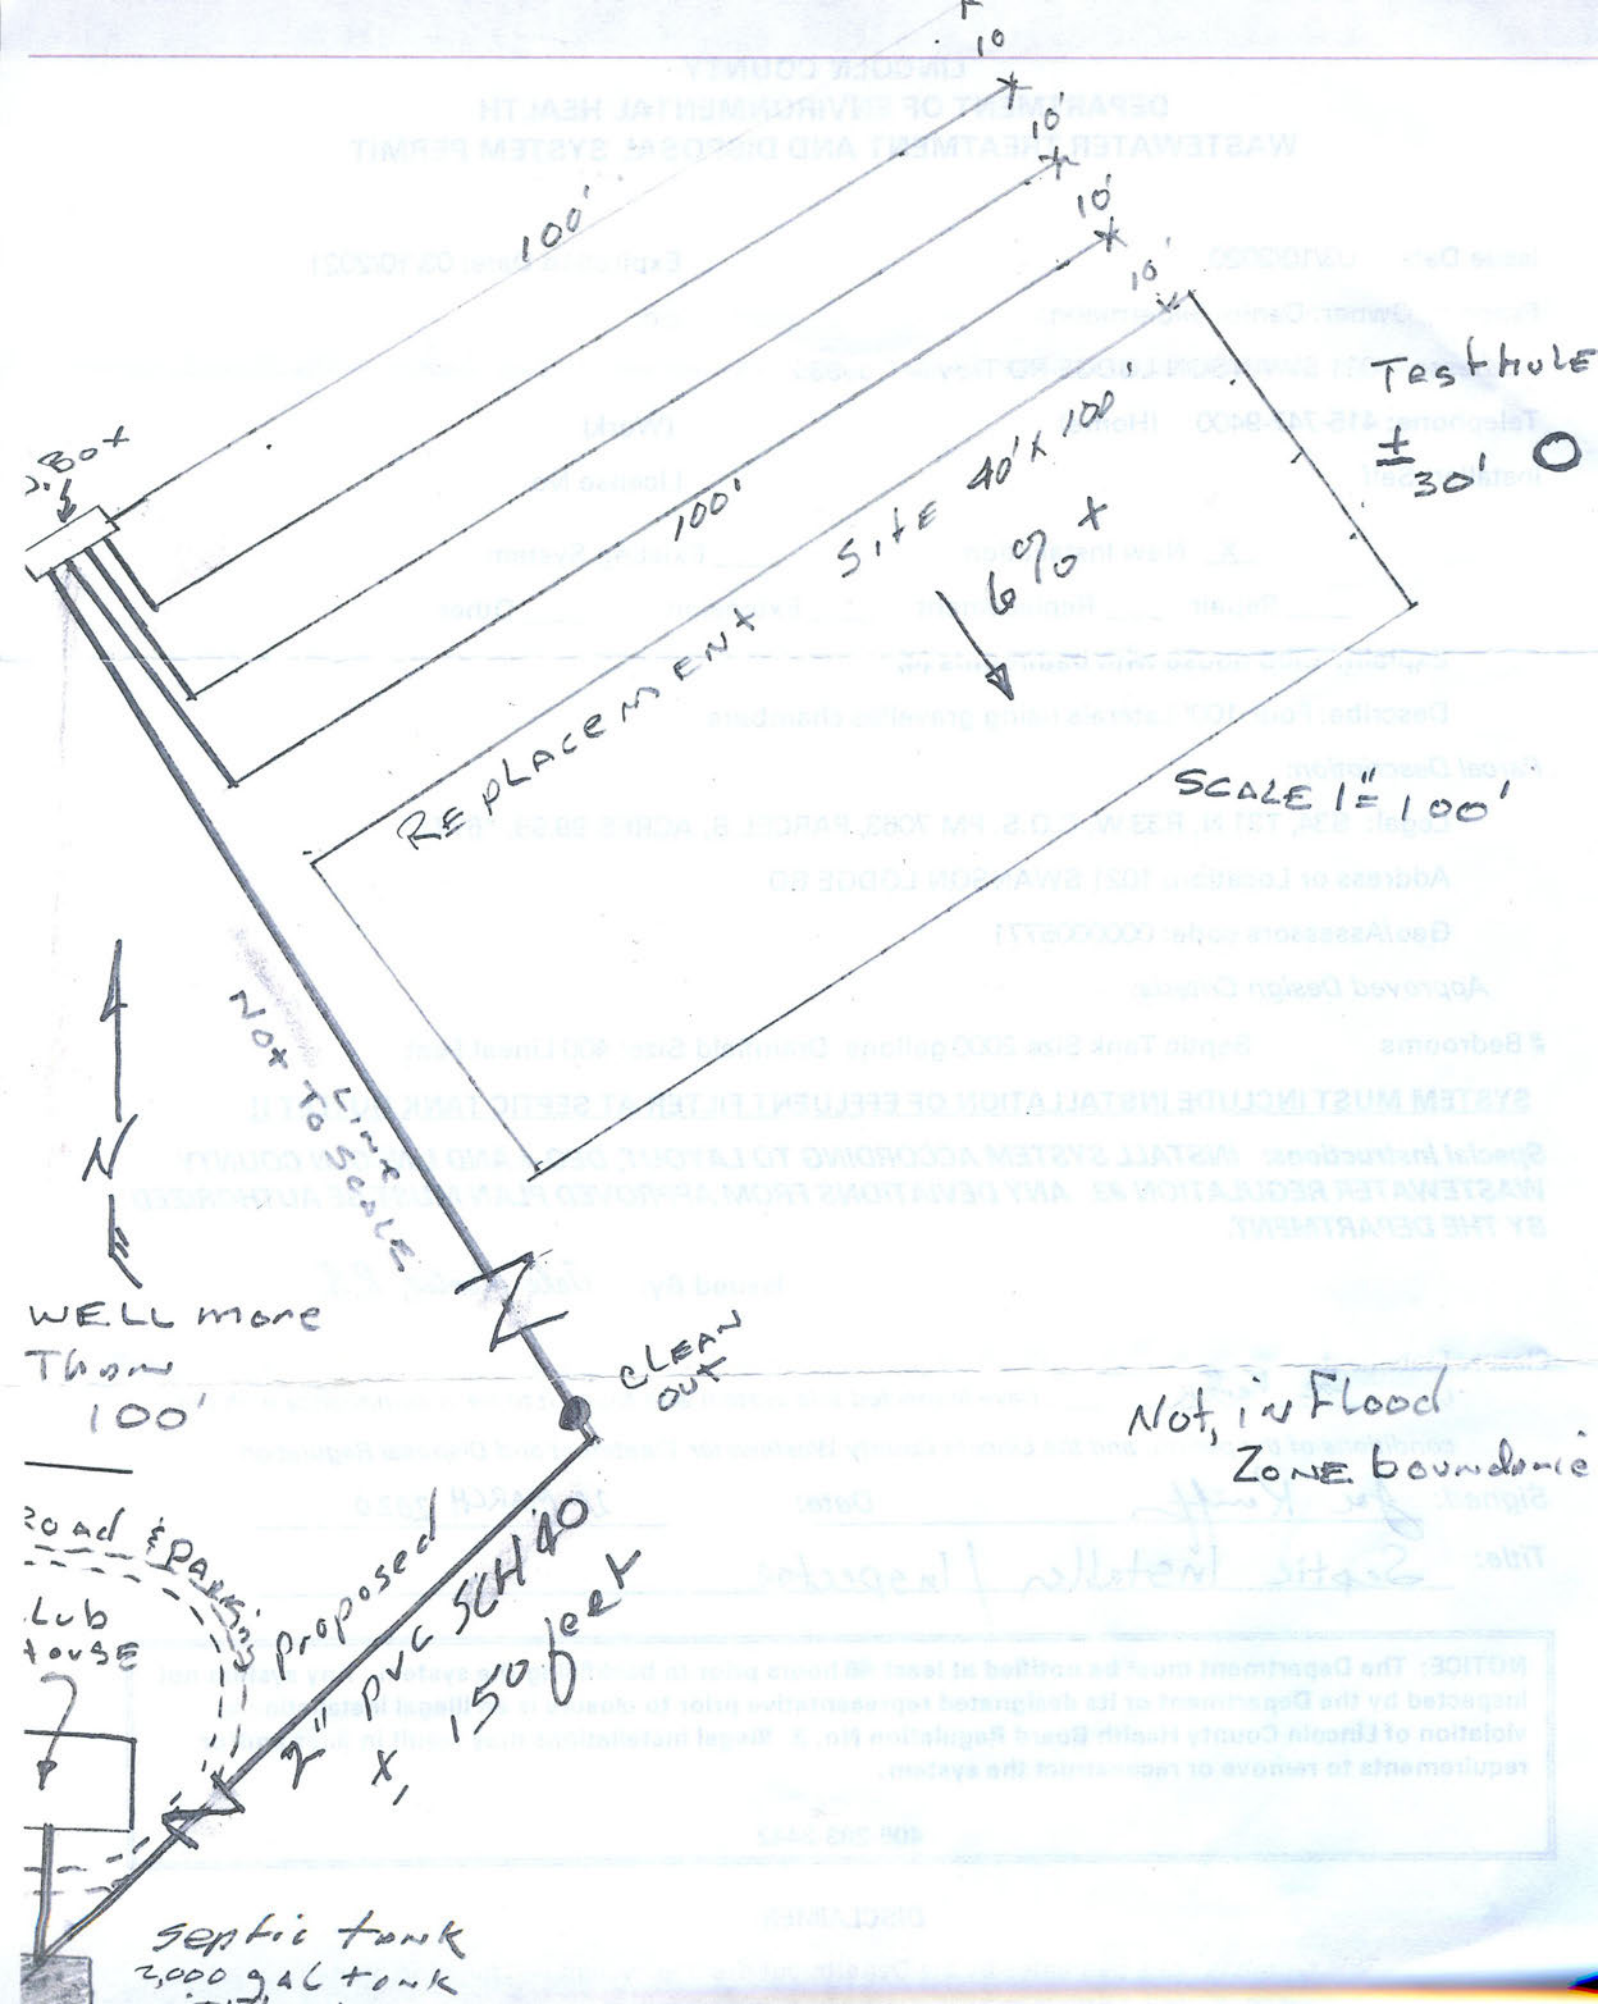
Title: Septic Installer / Inspector

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly


10'
10'
10'
10'
100'
100'
Test hole
± 30'
Boot
SITE 40' x 100'
60% +
REPLACEMENT
SCALE 1" = 100'
Not to Scale
N
WELL more Than 100'
CLEAN OUT
Not in Flood Zone boundarie
Road & Parking
Lub House
Proposed 2" PVC SCH 40 x 150 feet
Septic tank
3,000 gal tank