LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 03/23/2020 Expiration Date: 03/23/2021

Property Owner: Jeff & Lisa Sooter c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work)

Installer: Terry Oedewaldt License No. 02

_X_ New Installation ____ Existing System

____ Repair _____ Replacement ____ Extension ____ Other

Explain:

Describe: Three 100' Laterals using gravelless chambers

Parcel Description:

Legal: KOOTENAI VIEWS, S33, T31 N, R31 W, ACRES 9.09, LOT 4 IN E2W2 PM 6713 *50061*

Address or Location: LOT 4

Geo/Assessors code: 0000050061

Approved Design Criteria:

Bedrooms 6 Septic Tank Size 2,000 gallons Drainfield Size: 300 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly

REVISED LOT LAYOUT

LOT 4 KOOTENAI VIEWS SUBDIVISION
PLAT NO. 6713
NE¼ SW¼, SECTION 33, T.31N., R.31W., P.M.MT.


EQ 06-1597

Reviewed by the Local Reviewing Authority
Under contract with the
Department of Environmental Quality

3/17/2020
Reviewer Date

Accepted under contract

Signature

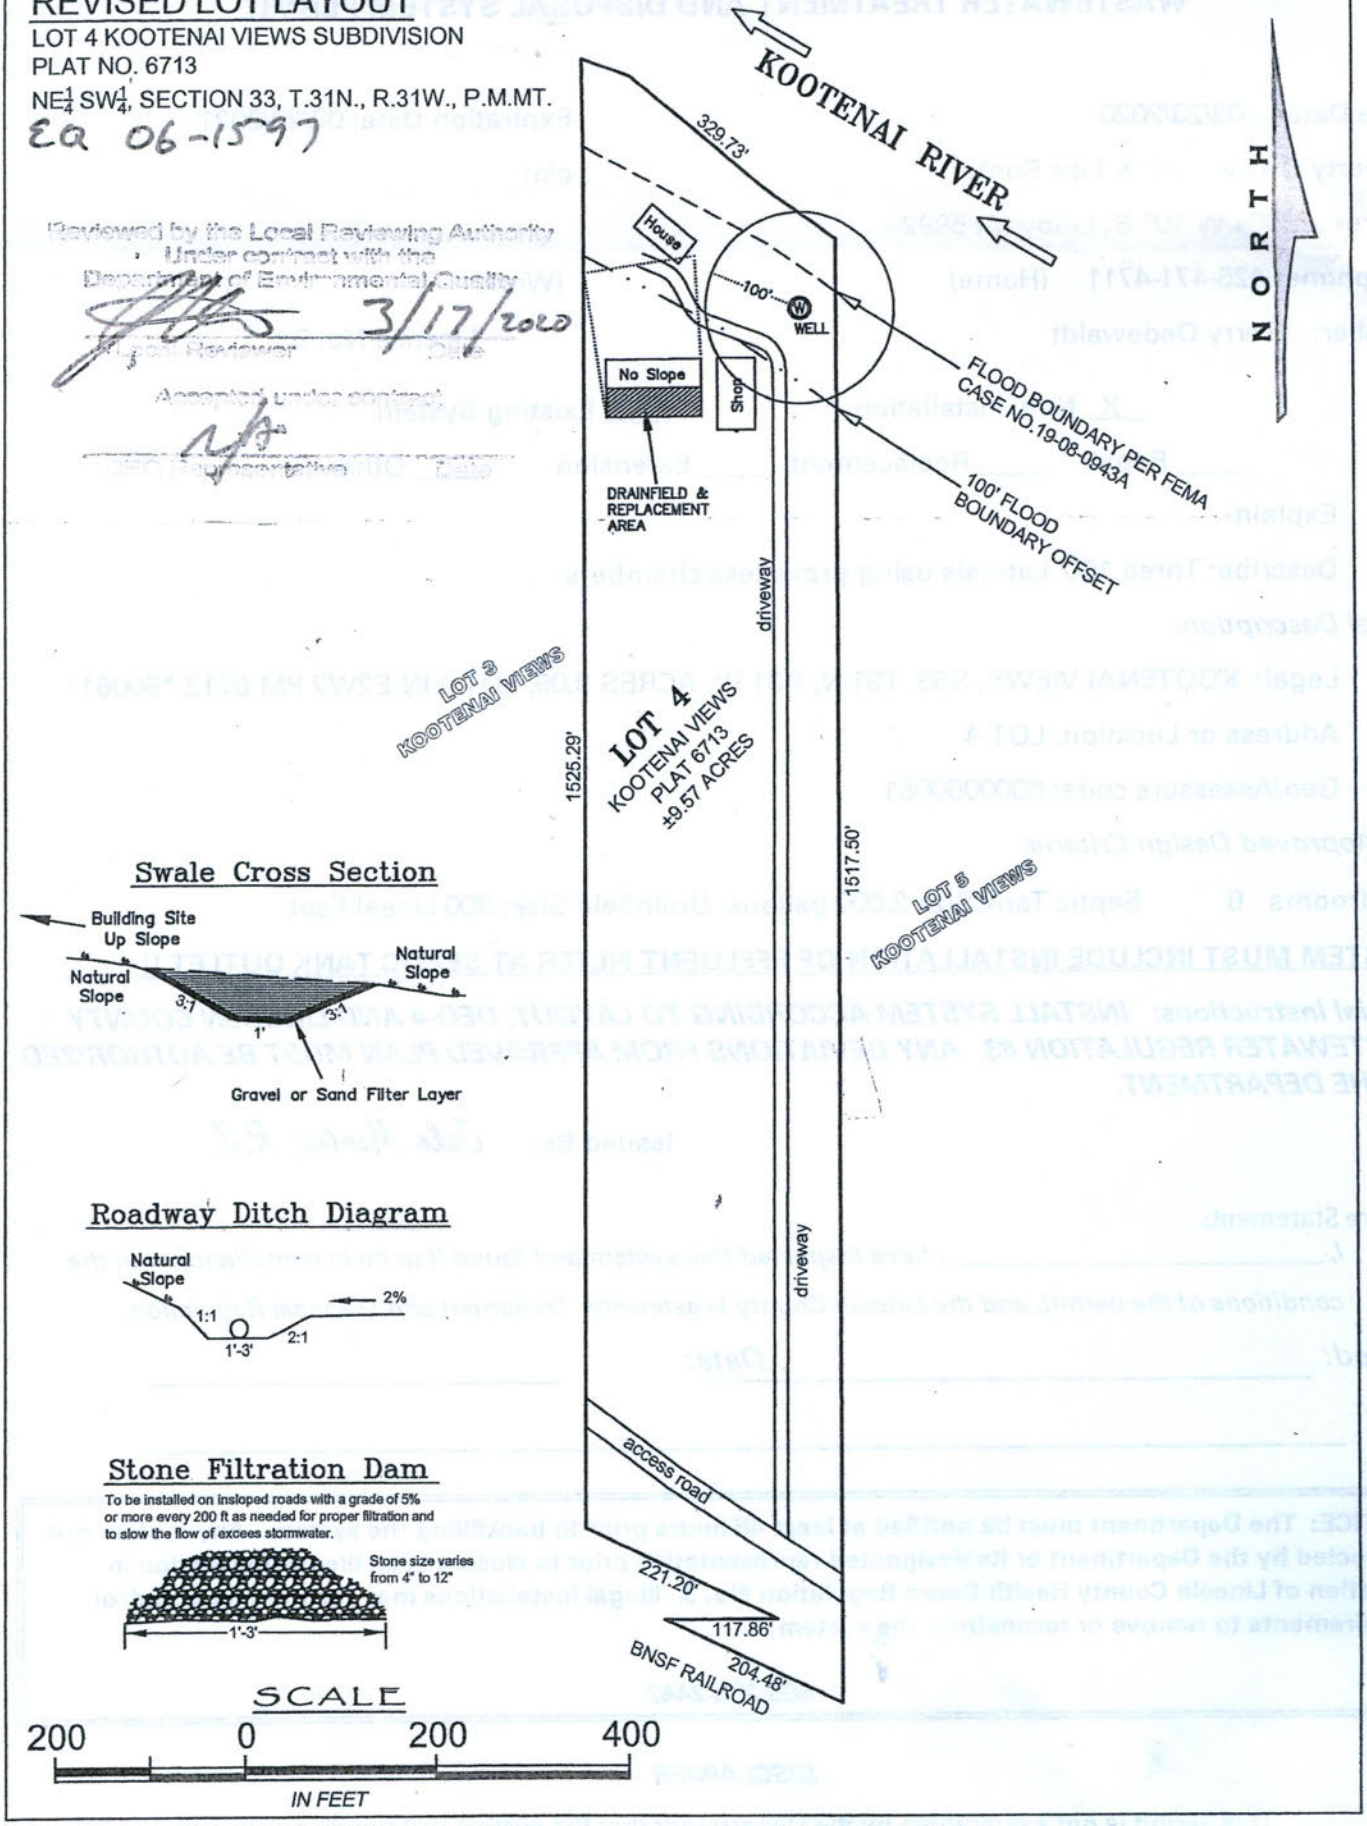

Swale Cross Section

Roadway Ditch Diagram

Stone Filtration Dam

To be installed on insloped roads with a grade of 5% or more every 200 ft as needed for proper filtration and to slow the flow of excess stormwater.

SCALE

200 0 200 400

IN FEET