# LINCOLN COUNTY
# DEPARTMENT OF ENVIRONMENTAL HEALTH
# WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 06/05/2020

Expiration Date: 06/05/2021

Property Owner: Rosemarie Strope

c/o:

Address: [redacted]

Telephone:

(Work)

Installer: Tally Hoe

License No. 1

___ New Installation __xx__ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Add extra drainfield to bad clay small lots Rockless Chambers with rock

*Parcel Description*:

Legal: RIVERSIDE DRIVE, S32, T31 N, R31 W, ACRES 6.65

Address or Location: Lots 14-15

Geo/Assessors code: 0000008513

*Approved Design Criteria*:

# Bedrooms 6 Septic Tank Size: 1500 gallons Drainfield Size: 25X25 lineal feet

**SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!**

***Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.***

**Issued By:** Jake Mertes, R.S.

Closure Statement:

I, Thomas J Cole, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

*Signed:* Thomas J Cole *Date:* 6-7-20

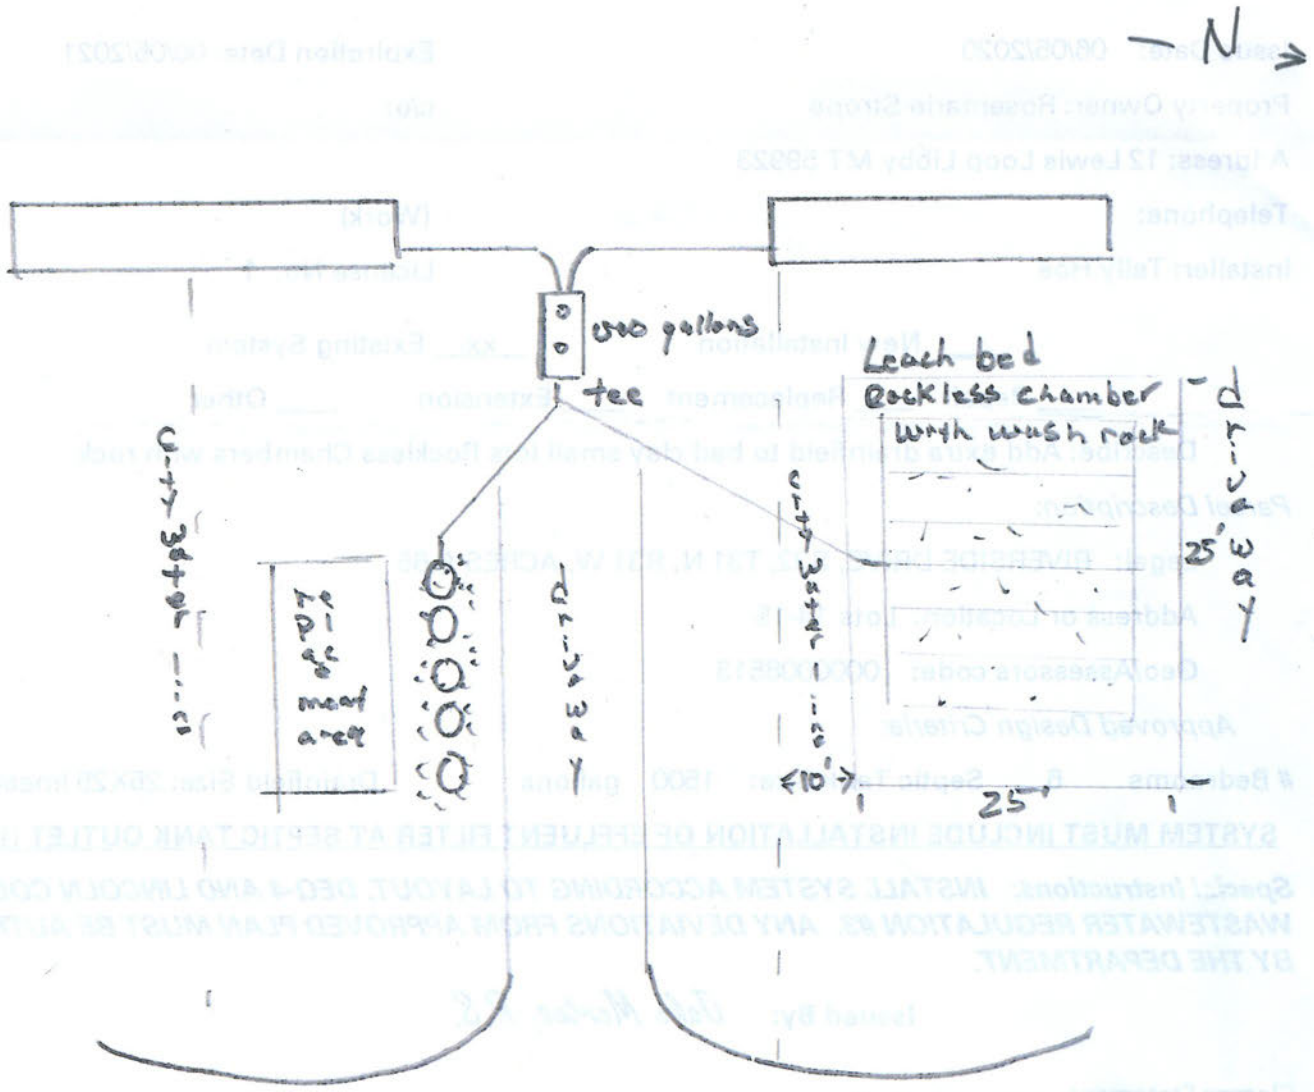
*Title:* owner operator

**NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.**

**406-283-2442**

***DISCLAIMER***

This permit is not a guarantee by the Department that the system will function properly


N
1000 gallons
tee
Leach bed
Rockless chamber
With wash rock
25'
25'
<10'
Drive way
City water line
Septic line
Septic line
City water line
Septic tank