LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 09/25/2020 Expiration Date: 09/25/2021

Property Owner: Ray Sygitowicz c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work)

Installer: Dustin Welch License No. 155

___ New Installation __XX__ Existing System

____ Repair __XX__ Replacement ____ Extension ____ Other

Describe: Thee 50' Laterals using chambers.

Parcel Description:

Legal: KOOTENAI VISTA, S27, T32 N, R34 W, BLOCK 006, LOT 6A SEC 22

Address or Location: LOT6A

Geo/Assessors code: 0000006643

Approved Design Criteria:

Bedrooms 2 Septic Tank Size: 1000 gallons Drainfield Size: 150 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Dustin Welch, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: [signature] *Date:* 10-16-20

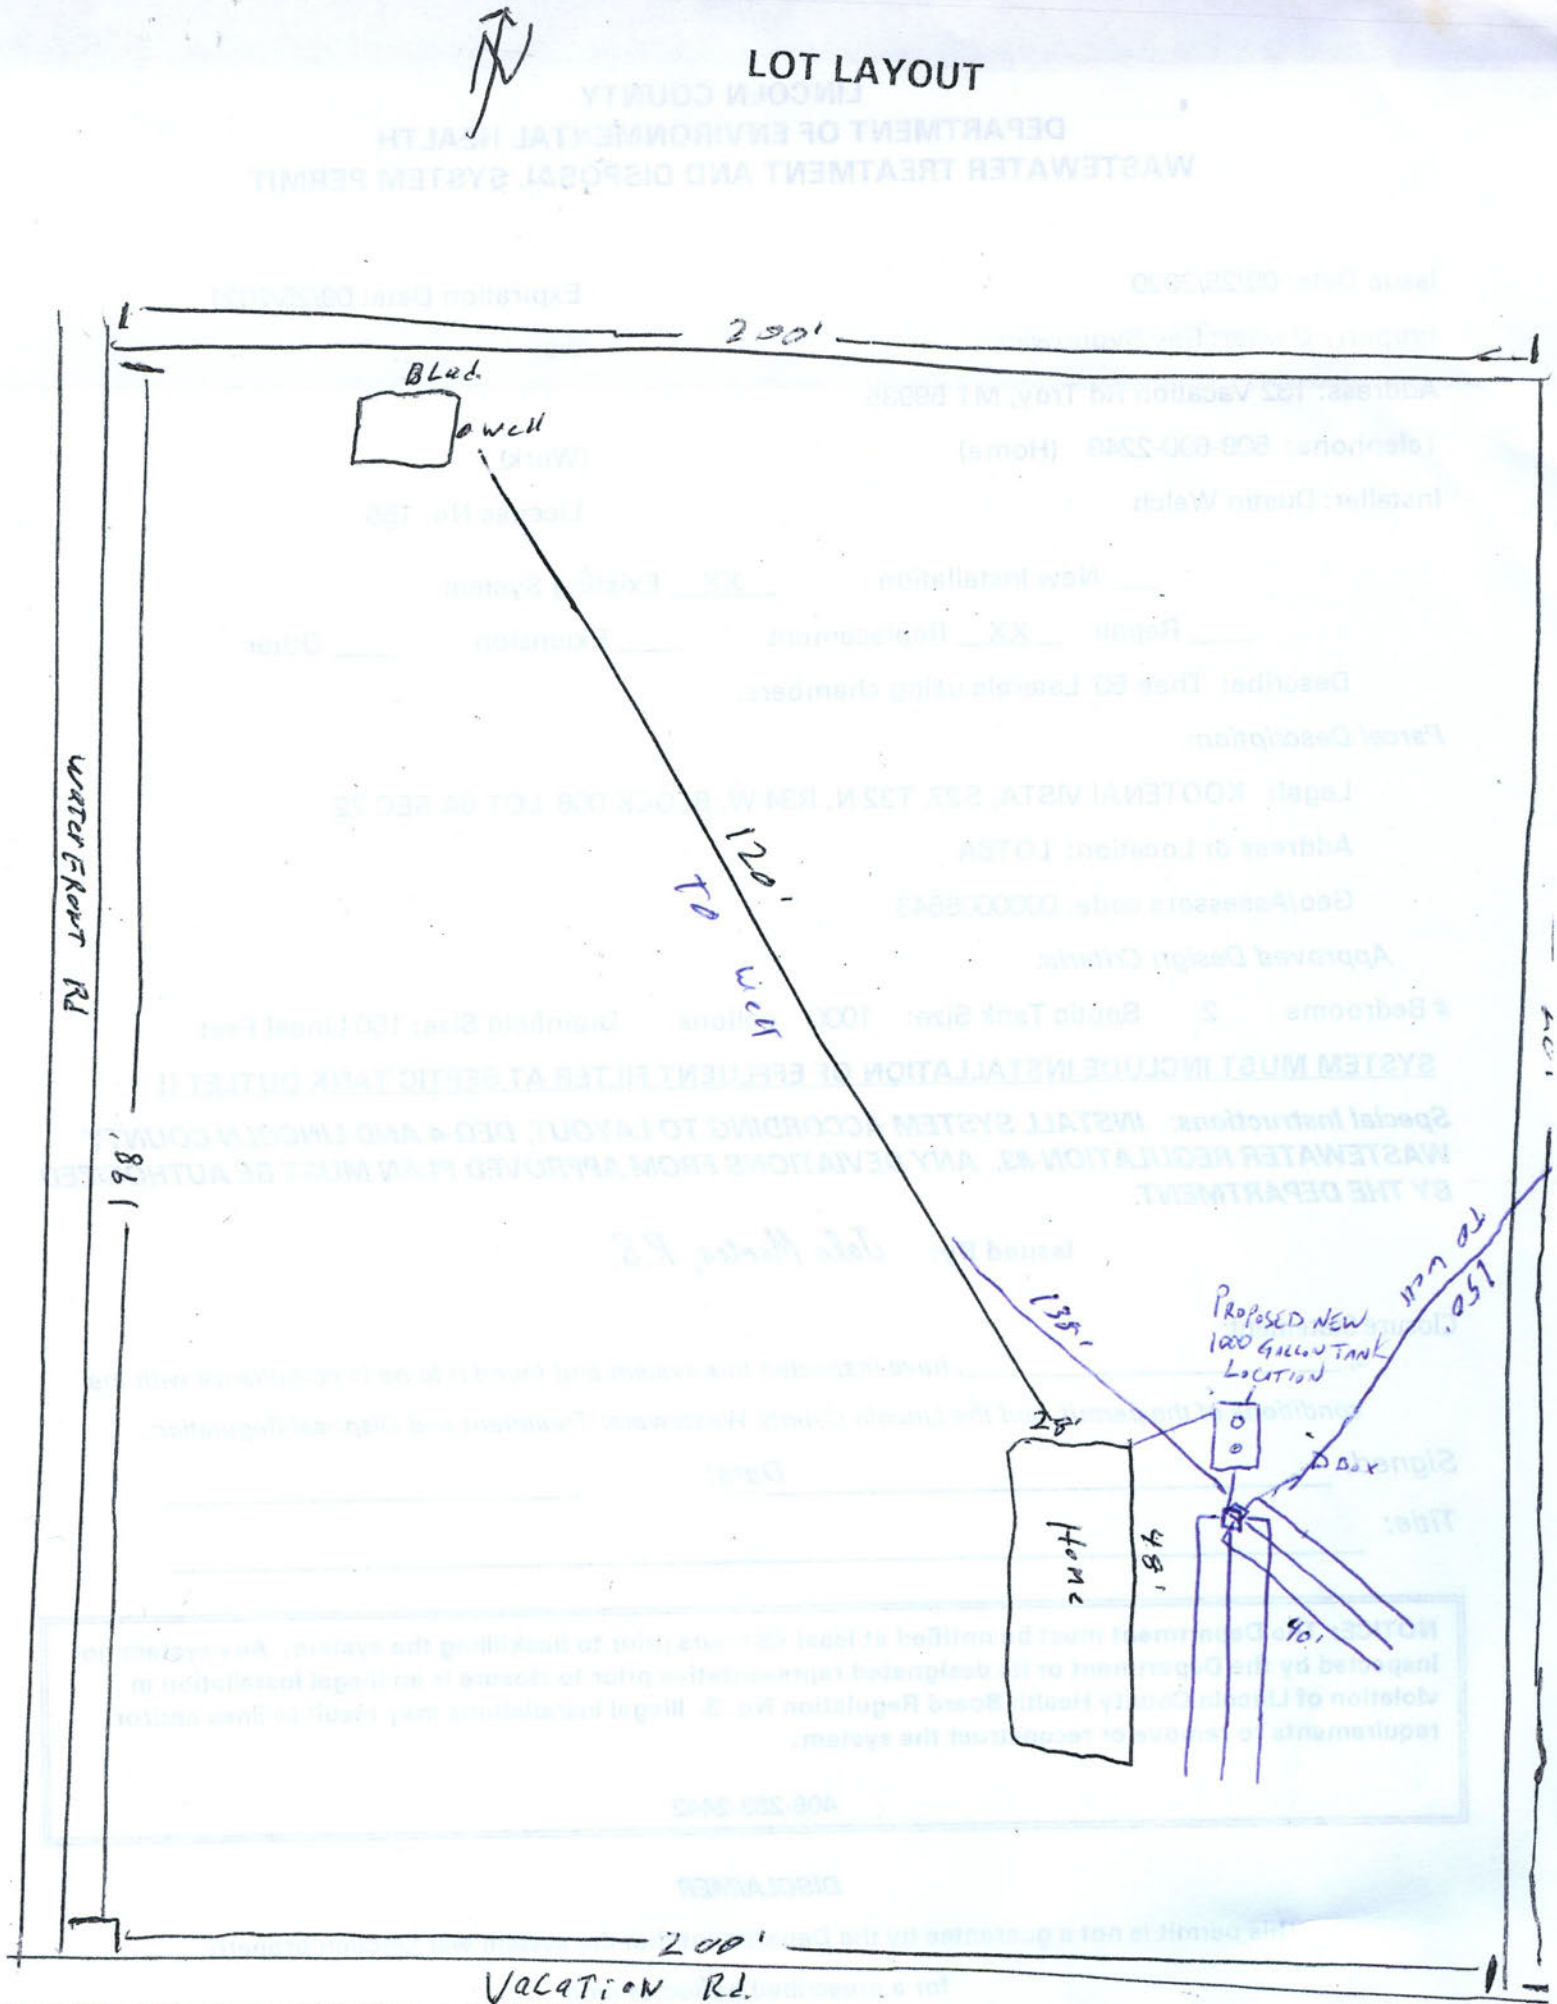
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

LOT LAYOUT


N
2 90'
Blvd.
well
120'
To well
WATERFRONT Rd
198'
135'
150'
To well
PROPOSED NEW
1000 GALLON TANK
LOCATION
28'
DOOR
home
48'
40'
200'
VACATION Rd.