LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 01/12/2021 Expiration Date: 01/12/2022

Property Owner: Douglas & DeAnn Thomas c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work)

Installer: Self/Owner License No.

___XX___ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Three 84' laterals using chambers.

Parcel Description:

Legal: LAKE CREEK RANCH PH 1, S17, T30 N, R33 W, ACRES 3.66, LOT 4 PM 7156

Address or Location: 43 Shoshone Trail Troy MT 59935

Geo/Assessors code: 0000052739

Approved Design Criteria:

Bedrooms: 3 Septic Tank Size: 1000 gallons Drainfield Size: 252 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, JAKE MERTES, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ Date: 3/23/2021

Title: COUNTY SANITARIAN

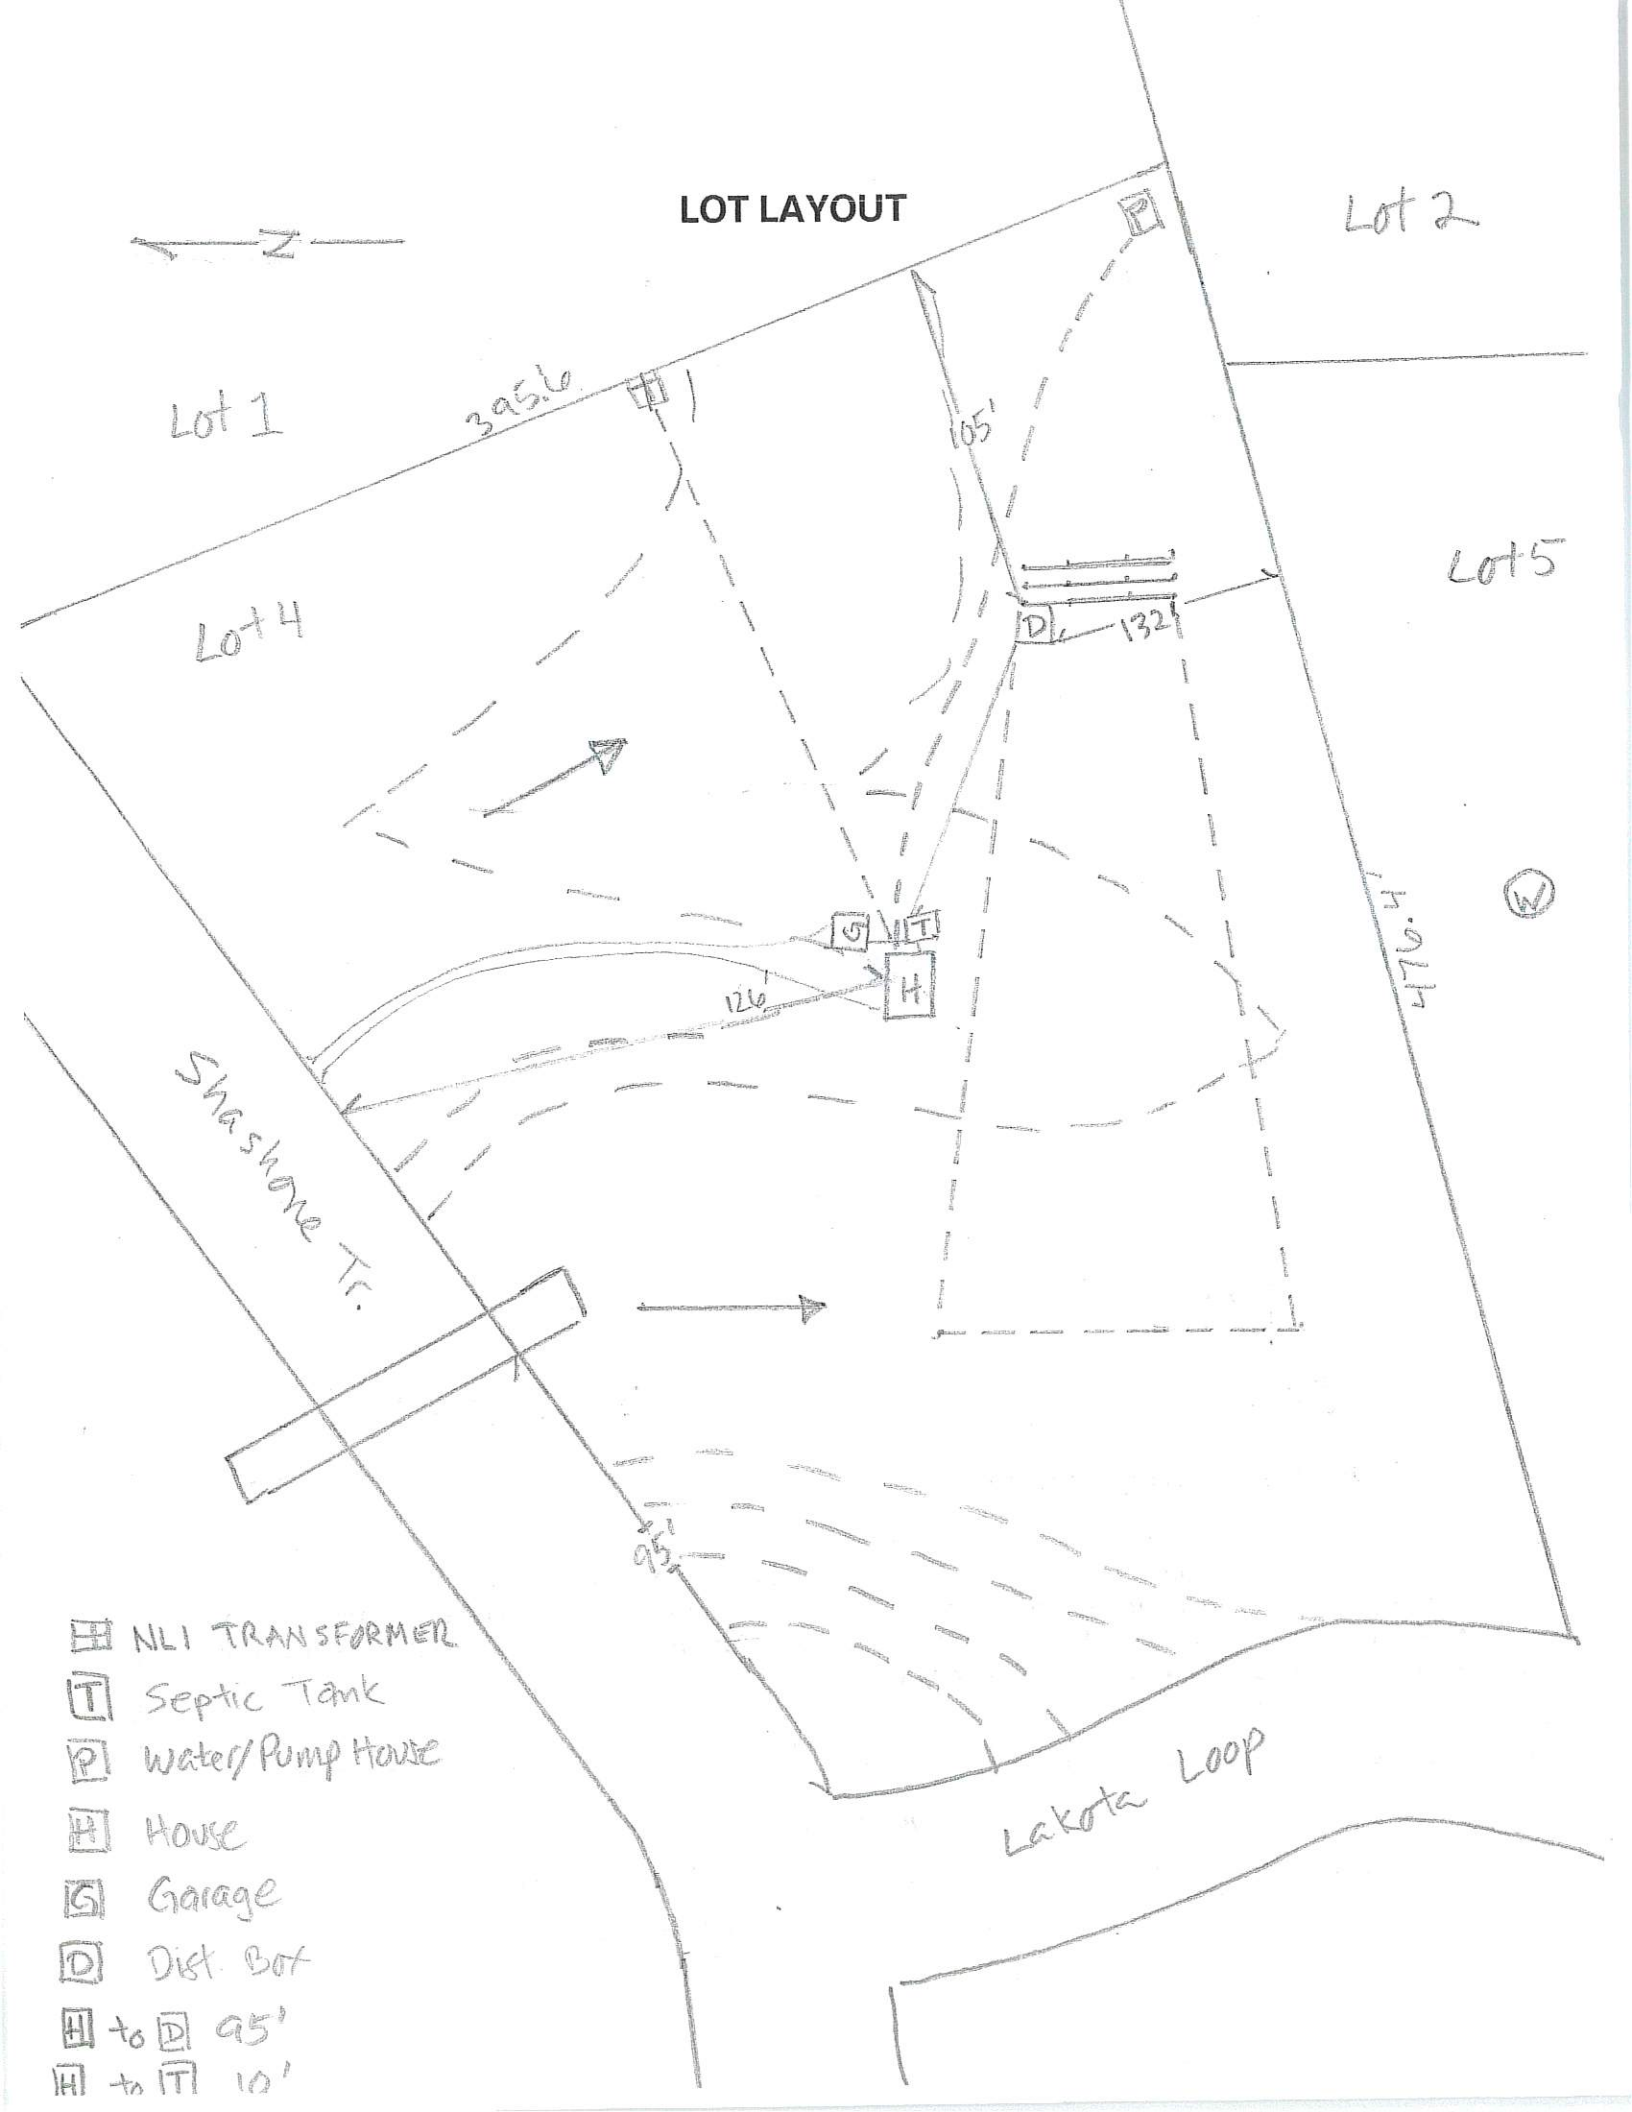
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

18


LOT LAYOUT
N
Lot 1
Lot 2
Lot 4
Lot 5
395.6'
105'
132'
126'
95'
H
D
S
T
P
W
Shashone Tr.
Lakota Loop
NLI TRANSFORMER
Septic Tank
Water/Pump House
House
Garage
Dist. Box
H to D 95'
H to T 10'