County

LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

~~Issue Date: 10/14/2020~~ ~~Expiration Date: 10/14/2021~~

Property Owner: Steve & Diane Tralles c/o:

Address: [redacted]

Telephone: (Home) (Work)

Installer: Tally Hoe License No. 1

___ New Installation ____ Existing System

__Repair ___XX_ Replacement ____ Extension ____ Other

Describe: ~~Three~~ 2 80' Laterals using chambers.

Parcel Description:

Legal: RAWLINGS ROAD, S29, T31 N, R31 W, Lot 008, N 1/2 OF LOT 8 2.17 ACRES

Address or Location: Lot 008, N 1/2 OF LOT 8, 53 BALD EAGLE RD Libby

Geo/Assessors code: 0000008593

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 162 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Thomas J Cole *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Thomas J Cole *Date:* 11-11-20

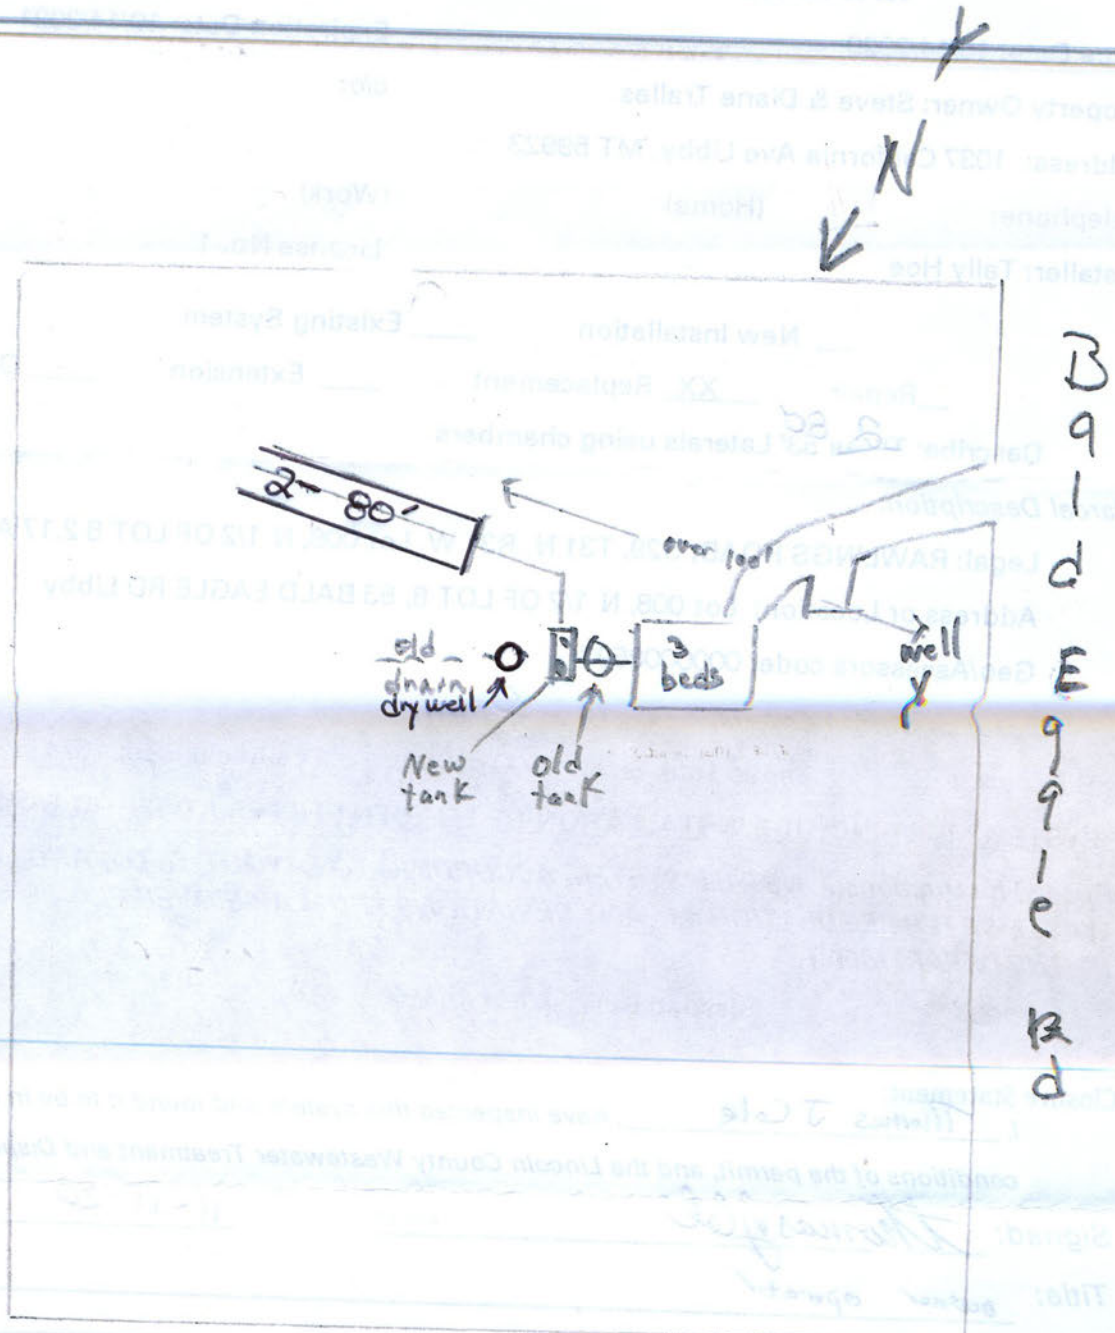
Title: owner operated

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


N
2- 80'
over load
old drain dry well
3 beds
well
New tank
old tank
Bald Eagle Rd

Rawling ed