County

LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 12/16/2020 Expiration Date: 12/16/2021

Property Owner: Robert Vetter c/o:

Address: [redacted]

Telephone: (Home) (Work)

Installer: Tally Hoe License No. 1

___ New Installation __XX__ Existing System

____ Repair __XX__ Replacement ____ Extension ____ Other

Describe: 400 Square feet leach bed with 7 rows of rockless chamber.

Parcel Description:

Legal: GLENWOOD PARK, S04, T30 N, R31 W, ACRES 0.247, N68' OF LOT 3 & S15' OF LOT 2

Address or Location: N68' OF LOT 3 & S15' OF LOT 2

Geo/Assessors code: 0000009276

Approved Design Criteria:

Bedrooms: 3 Septic Tank Size: 1000 gallons Drainfield Size: 400 Sq. Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Thomas J Cole, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Thomas J Cole *Date:* 12-19-20

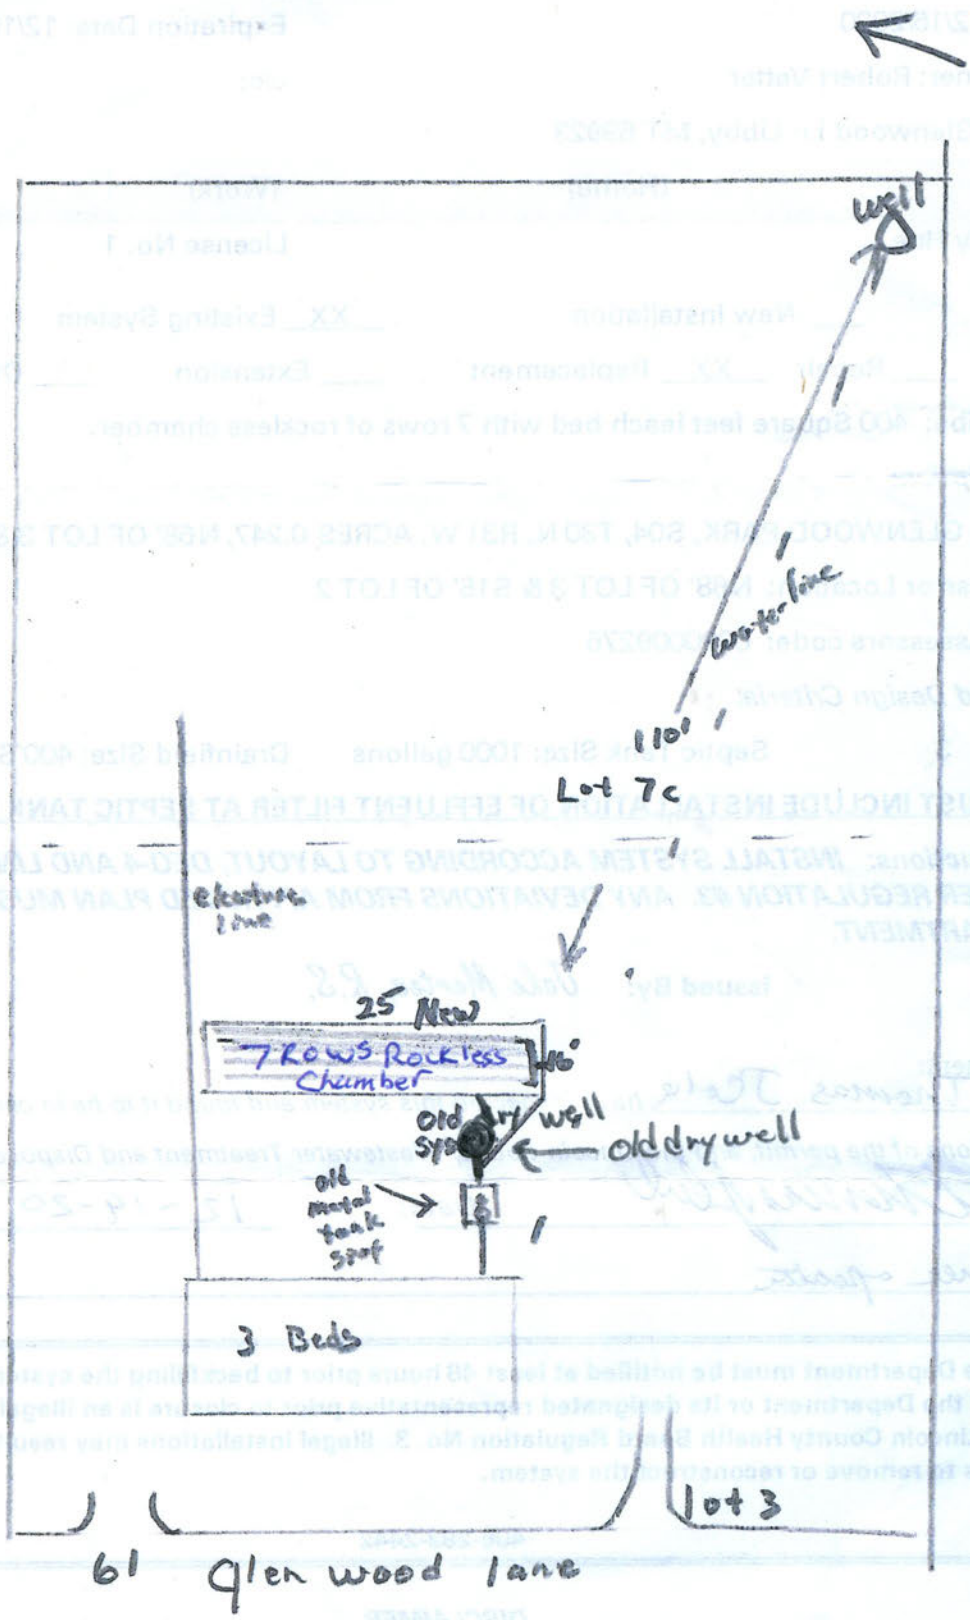
Title: owner operator

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


N
well
water line
110'
Lot 7c
electric line
25 New
7 Rows Rockless Chamber
46'
old dry well
old dry well
old metal tank 500g
3 Beds
Lot 3
61 Glen wood lane