LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Permit # 24-10860

Issue Date: 07/08/2024 Expiration Date: 07/07/2025

Property Owner: John Bayrak

Mailing Address: [redacted]

Installer: Jessica Svendsbye License #: 192

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of 3 community drainfields with 3 dosing tanks 2000 gallon each for (19) 2 Bedroom lots and 6 RV lots 4,875 GPD maximum.

Legal: S22, T32 N, R29 W, ACRES 317.77

Property Address: Barron/Bristow Crk. Libby, MT 59923 Assessment Code: 10860

DEQ COSA: EQ#22-1670 Date: 08/07/23

Approved Design Criteria: Installation of 3 community drainfields with 3 dosing tanks 2000 gallon each. County Sanitarian and Miles McElhinney, P.E. will need to sign the closure statement.

Each individual lot is required to apply for Lincoln County Wastewater Permit for tank and connection to community system.

# of Tanks: 3 DosingTank Size: 2000 gallons Trench Width: 36"

Drainfield Size: 3312 (19) 2 Bedroom Lots & 6 RV Lots 4,875 GPD Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, R.S.

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.


Signed: Robin Blumberg Date: 8/20/25

Signed: MM Date: 8/20/25

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

EQ# 22-1670

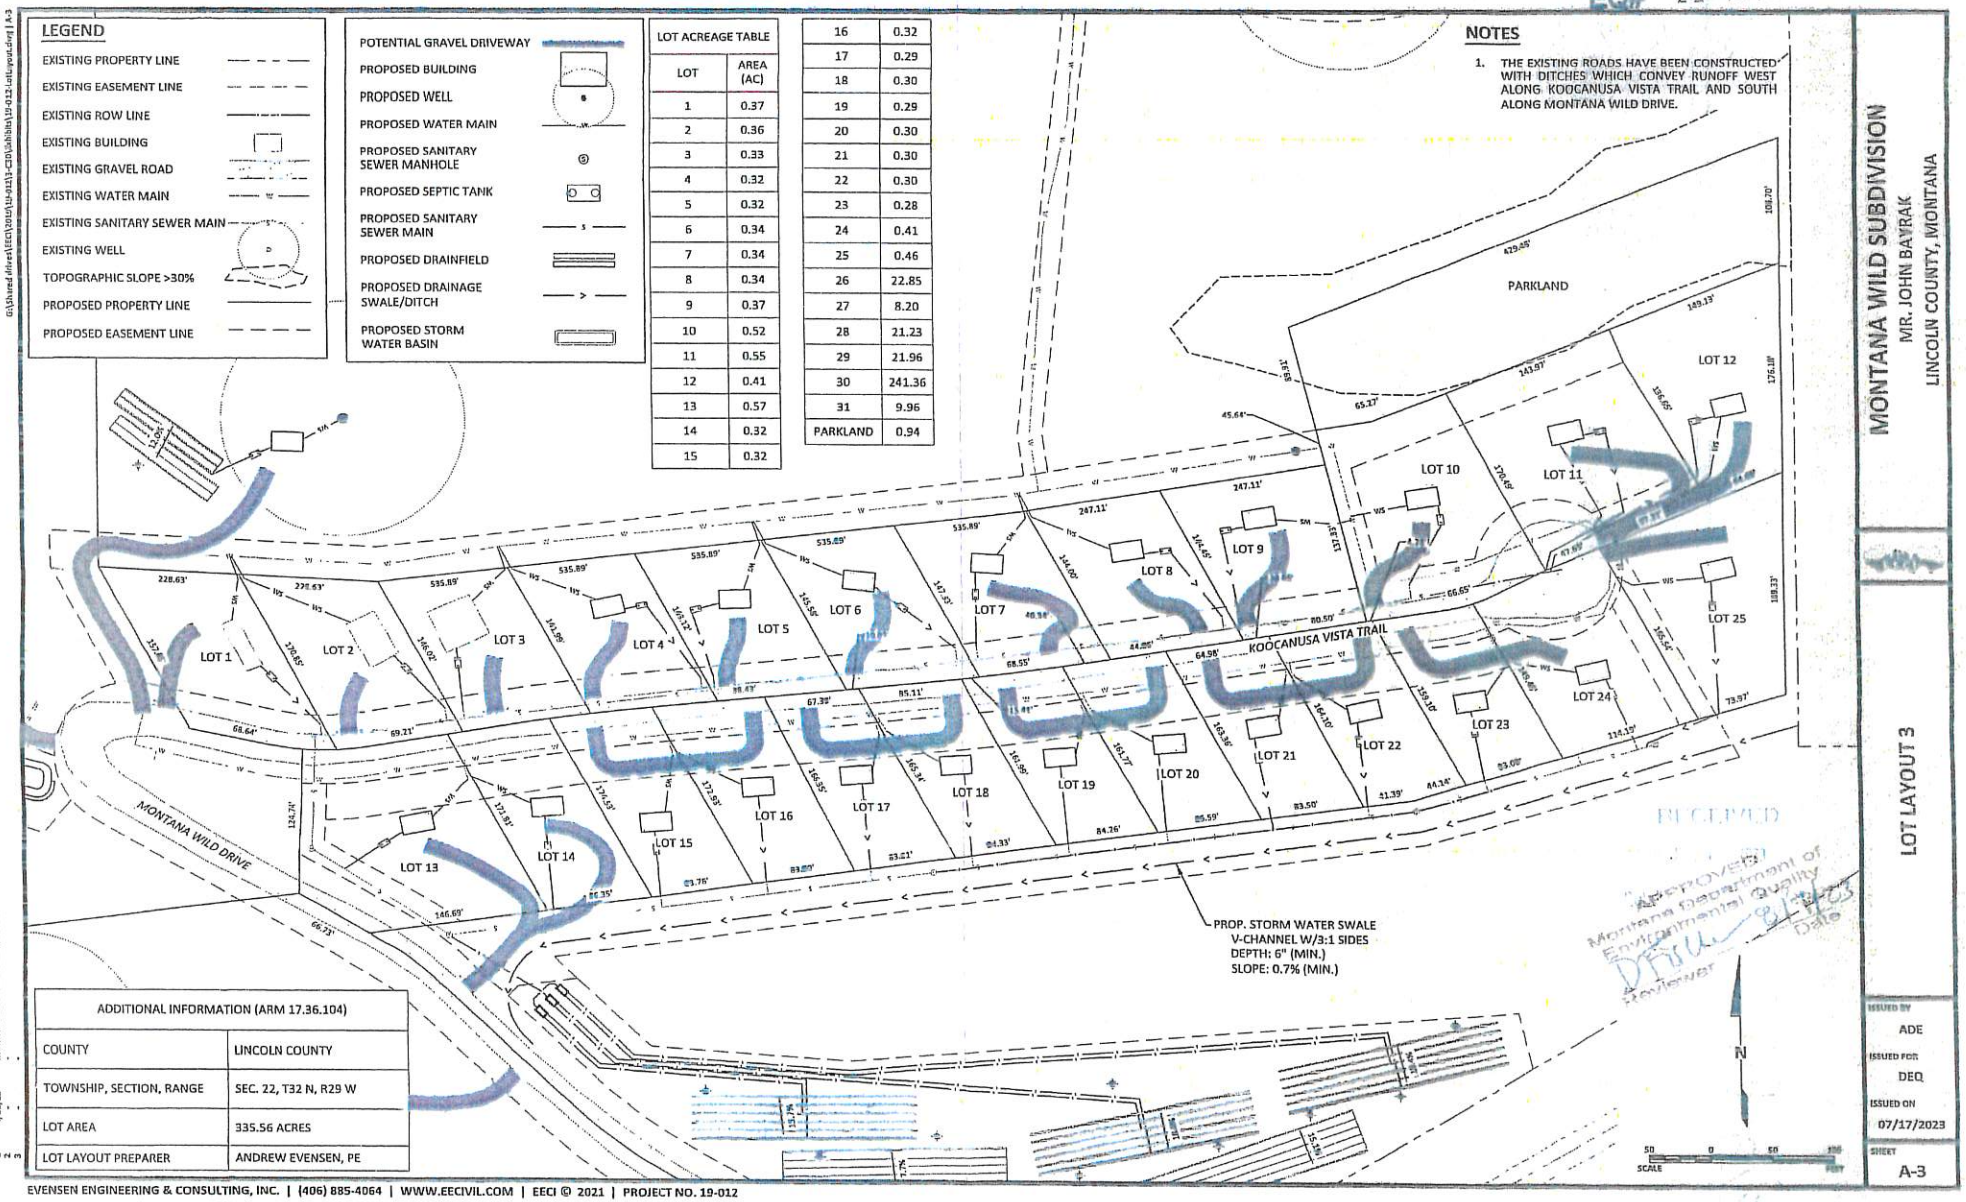

LOT ACREAGE TABLE

LOT	AREA (AC)
1	0.37
2	0.36
3	0.33
4	0.32
5	0.32
6	0.34
7	0.34
8	0.34
9	0.37
10	0.52
11	0.55
12	0.41
13	0.57
14	0.32
15	0.32
16	0.32
17	0.29
18	0.30
19	0.29
20	0.30
21	0.30
22	0.30
23	0.28
24	0.41
25	0.46
26	22.85
27	8.20
28	21.23
29	21.96
30	241.36
31	9.96
PARKLAND	0.94

ADDITIONAL INFORMATION (ARM 17.36.104)	
COUNTY	LINCOLN COUNTY
TOWNSHIP, SECTION, RANGE	SEC. 22, T32 N, R29 W
LOT AREA	335.56 ACRES
LOT LAYOUT PREPARER	ANDREW EVENSEN, PE

RECEIVED
Approved
Montana Department of Environmental Quality
DEQ Reviewer
Date

REVISION	DATE	MODIFICATION
1	8/22/22	INCLUDED DOSE TANK IN CHANGES SIPHON SIZES
2	-	-
3	-	-

MONTANA WILD SUBDIVISION
MR. JOHN BAYRAK
LINCOLN COUNTY, MONTANA

LOT LAYOUT 3

ISSUED BY: ADE
ISSUED FOR: DEQ
ISSUED ON: 07/17/2023
SHEET: A-3

G:\Shared drives\EECI\Projects\19-012\1-CDD\Exhibits\19-012-LotLayout.dwg | A-3