LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 9/21/2015 Expiration Date: 9/22/2016

Property Owner: Sarah Bilal c/o: Koocanusa Plumbing and Elect.

Address: [redacted]

Telephone: (Home) (Work) [redacted]

Installer: Koocanusa Plumbing and Electric License No. 8

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: 3 44' laterals. Pressure dosed in three foot wide trenches

Parcel Description:

Legal: Lot 9 Barnaby Lake Subdivision

Address or Location:

Approved Design Criteria:

Bedrooms 2 Septic Tank Size: 1000/500 gallons Drainfield Size: 132 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes

Closure Statement:

I, Michael Nelson *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: [signature] *Date:* 30 Sept 2015

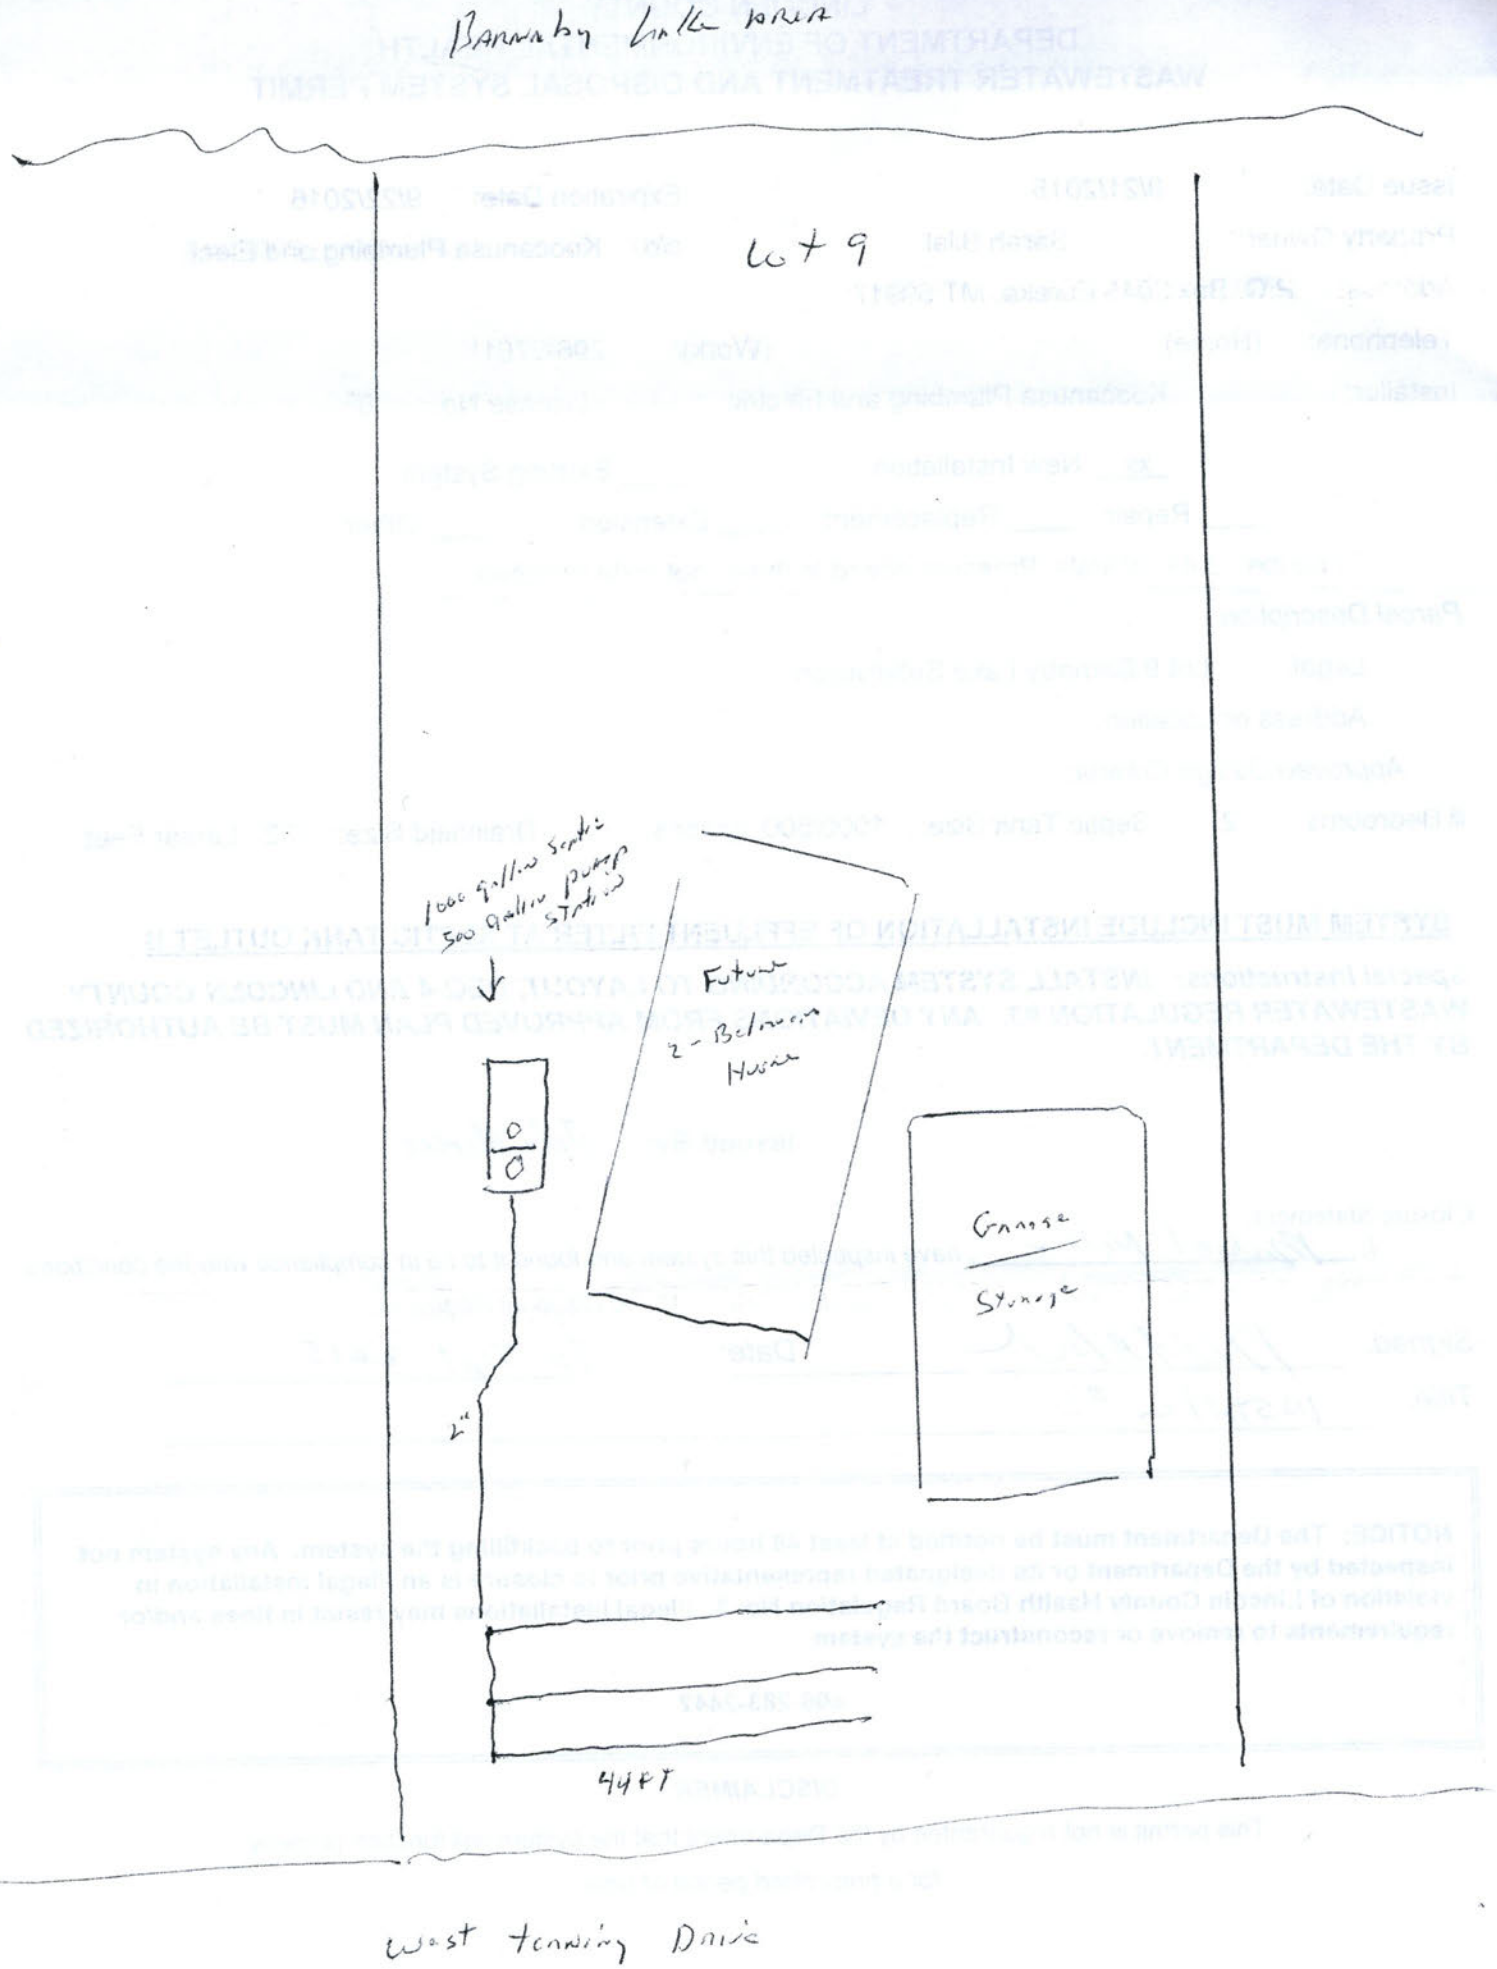
Title: Installer #2

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Barnaby Lake Drive
Lot 9
1000 gallon Septic
500 gallon pump station
Future
2 - Bedroom
House
Garage
Storage
2"
4YPT
West Fanning Drive