LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 9/5/2008 Expiration Date: 9/5/2009

Property Owner: Justin Brooks c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Gideon Yutzy License No. 113

Proposed Work: (Check One) __X__ New Installation ____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Installing two 76-foot lines using infiltrators after 20% reduction on drainfield size.

Parcel Description:

Legal: S11 T37N R28W

Address or Location: Lot 2 Green Basin Vista

Approved Design Criteria:

Bedrooms 2 Septic Tank Size: 1000 Gallons Drainfield Size: 150 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Lori Kelley-Bowe, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ ***Date:***

Title:

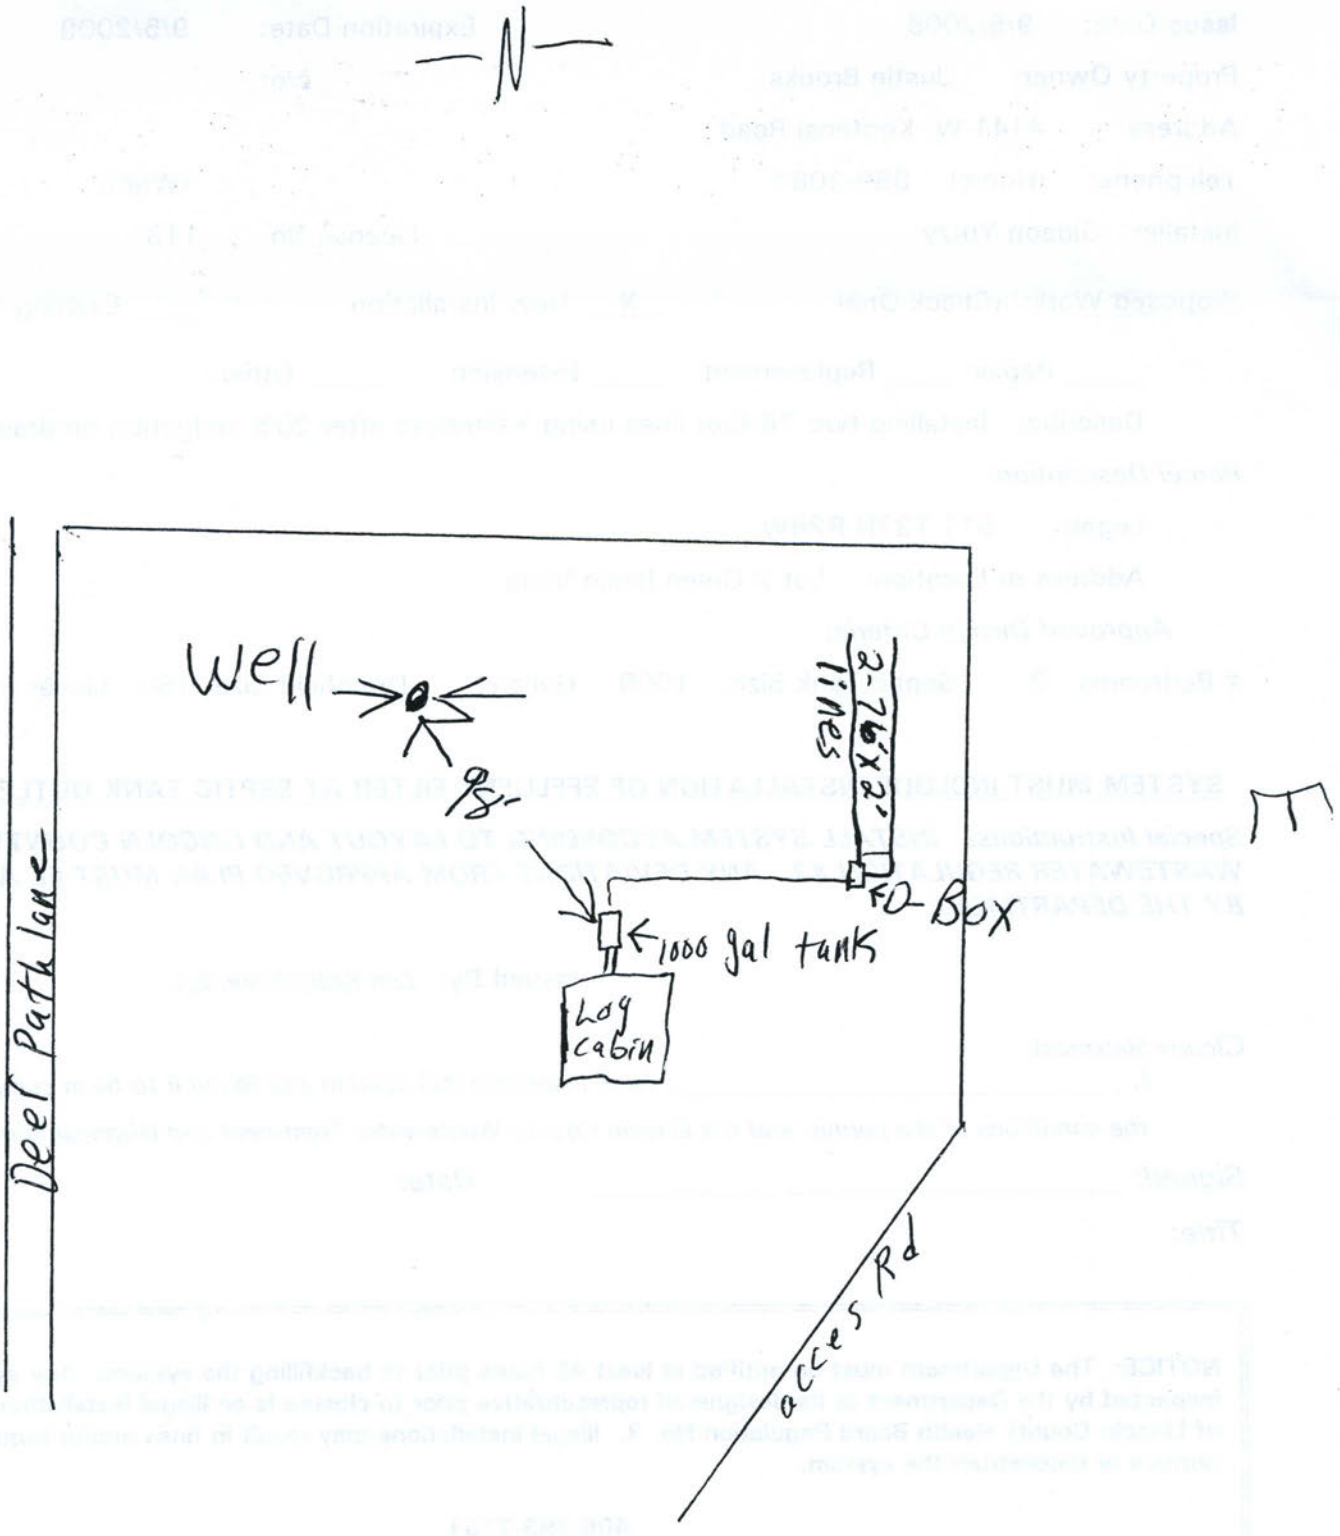
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


N
Well
2-70'x2' lines
FD Box
1000 gal tank
Log cabin
Deer Path lane
access Rd