# LINCOLN COUNTY
# DEPARTMENT OF ENVIRONMENTAL HEALTH
# WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/23/2019 Expiration Date: 10/23/2020

Property Owner: Brandon & Stephanie Callahan c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work)

Installer: Gideon Yutzy License No. 113

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Five 84' pressure dosed laterals in 3' wide trenches

*Parcel Description*:

Legal: S21, T36 N, R26 W, E2SWSW OR TR 5 20.00 ACRES *11296*

Address or Location: TR 5

Geo/Assessors code: 0000011296

*Approved Design Criteria*:

# Bedrooms 7 Septic Tank Size: 2000/500 gallons Drainfield Size: 588 Lineal Feet

**SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!**

***Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.***

**Issued By:** Jake Mertes, R.S.

Closure Statement:

*I,* Gideon Yutzy *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

*Signed:* Gideon Yutzy *Date:* 11-15-2019

*Title:* licensed installer #113

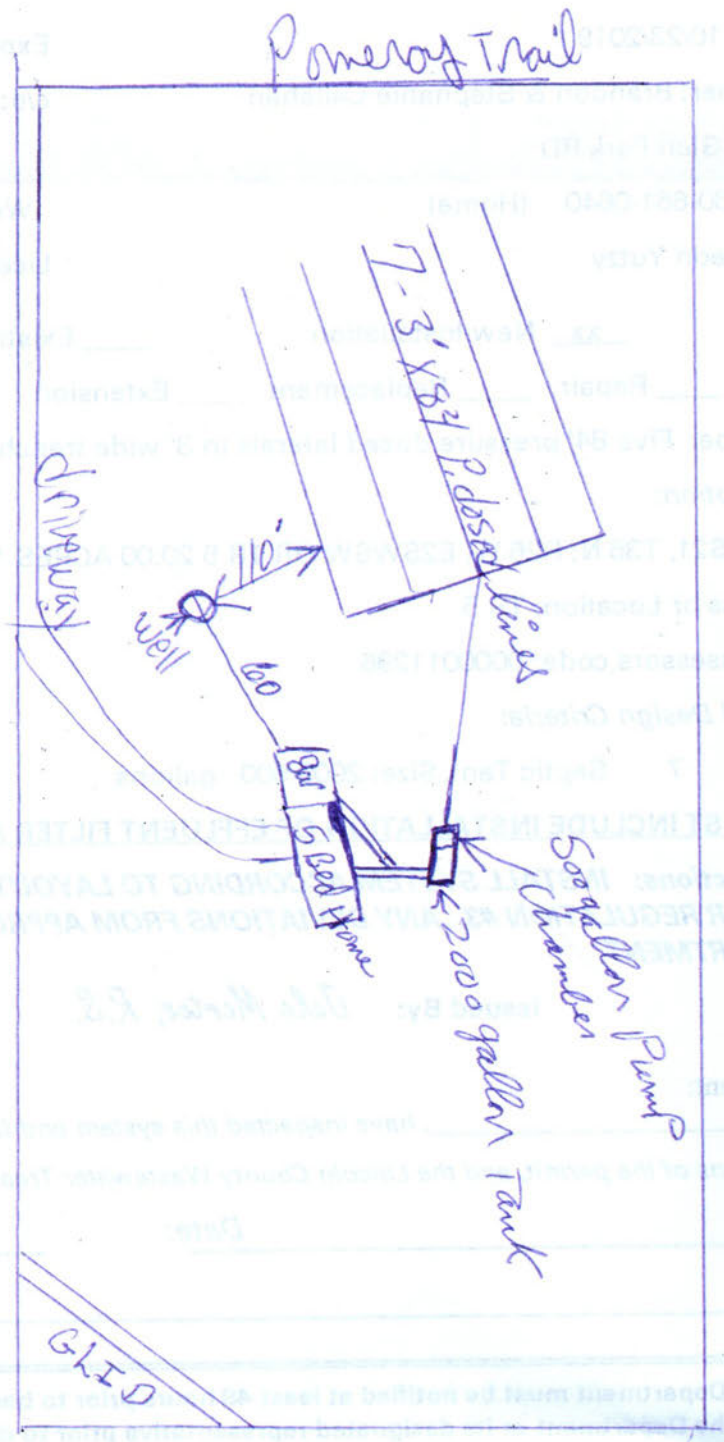
**NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.**

**406-283-2442**

***DISCLAIMER***

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

## LOT LAYOUT


N
Pomeroy Trail
7-3'x84' L.dosed lines
110'
well
60
Driveway
Bar
5 Bed Home
500 gallon Pump Chamber
2000 gallon Tank
GLO