LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 01/21/2020

Expiration Date: 01/21/2021

Property Owner: Lawrence Casazza

c/o:

Address: [redacted]

Telephone: [redacted] (Home)

[redacted] (Work)

Installer: R&L Peterson Construction

License No. 92

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Four 84' laterals using gravelless chambers size reduced per 0.4 App Rate

Parcel Description:

Legal: S07, T36 N, R26 W, C.O.S. 3766/4384, ACRES 130.14, PARCELS A & NENW of SEC

Address or Location: COS 3766/4384

Geo/Assessors code: 0000055202

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 300 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Ricky Peterson, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Ricky Peterson *Date:* 5/14/2020

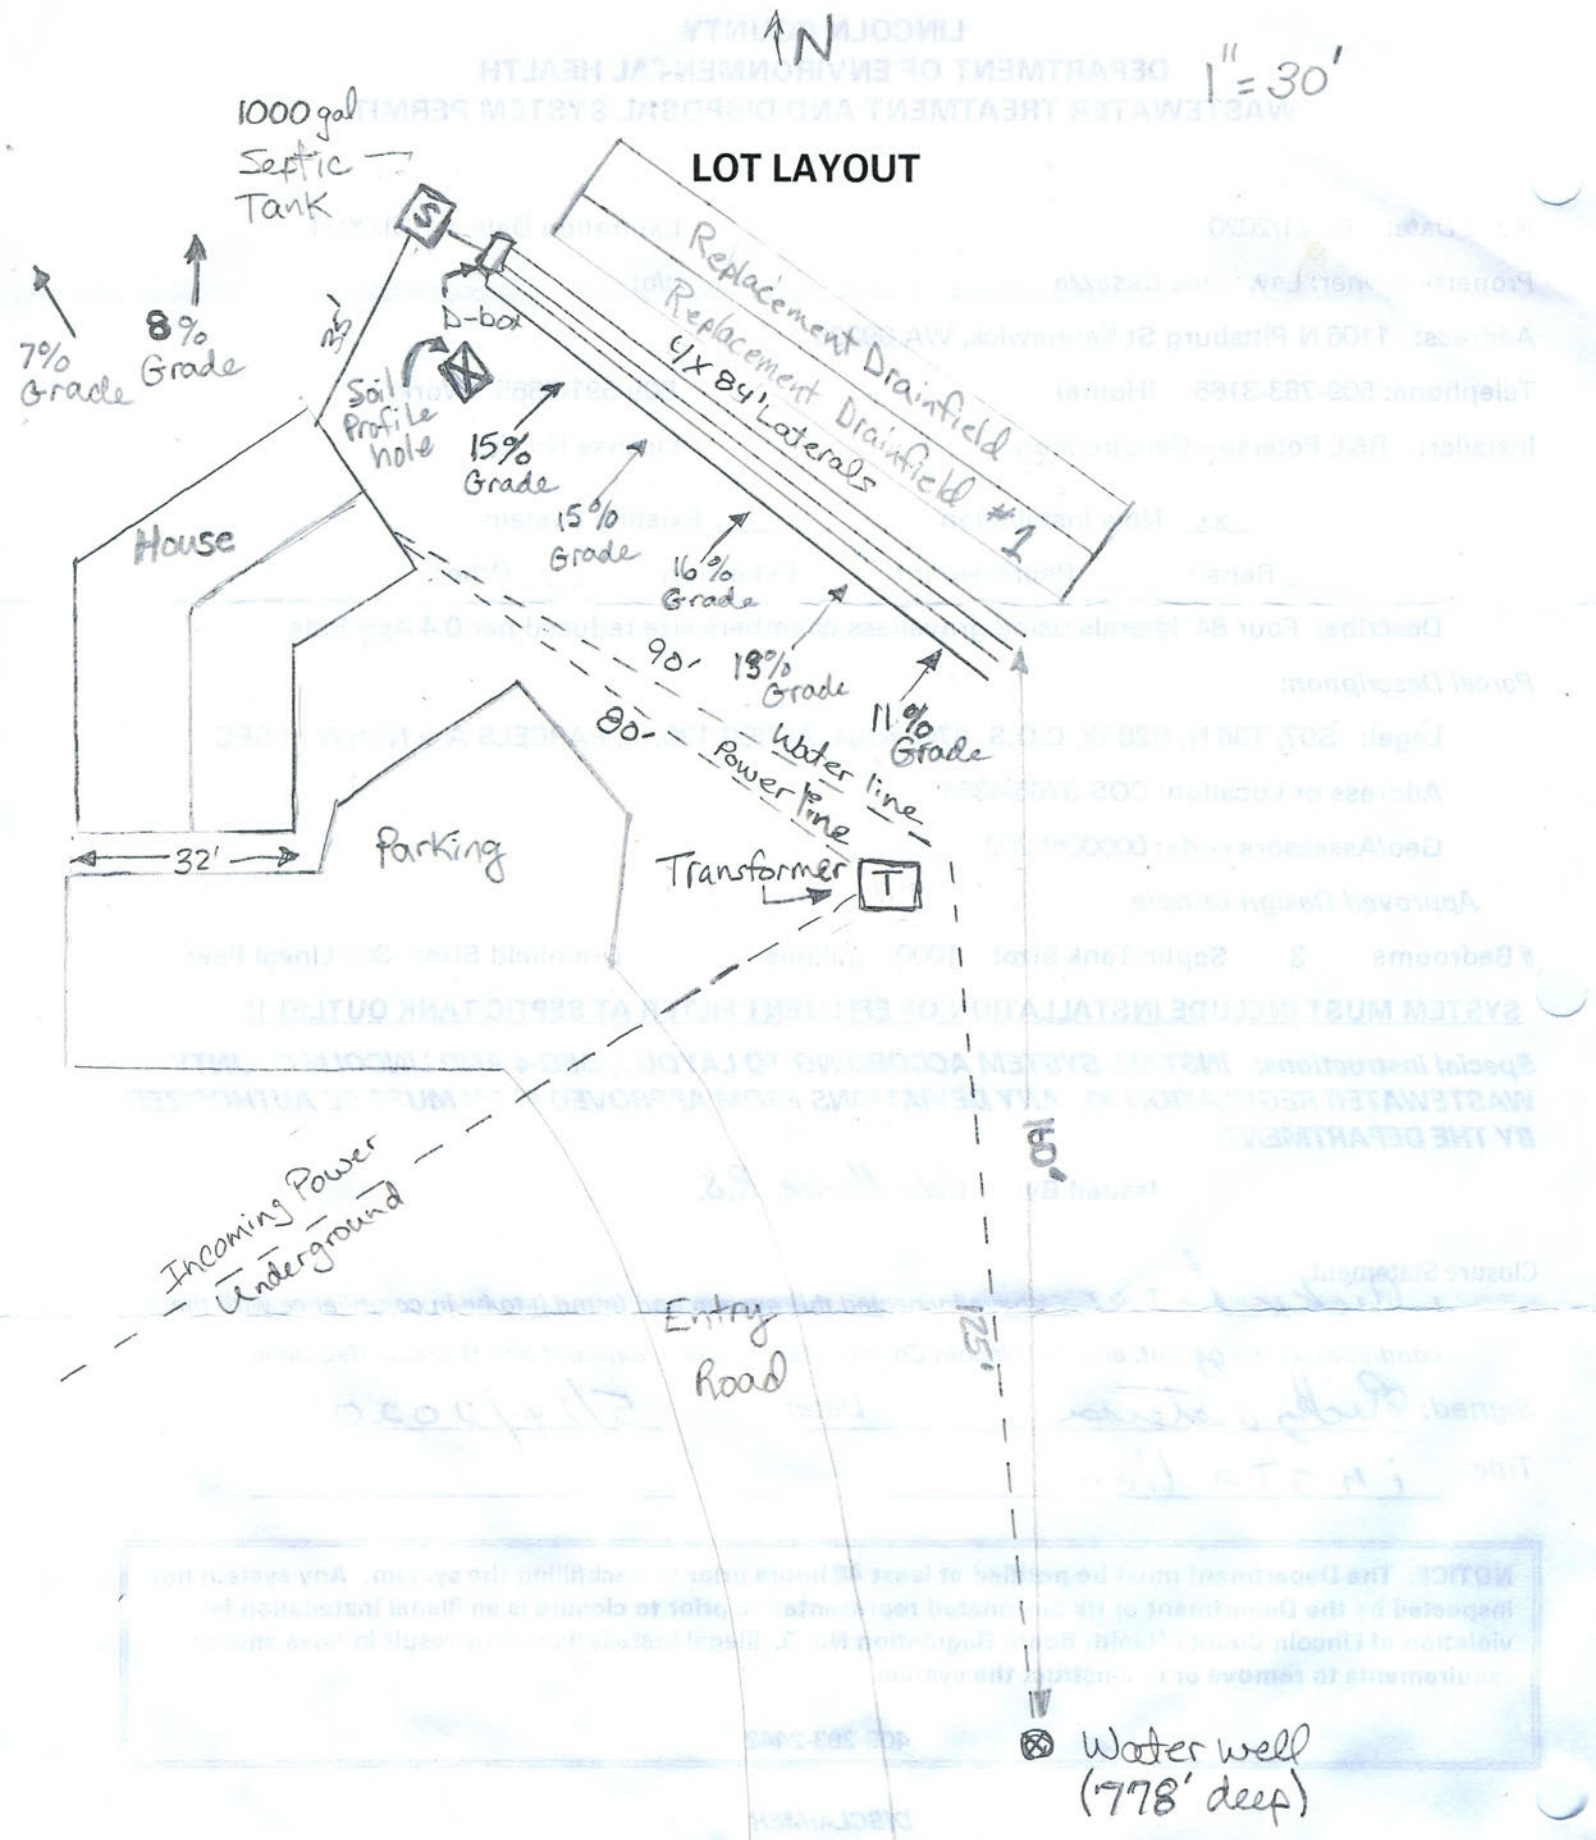
Title: installer

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly


N
1" = 30'
LOT LAYOUT
1000 gal Septic Tank
S
D-box
Soil Profile hole
7% Grade
8% Grade
15% Grade
15% Grade
16% Grade
18% Grade
11% Grade
Replacement Drainfield
Replacement Drainfield #1
4 X 84' Laterals
House
90'
80'
Water line
Power line
32'
Parking
Transformer
T
Incoming Power Underground
Entry Road
125'
Water well (178' deep)