LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 06/04/2020 Expiration Date: 06/04/2021

Property Owner: Wendy Chalcraft c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work)

Installer: Bradley Persson License No. 159

__XX__ New Installation ___ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Five 80' Pressure dosed trenches in deep sand lined trenches

Parcel Description:

Legal: S28, T35 N, R27 W, ACRES 1.16, TR-2J OR IRR PM#1004 IN NES

Address or Location: Tr-2J

Geo/Assessors code: 0000007244

Approved Design Criteria:

Bedrooms 2 Septic Tank Size: 1500 gallons Drainfield Size: 400 lineal feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, BRADLEY S. PERSSON *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Bradley S. Persson *Date:* June. 20 2020

Title: Installer License # 159

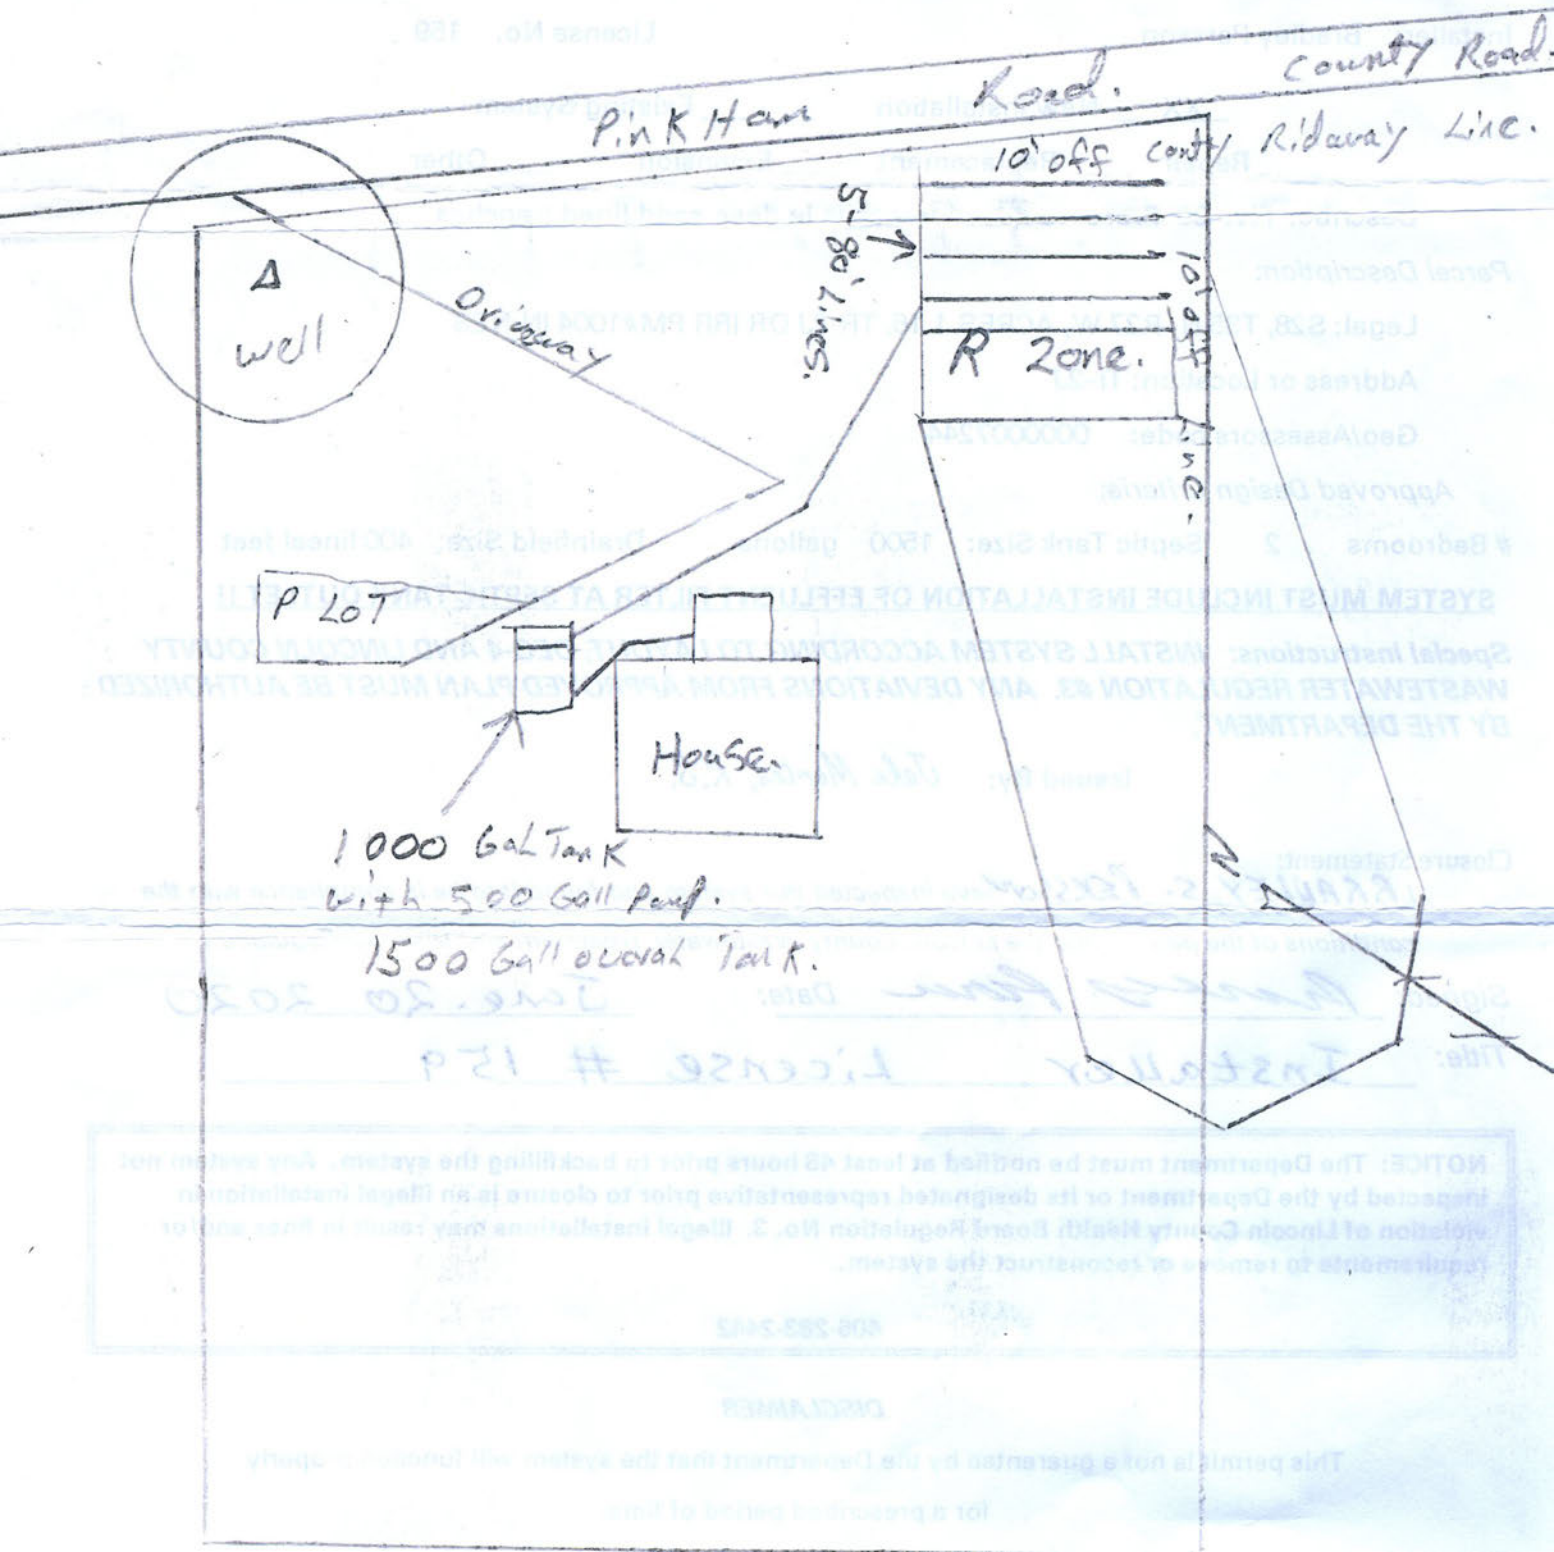
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


Pink Ham Road.
County Road.
10' off county R/away Line.
Δ well
Driveway
50'-8" Min.
10' off
R Zone.
Line.
P LOT
House.
1000 Gal Tank
with 500 Gall Pump.
1500 Gall overal Tank.