LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 11/12/2019 Expiration Date: 11/12/2020

Property Owner: Andy & Nancy Debattista c/o:

Address: [redacted]

Telephone: (Home) (Work) [redacted]

Installer: Terry Oedwaldt License No. 002

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Three 80' laterals using gravelless chambers

Parcel Description:

Legal: SWEDE MTN LOOKOUT ESTATES, S30, T30 N, R30 W, ACRES 8.456, LOT 1A PM 6383

Address or Location: Lot 1A

Geo/Assessors code: 0000016470

Approved Design Criteria:

Bedrooms 4 Septic Tank Size: 1500 gallons Drainfield Size: 240 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, TERRY OEDEWALDT, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: _____ *Date:* 11/14/19

Title: PRESIDENT


NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.


406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

DEBATTISTA 11/12/19

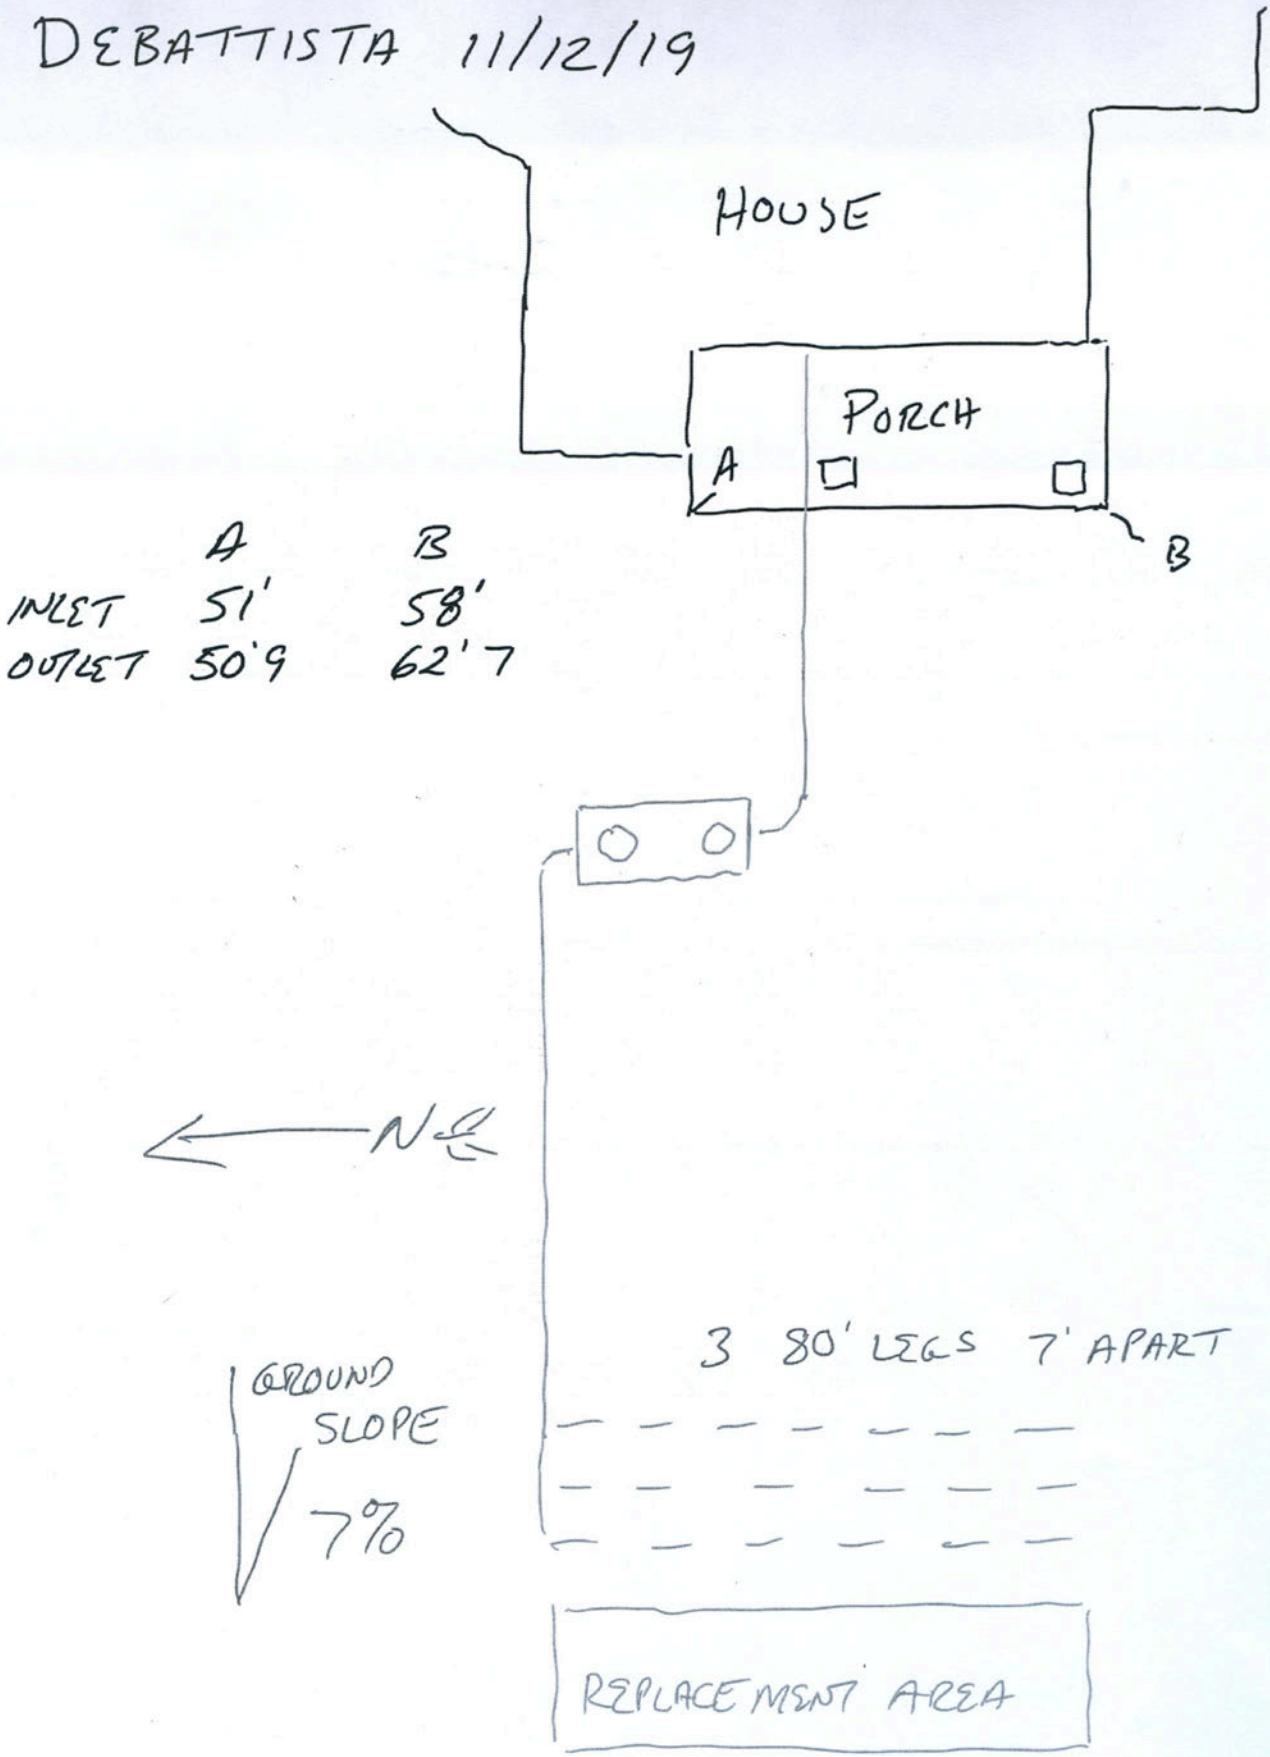

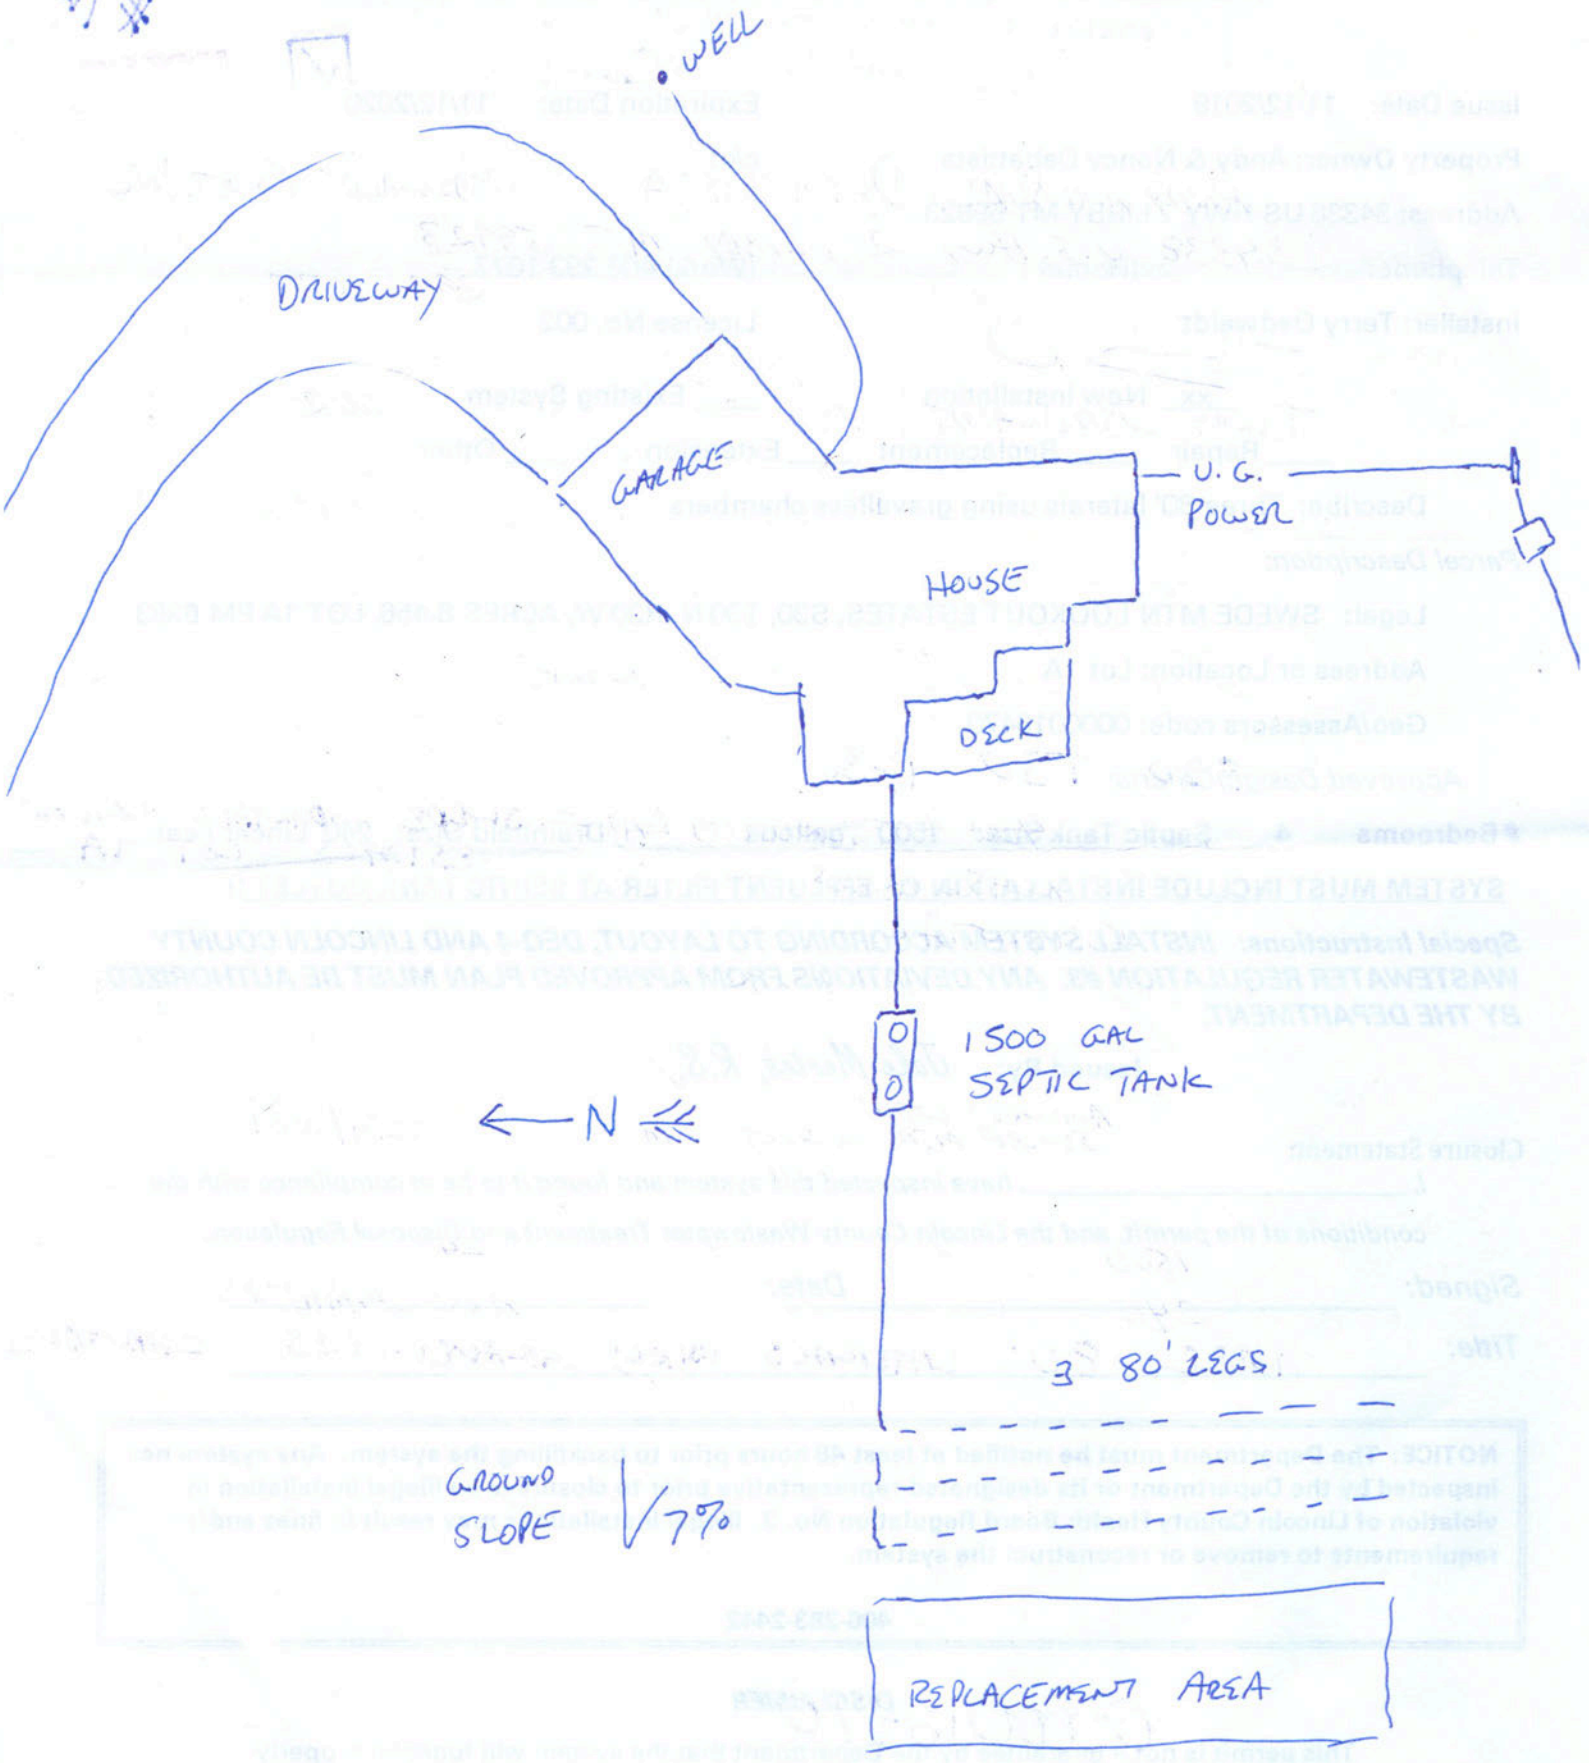
WELL
DRIVEWAY
GARAGE
U. G.
POWER
HOUSE
DECK
1500 GAL
SEPTIC TANK
N
3 80' LEGS
GROUND
SLOPE
7%
REPLACEMENT AREA