County

LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 5/8/2020 Expiration Date: 5/8/2021

Property Owner: Jack DeShazer c/o: Rivers Edge Mobile

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Tally Hoe License No. 001

____ New Installation ___xx__ Existing System

____ Repair ___xx__ Replacement____ Extension ____ Other

Describe: Replace tank and 6 drywells.

Parcel Description:

Legal: S30 T31 R30 Tract 1 C

Address or Location: Rivers Edge Mobile Park Unit # 33

Geo/Assessors code: 0000009318

Approved Design Criteria:

Bedrooms 5 Septic Tank Size: 1500 gallons Drainfield Size: 6 Drywells

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Thomas J Cole *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

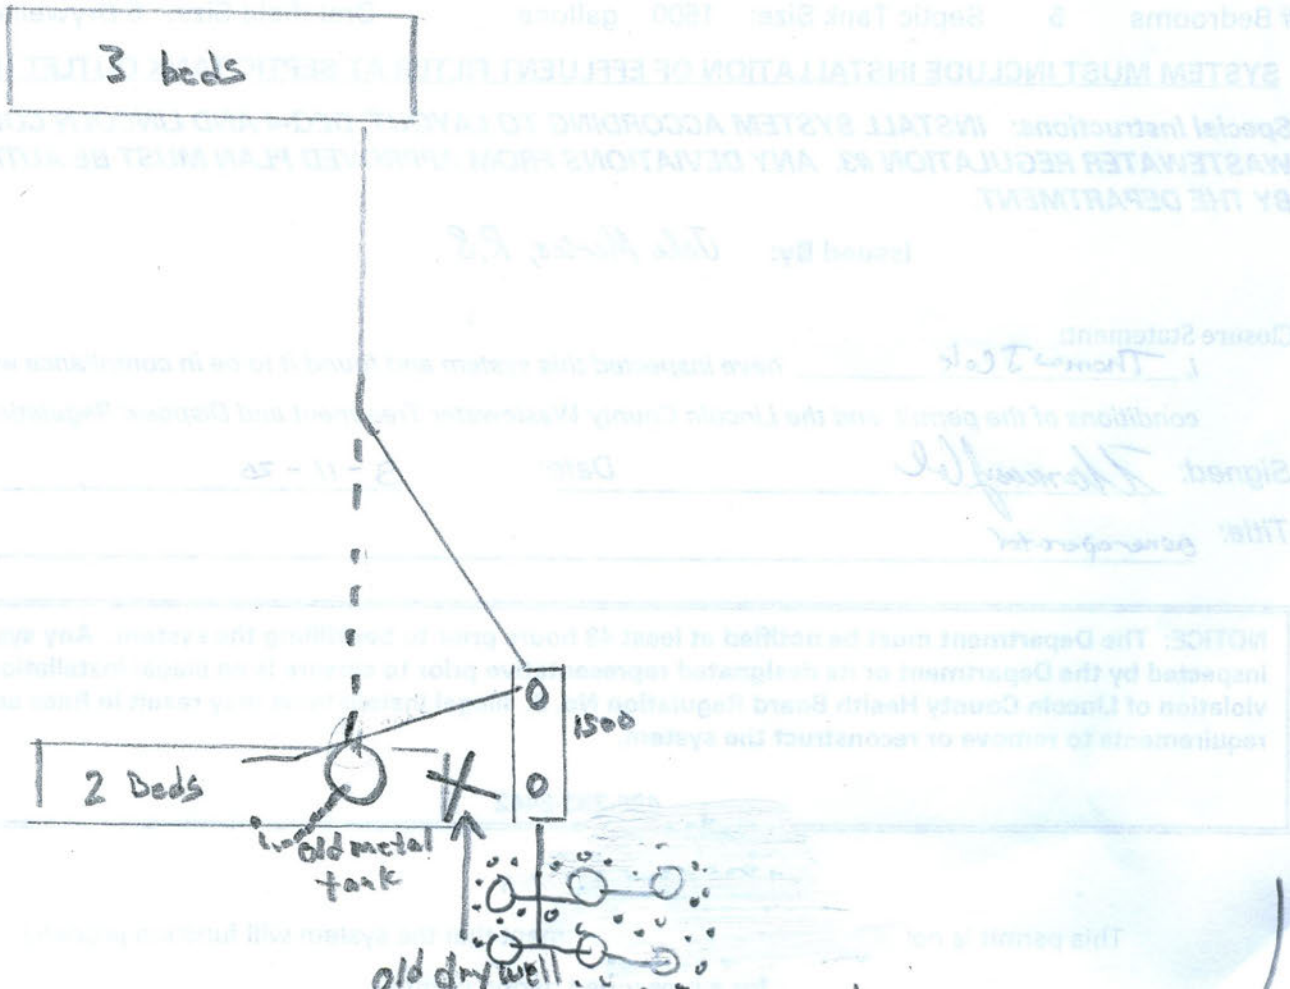
Signed: Thomas J Cole *Date:* 5-11-20

Title: owner operator

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER


N
3 beds
2 Beds
1500
old metal tank
old dry well