LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 07/07/2020 Expiration Date: 07/07/2021

Property Owner: Melody Duncan c/o:

Address: [redacted]

Telephone: (Home) (Work)

Installer: Elmer Brenneman License No. 170

xx New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Explain:

Describe: Three 98' Pressure dosed laterals in 3' wide trenches using chambers.

Parcel Description:

Legal: WEST DOXIE, S02, T35 N, R26 W, ACRES 20.521, LOT 1 PM 6305

Address or Location: 12 Hodges Rd Eureka, MT 59917

Geo/Assessors code: 0000053143

Approved Design Criteria:

Bedrooms 3 Septic Tank Size 1000/500 gallons Drainfield Size: 294 lineal feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Elmer Brenneman *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Elmer Brenneman *Date:* 9-2-2020

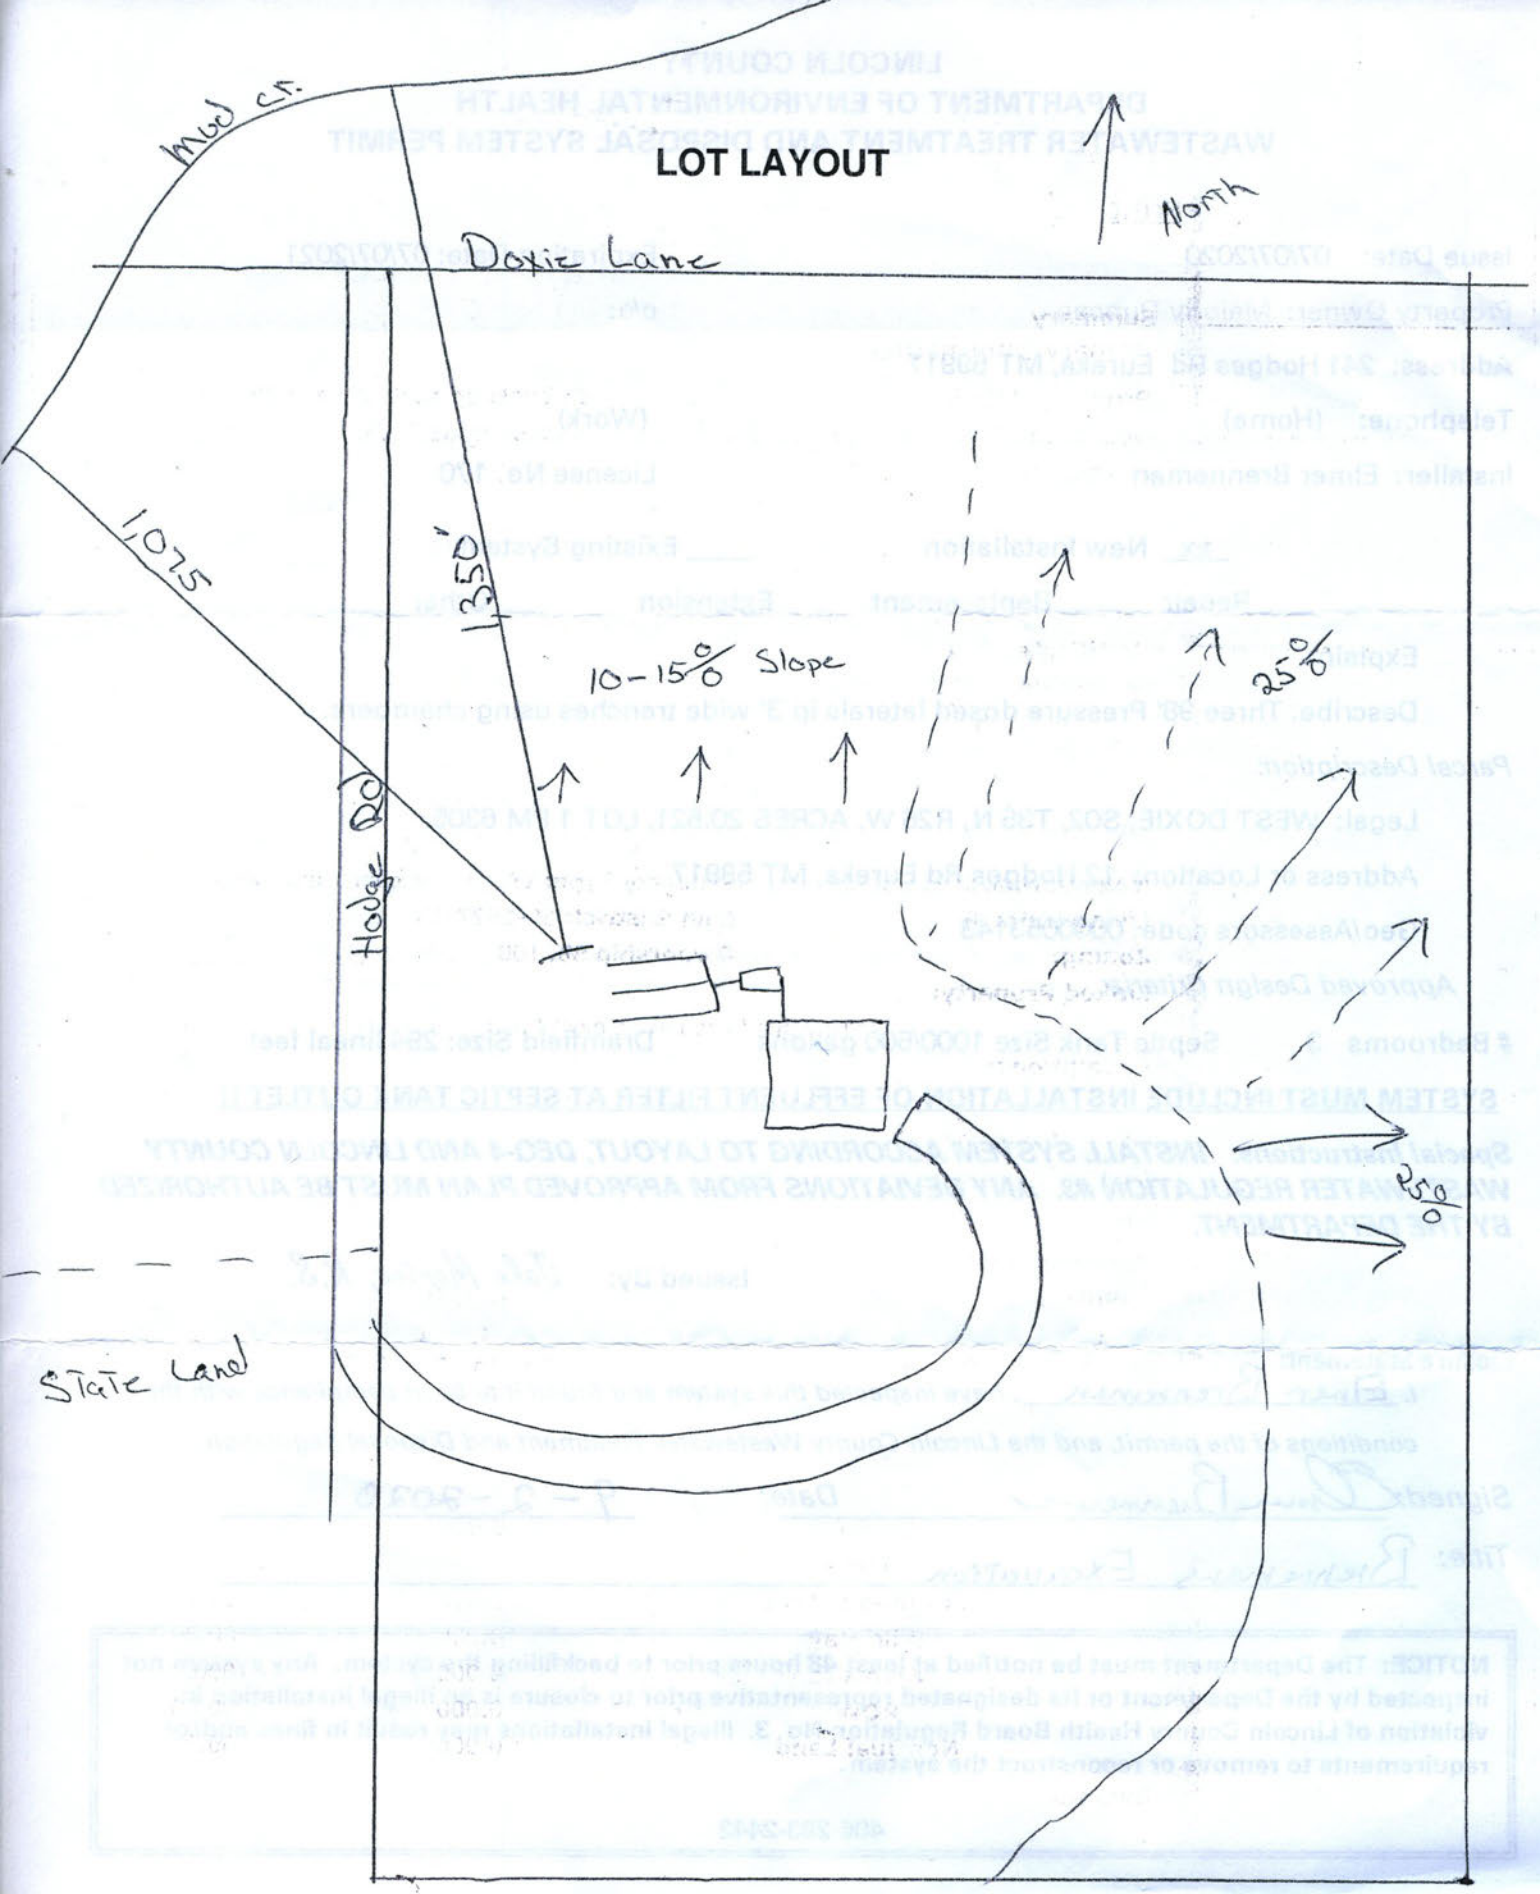
Title: Brenneman's Excavation

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

LOT LAYOUT


Mud Ct.
North
Doxie Lane
1,075'
1350'
10-15% Slope
25%
Hodge Rd
25%
State Land