LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 9/18/2019 Expiration Date: 9/18/2020

Property Owner: Gary Fjelstad c/o:

Address: [redacted]

Telephone: (cell) [redacted] (Work)

Installer: License No.

__ New Installation ____ Existing System

____ Repair __xx__ Replacement ____ Extension ____ Other

Describe: Three 75' laterals using gravelless chambers

Parcel Description:

Legal: S9 T30 R31 Tract 2G18

Address or Location: 252 Upper Flower Creek Road

Geo/Assessors code: 0000009086

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size 225 lineal ft

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

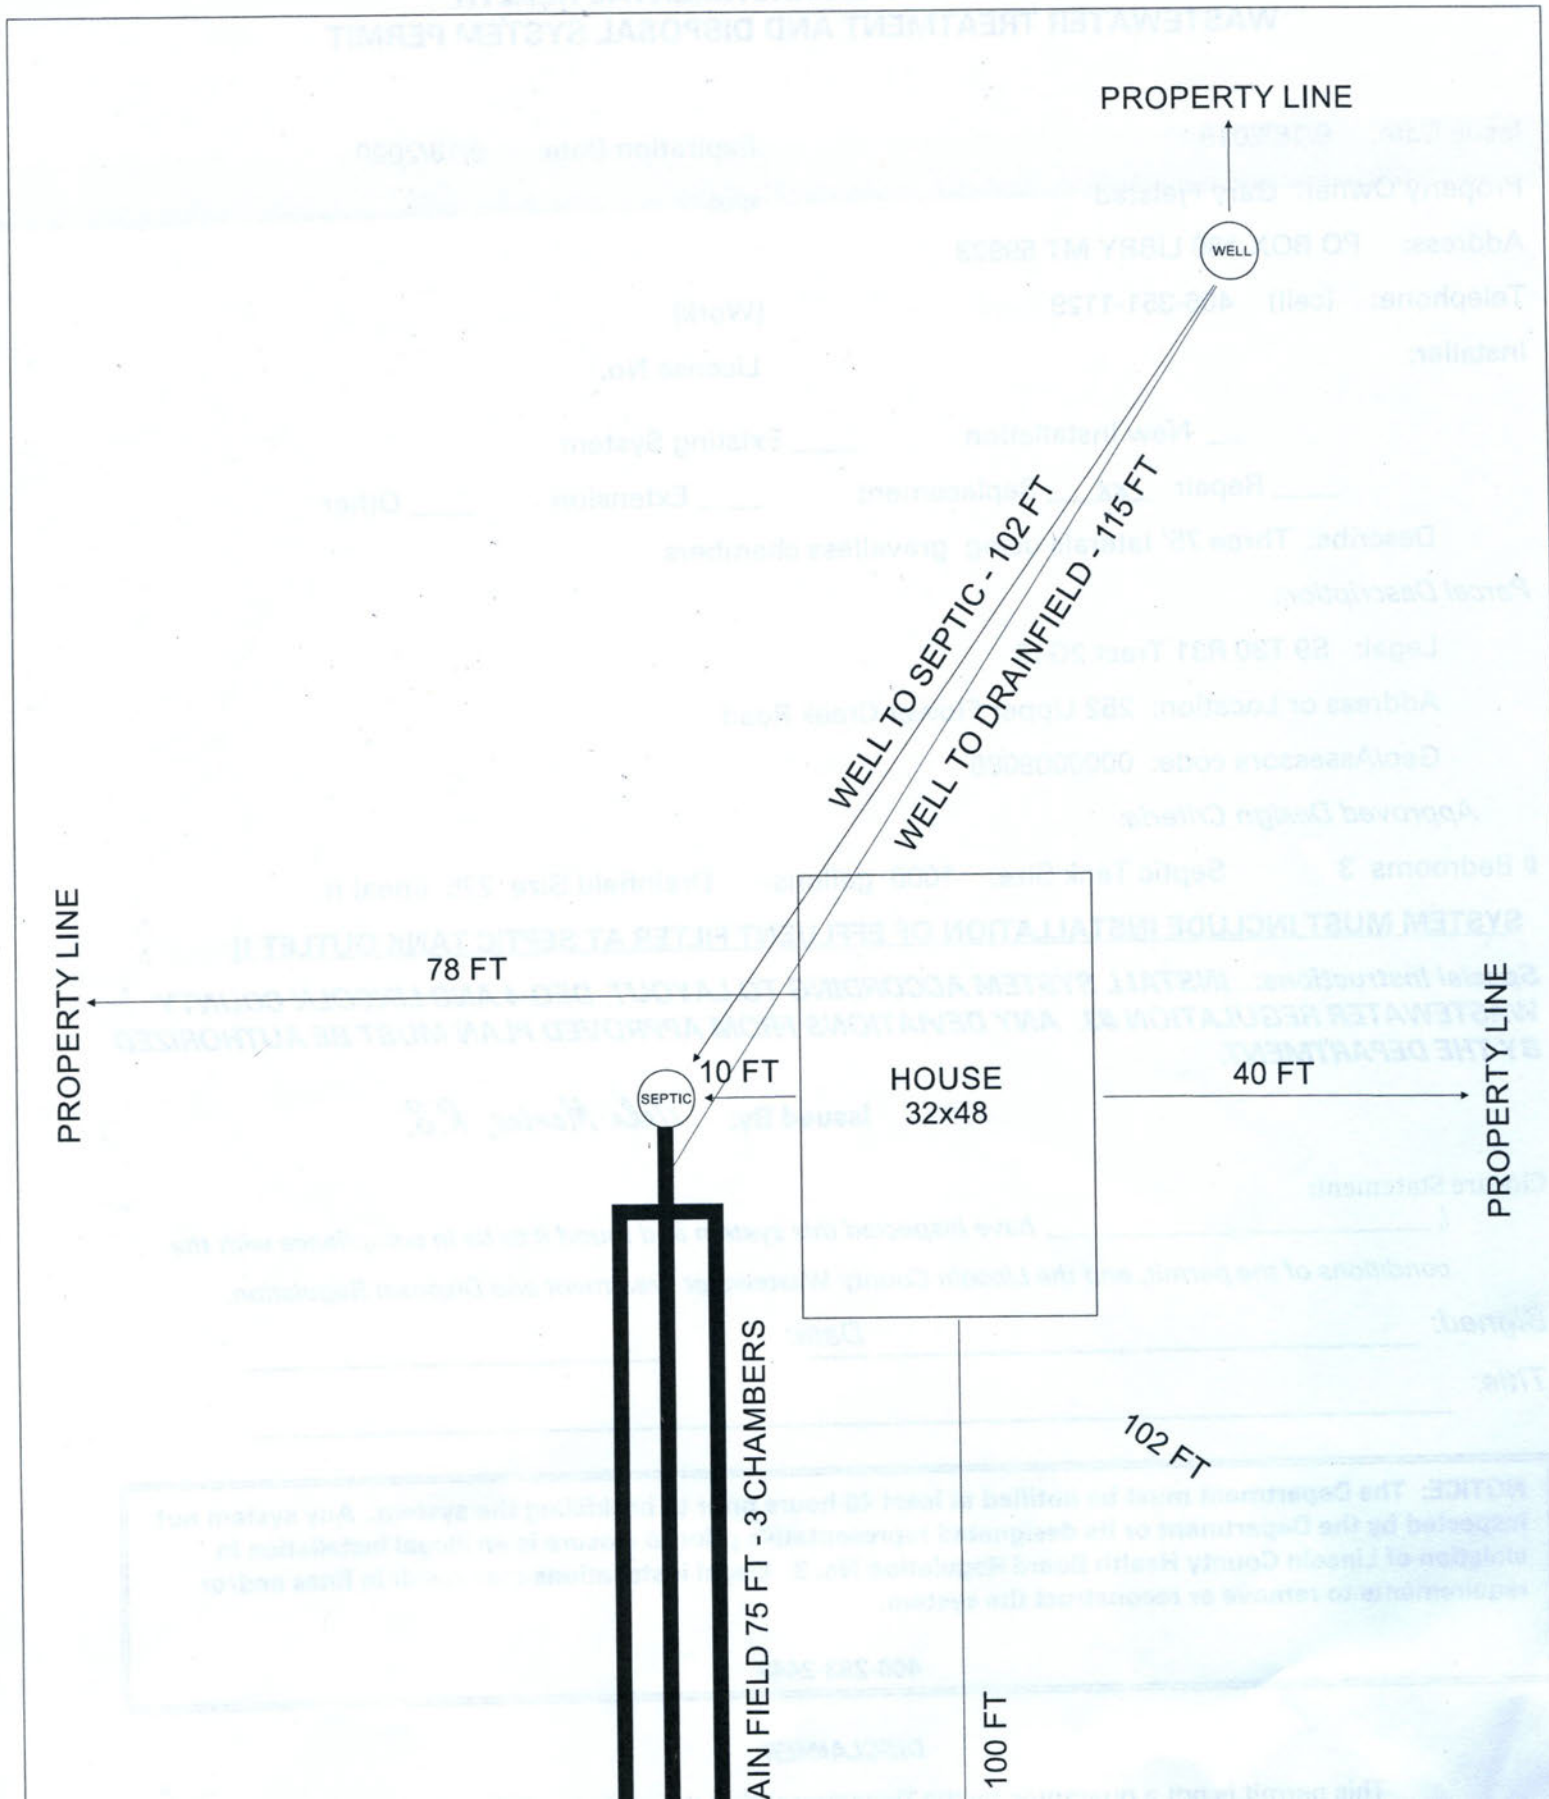
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


PROPERTY LINE
WELL
WELL TO SEPTIC - 102 FT
WELL TO DRAINFIELD - 115 FT
PROPERTY LINE
78 FT
SEPTIC
10 FT
HOUSE
32x48
40 FT
PROPERTY LINE
102 FT
AIN FIELD 75 FT - 3 CHAMBERS
100 FT