LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/28/2014 Expiration Date: 10/29/2015

Property Owner: Follensbee Family Trust c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work) [redacted]

Installer: Charley Follensbee License No. 96

XX New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Using gravelless chambers for installation.

Parcel Description:

Legal: NW-1/4 S13 T36 R27 Lot 3 of Bernhard Estates

Address or Location: 760 Lundeen Road

Approved Design Criteria:

Bedrooms: 3 Septic Tank Size: 1000 gallons Drainfield Size: 300 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, Charley Follensbee *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Charley Follensbee *Date:* 4/5/15

Title: own/opp A1-Outback Const.

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

SV

EQ#01-1831

Roadside Swale Detail

to be installed along both sides of roadway

culverts to be installed as needed

ditch sides @ 1 to 1 slope


One lineal foot of swale contains 7.48 gallons of additional runoff

Retention Pond

3 cu. ft. / 1 lineal ft = 23 gallons retention

Stormwater Control Device (SCD)

Swales to convey stormwater runoff from driveway to Rention Pond (SCD) shall be constr

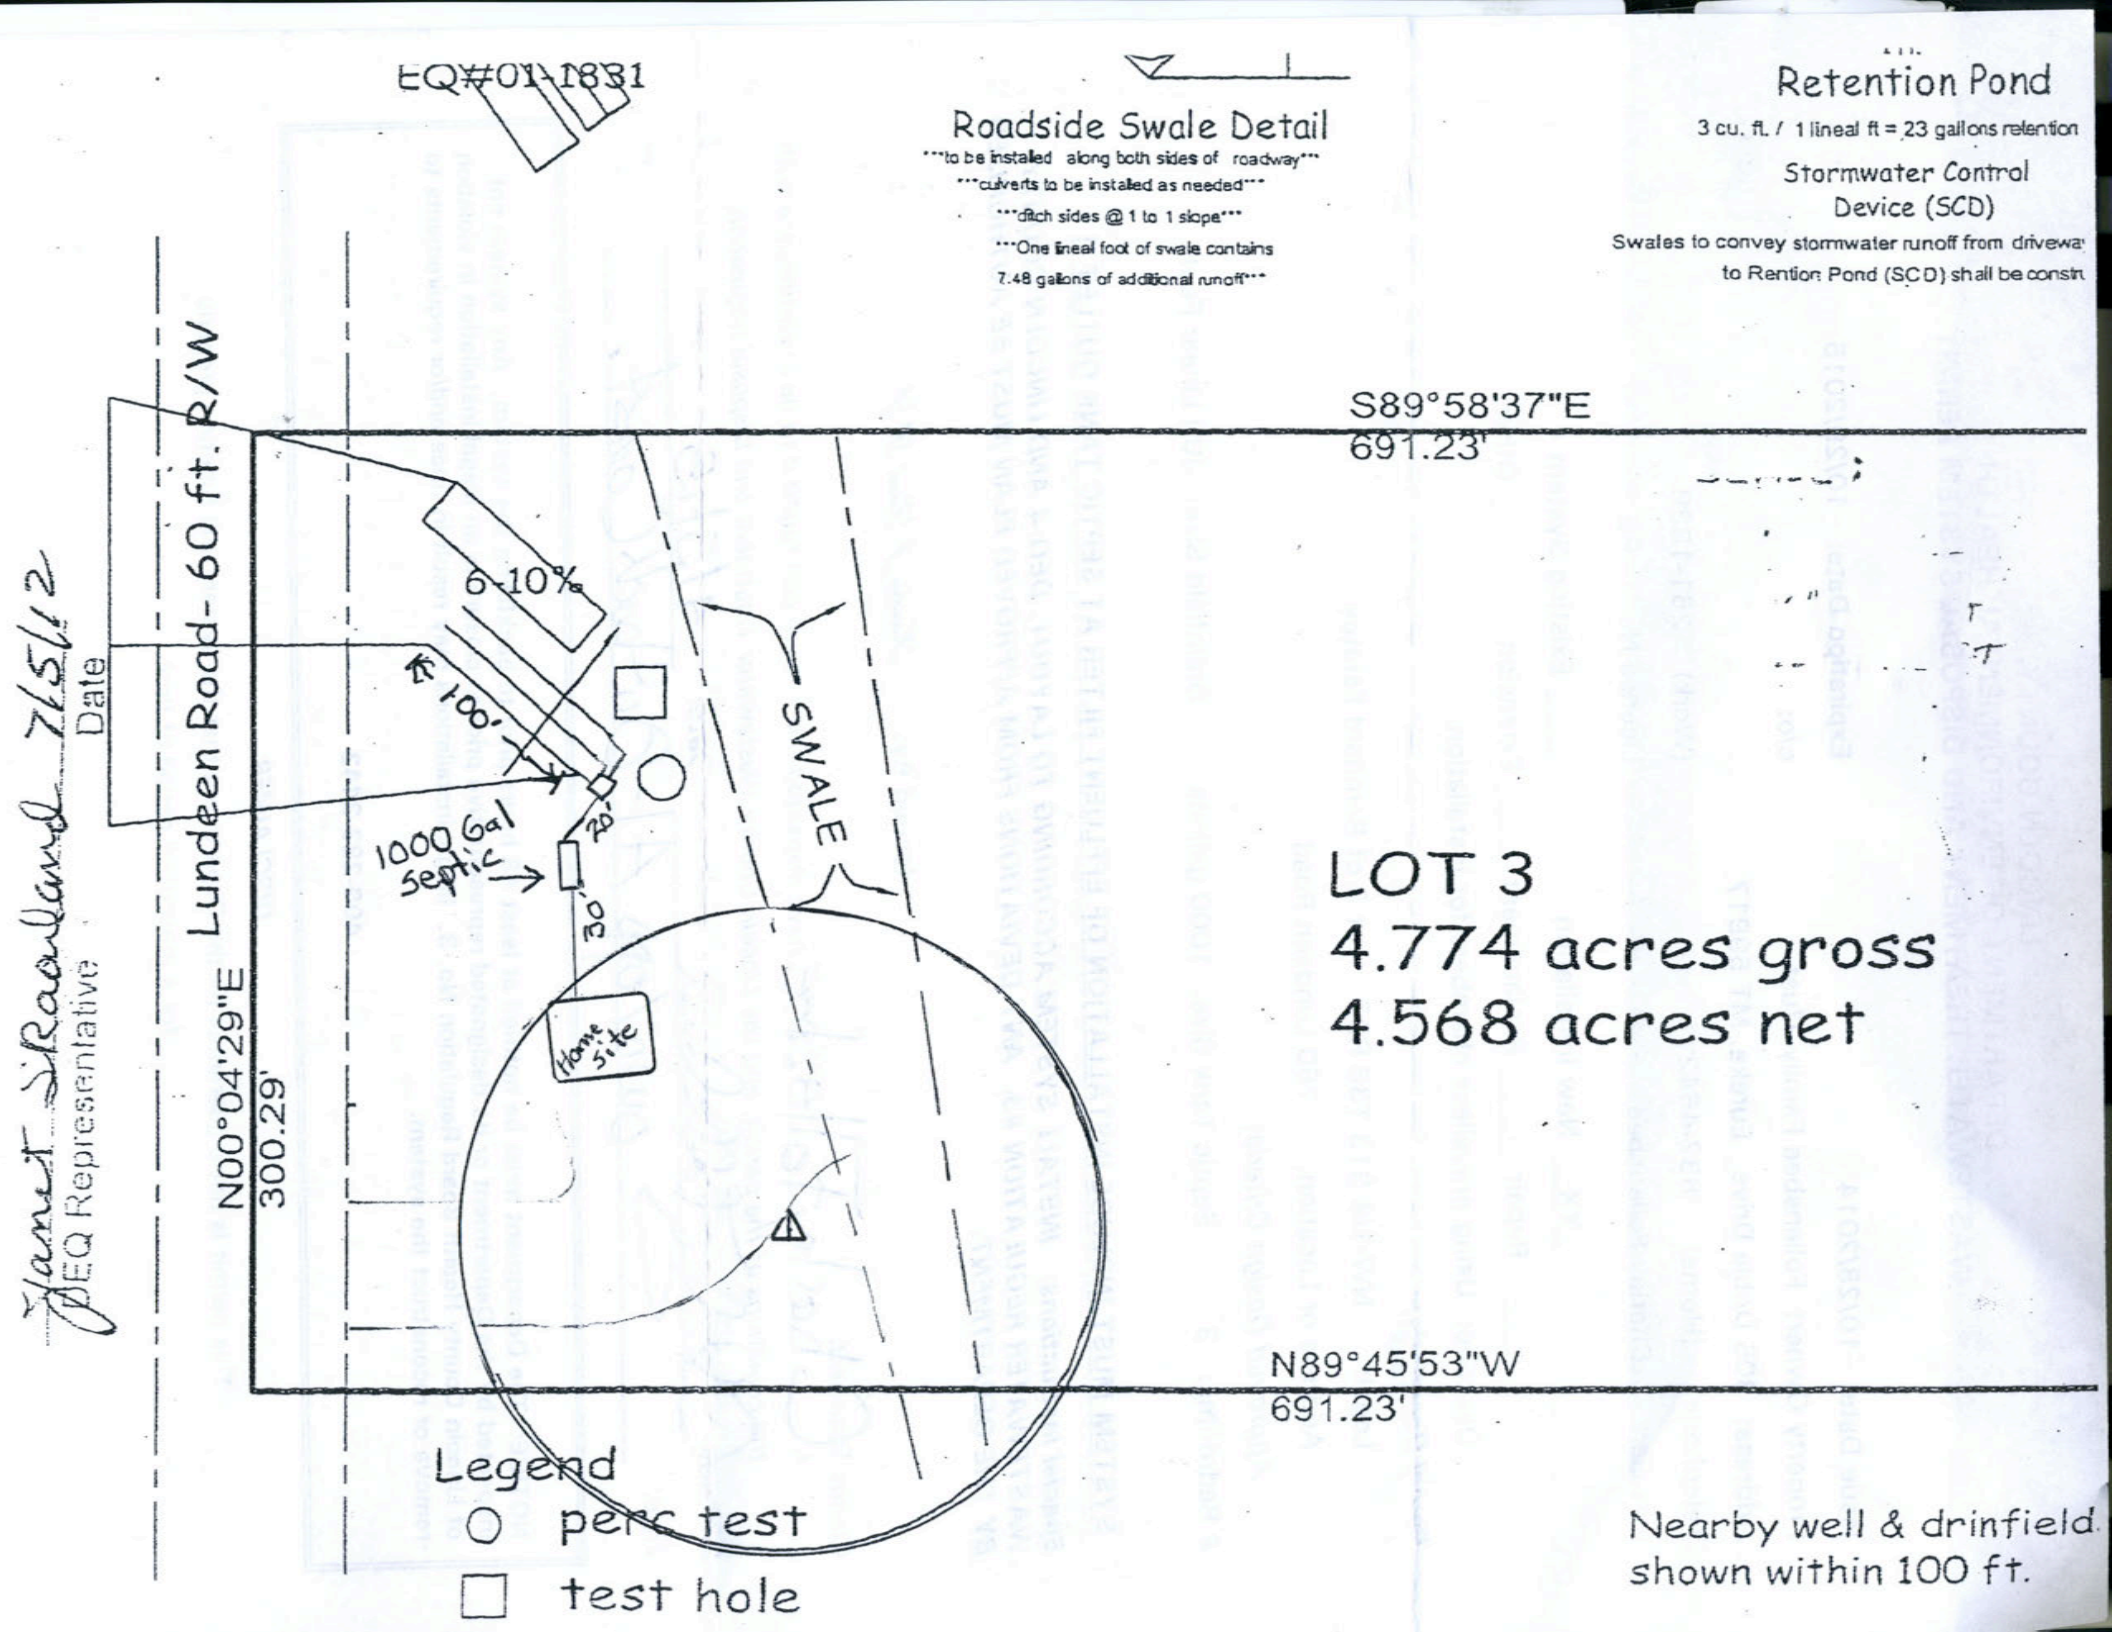

Garnet Strandlund 7/5/12
Date
DEQ Representative