LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 03/09/2020 Expiration Date: 03/09/2021

Property Owner: Jeff Franke c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work)

Installer: Dennins Riedlinger License No. 23

_X_ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Explain:

Describe: Two 65' Laterals using drain rock and perf pipe

Parcel Description:

Legal: S04, T30 N, R33 W, ACRES 154.27, SW LESS RW 154.27 ACRES *5835*

Address or Location: 6126 Bull Lake Road Troy MT 59935

Geo/Assessors code: 0000005835

Approved Design Criteria:

Bedrooms (1)-bedroom Septic Tank Size 1,000 gallons Drainfield Size: 125 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____

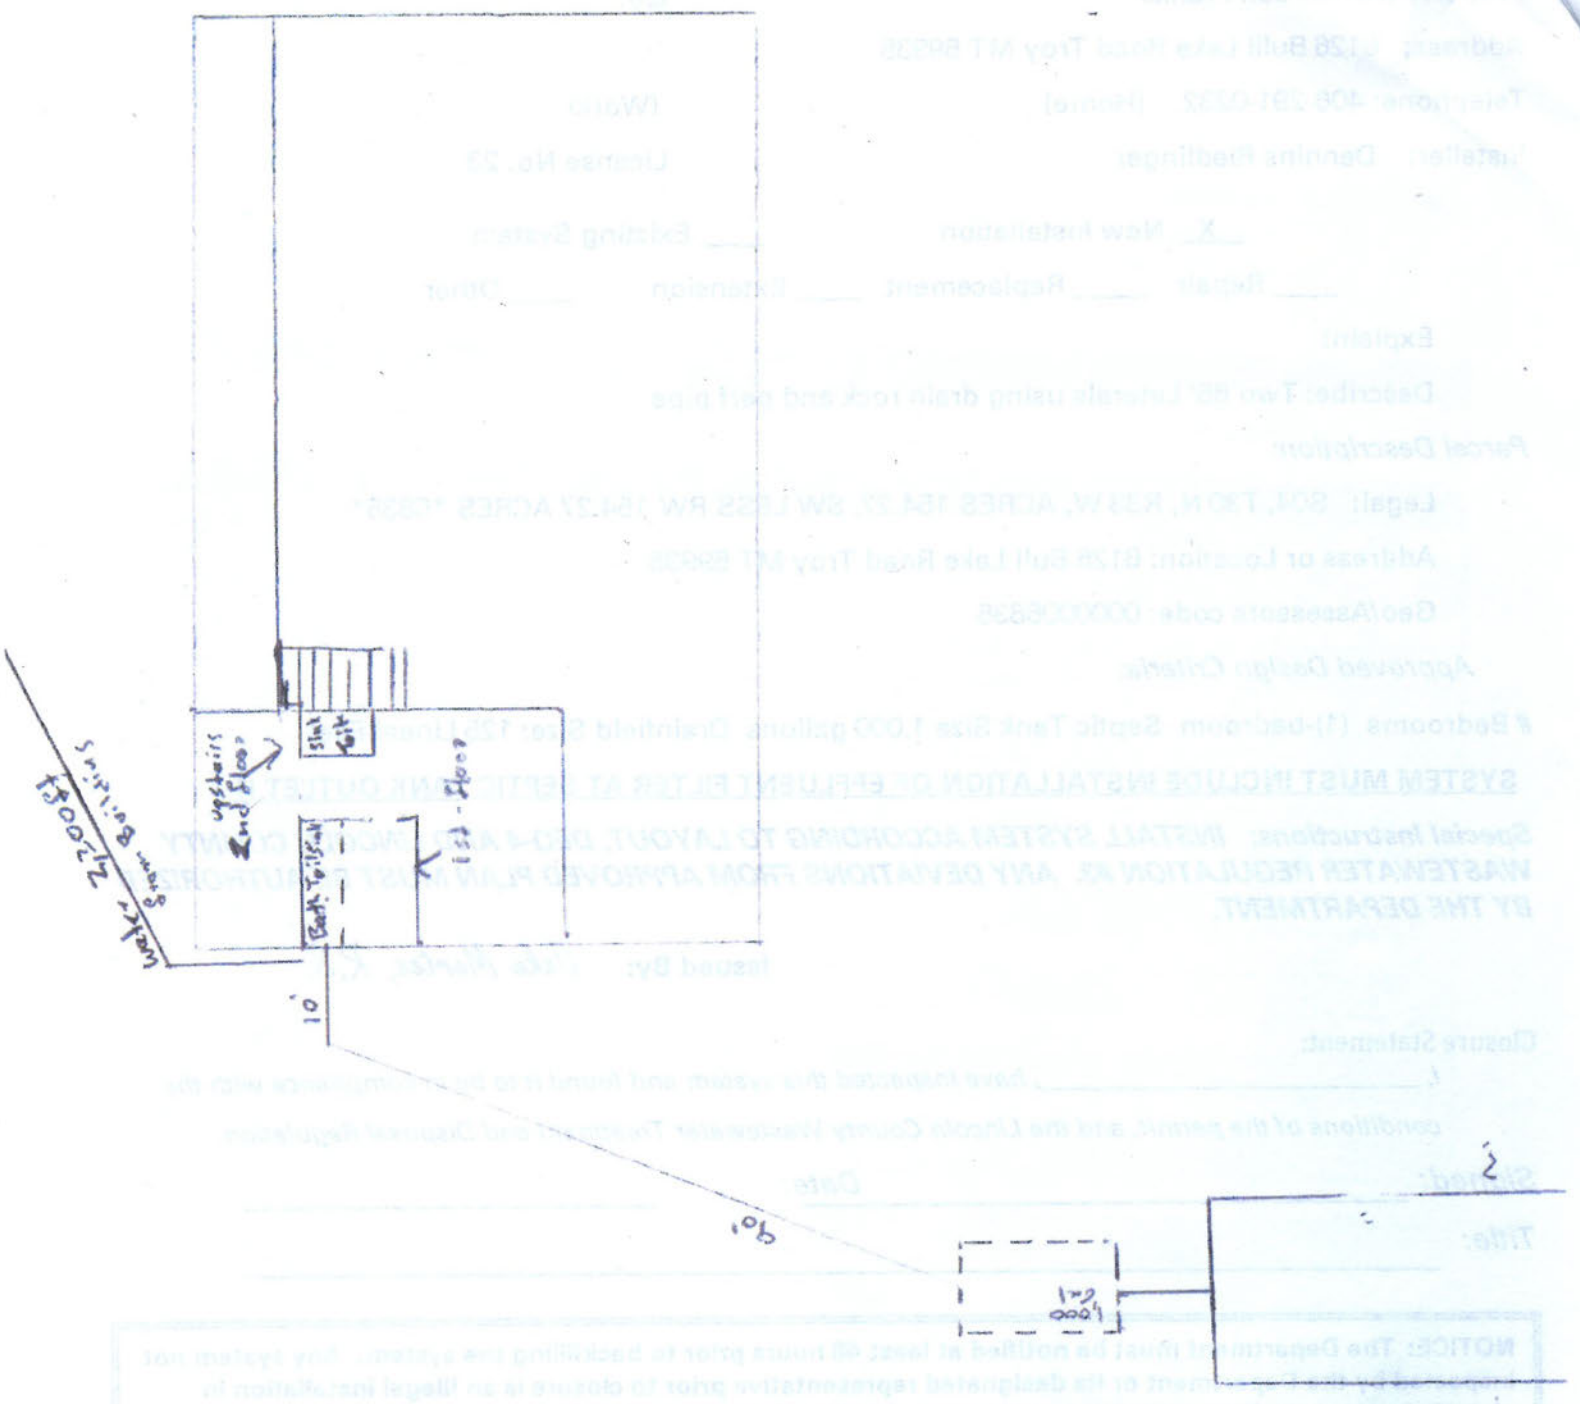
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly

LOT LAYOUT


Upstairs
2nd Floor
Sink
Toilet
Bath Tub/Shower
1st Floor
10'
40'