LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 04/24/12 Expiration Date: 04/23/13

Property Owner: Allen Freeman c/o:

Address: 274 Conifer

Telephone: (Home) [redacted] (Work)

Installer: Corey McNew License No. 130

Proposed Work: (Check One) ☐ New Installation ☒ Existing System

☐ Repair ☒ Replacement ☐ Extension ☐ Other _____

Describe: Replace septic tank and drywell system

Parcel Description:

Legal: S05 T30N R31W

Address or Location: Mobile Estates, Lots 8 & 9

Approved Design Criteria:

Bedrooms: 3 Septic Tank Size: 1000 gallons Drainfield Size: 380 sq. feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

Closure Statement:

I, Corey McNew *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: _____ *Date:* 4-26-12

Title: Installer

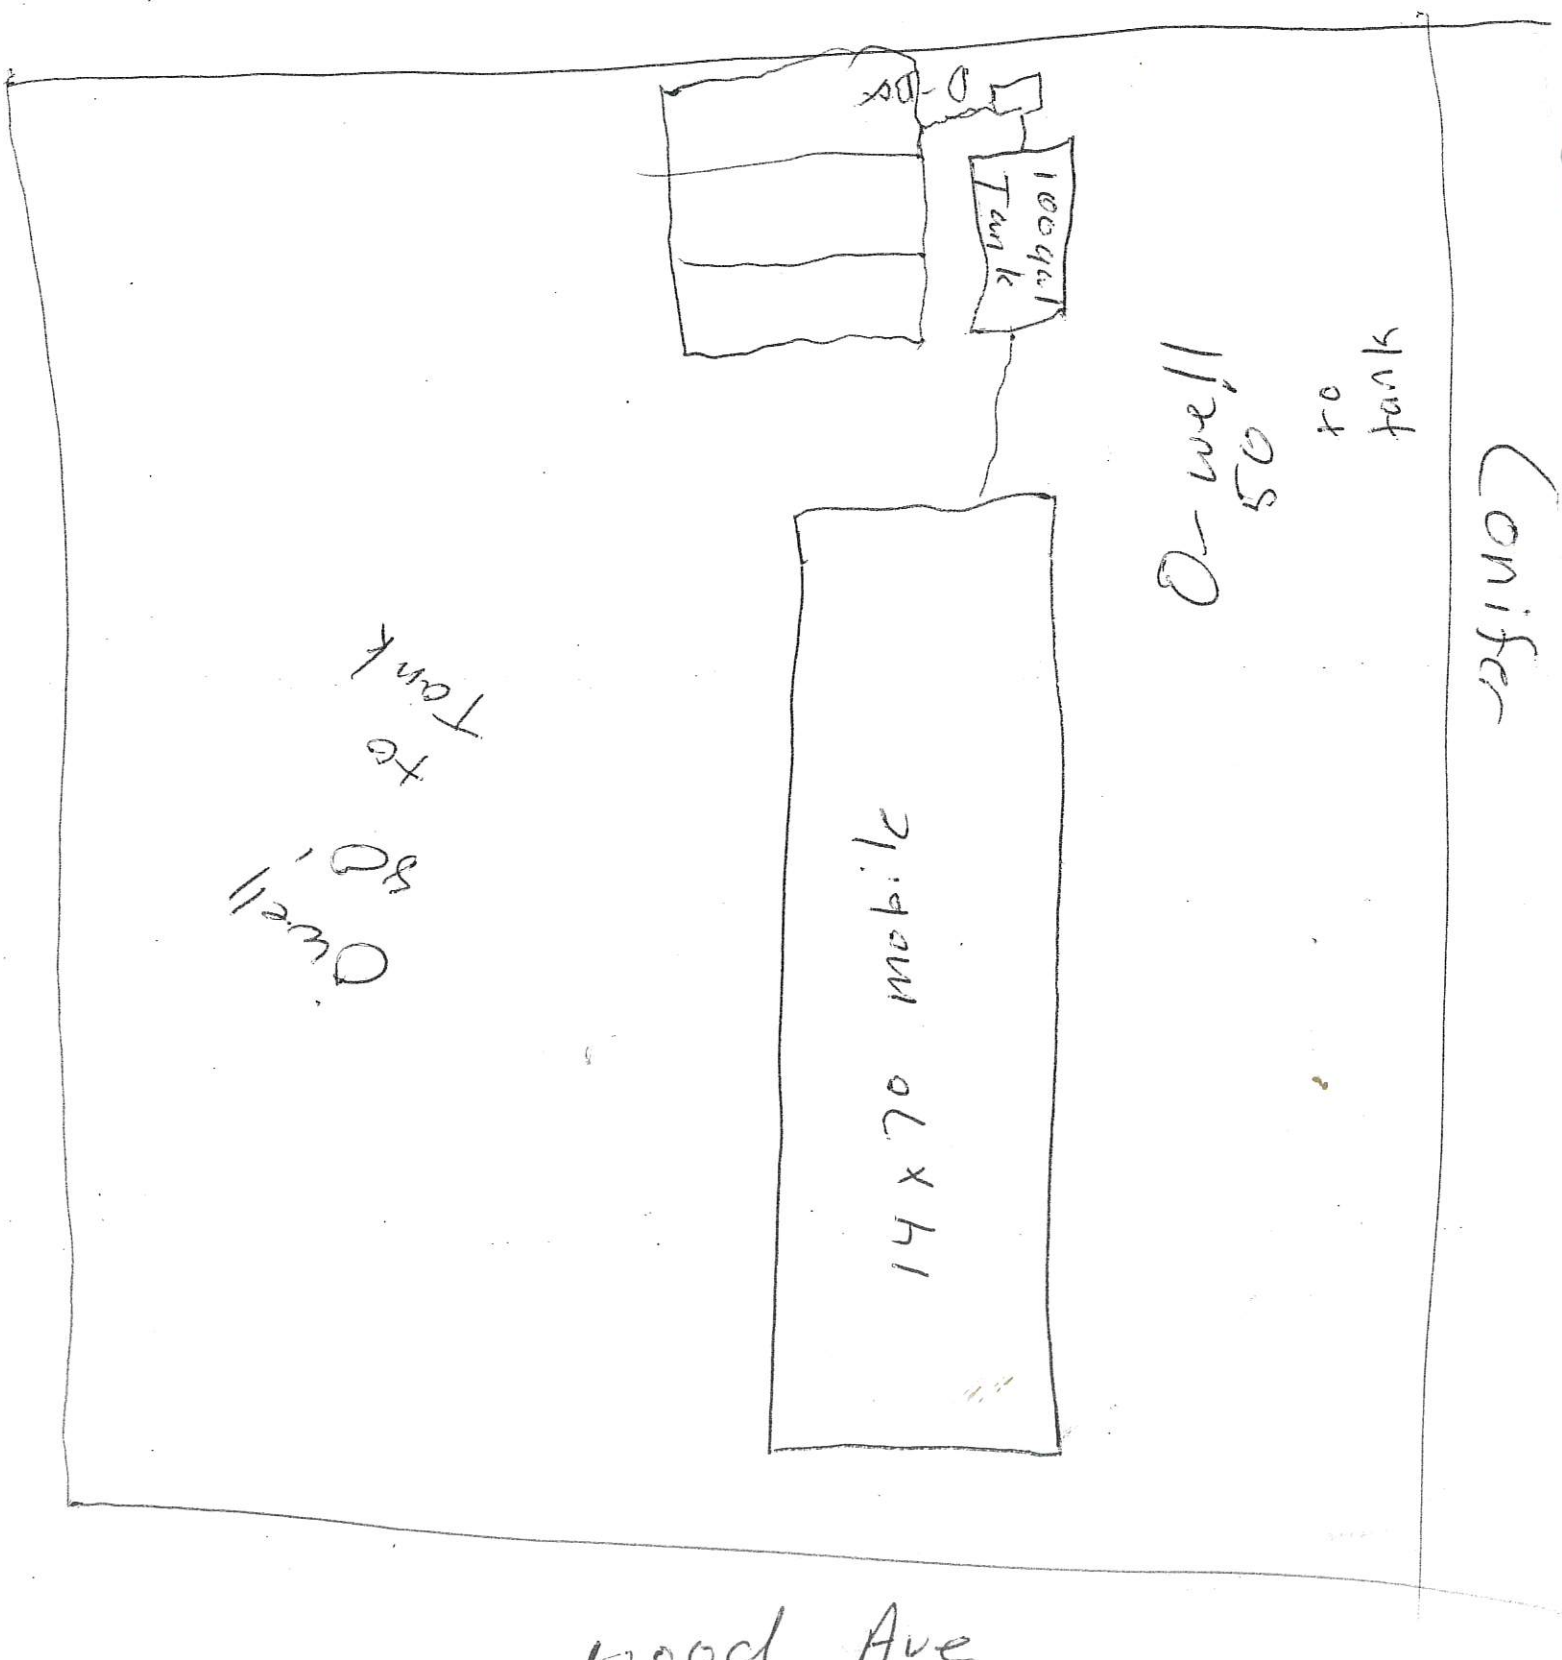
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781 x228

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


100 gal Tank
Owell 50 ft to tank
Conifer
14 x 70 mobile
Owell 80' to Tank
Wood Ave