DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 06/01/2022 Expiration Date: 05/30/2023

Property Owner: Gilbert Gravier II c/o:

Address:

Telephone: (Home) 406-334-7960 (Work) 406-295-4050

Installer: Dustin Welch License No. 155

Proposed Work: (Check One) ☒ New Installation ☐ Existing System

☐ Repair ☐ Replacement ☐ Extension ☐ Other _____

Describe: Two 76 foot laterals using chambers, **sand lined trenches**

Parcel Description:

Legal: S19 T30N R33W, Cadillac Acres, Lot #3

Address or Location: Lime Butte Rd, Troy

Approved Design Criteria:

Bedrooms: 3 Septic Tank Size: 1000 gallon Drainfield Size: 152 lineal feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

Closure Statement:

I, Dustin Welch, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* 1-26-2024

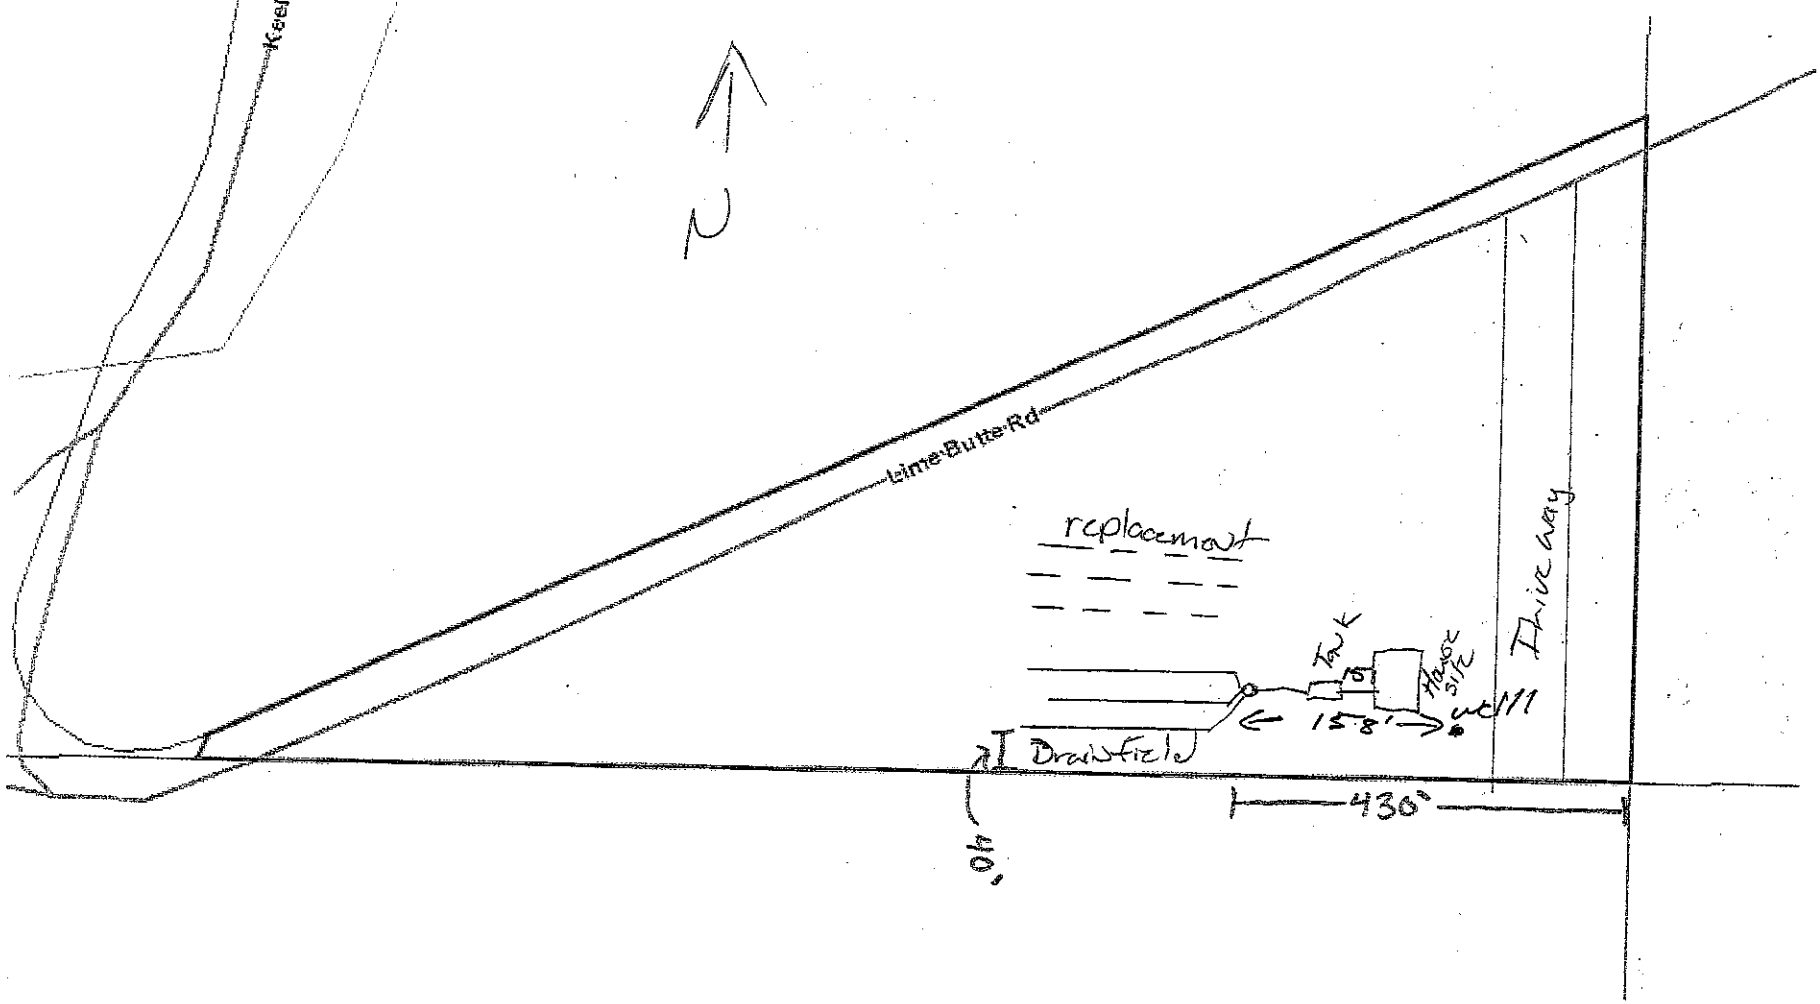
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Lime Butte Rd
N
replacement
Tank
House site
well
15.8'
Driveway
Drainfield
430'
90'