LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 01/21/2020 Expiration Date: 01/21/2021

Property Owner: Jeremy Hageness c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work)

Installer: Terry Oedewaldt License No. 002

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Three 85' Laterals using gravelless chambers reduced per 0.5 App Rate

Parcel Description:

Legal: LABELLE LOT 3B2, S36, T31 N, R31 W, ACRES 1.692, LOT 3 PM 7145

Address or Location: LOT 3

Geo/Assessors code: 0000050462

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 255 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Terry Oedewaldt, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: _____ *Date:* 2/10/2020

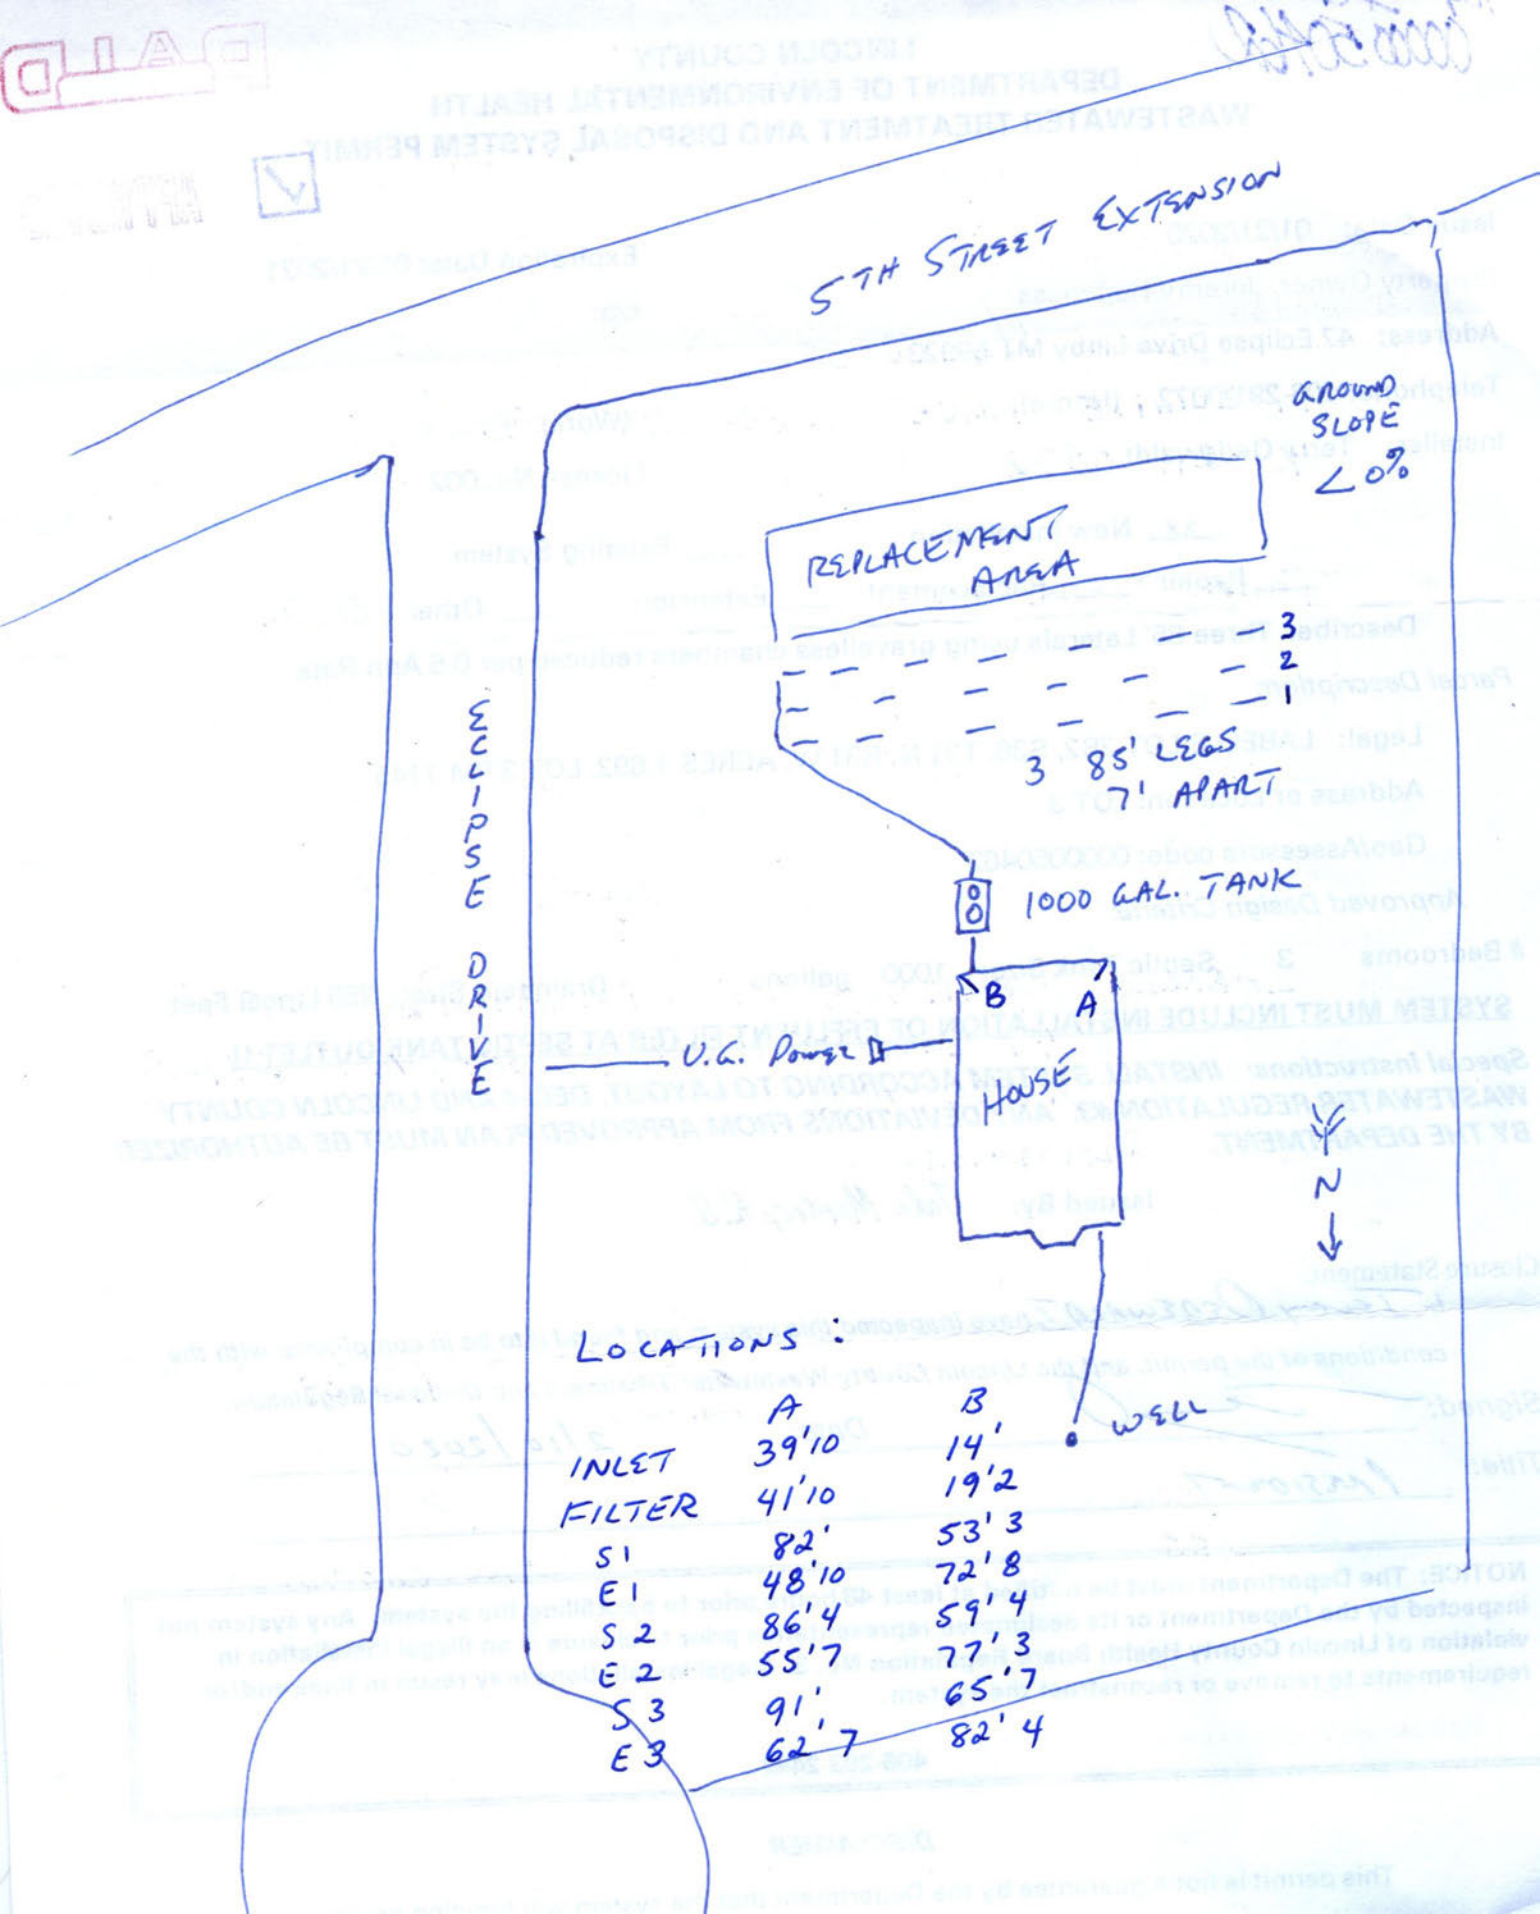
Title: President

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly


5TH STREET EXTENSION
GROUND SLOPE ∠ 0%
REPLACEMENT AREA
3
2
1
3 85' LEGS 7' APART
1000 GAL. TANK
B
A
HOUSE
U.G. Power
ECLIPSE DRIVE
N
WELL
LOCATIONS :
A
B
INLET 39'10 14'
FILTER 41'10 19'2
S1 82' 53'3
E1 48'10 72'8
S2 86'4 59'4
E2 55'7 77'3
S3 91' 65'7
E3 62'7 82'4