LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 5/1/2020 Expiration Date: 5/1/2021

Property Owner: John Hammond c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Koocanusa Excavating License No. 135

____ Direct Connection ____ Grinder Pump Connection __xx__ Lift Tank Connection

Describe: Effluent lift tank connection to sewer main for approved drainfield.

Parcel Description:

Legal: S36 T37 R27

Address or Location: Indian Springs Phase 1 Lot 24 *0000055124

Approved Design Criteria:

This lot is approved for 3 bedroom single family home. This structural size may not be exceeded and wastewater flows are prohibited from exceeding 300 gallons per day. Any proposed increase in wastewater flows must be reviewed by and receive the approval of the HOA Review Board and the Montana DEQ Subdivision Section. Any activity that increases wastewater flows without prior review and approval is in violation of the conditions of approval and subject to enforcement action.

Special Instructions: INSTALL SEPTIC LIFT TANK (1500gal) CONNECTION TO THE SEWER MAIN LINE FOR DRAINFIELD ACCORDING TO THE LOT LAYOUT AND DEQ APPROVAL STATEMENT E.Q. 06-3321. ANY DEVIATIONS FROM APPROVED PLAN MUST HAVE PRIOR AUTHORIZATION FROM THE *Indian Springs HOA*/ENVIRONMENTAL REVIEW BOARD, DEQ AND THE DEPARTMENT.

Issued By: *Jake T. Mertes*

Closure Statement:

I, Buck Schermerhorn *have inspected this system and found it to be in compliance with the conditions of the permit, and the DEQ Approval Statement requirements.*


Signed: _____ *Date:* 10/9/20

Title: President

NOTICE: The Department must be notified at least 48 hours prior to installation of the connection. Any connection installation not inspected by the Department or its designated representative is considered an illegal connection and may be subject to fines and/or requirements to remove or reconstruct the connection.

DISCLAIMER

This permit is not a guarantee by the Department that this connection will function properly for a prescribed period of time.

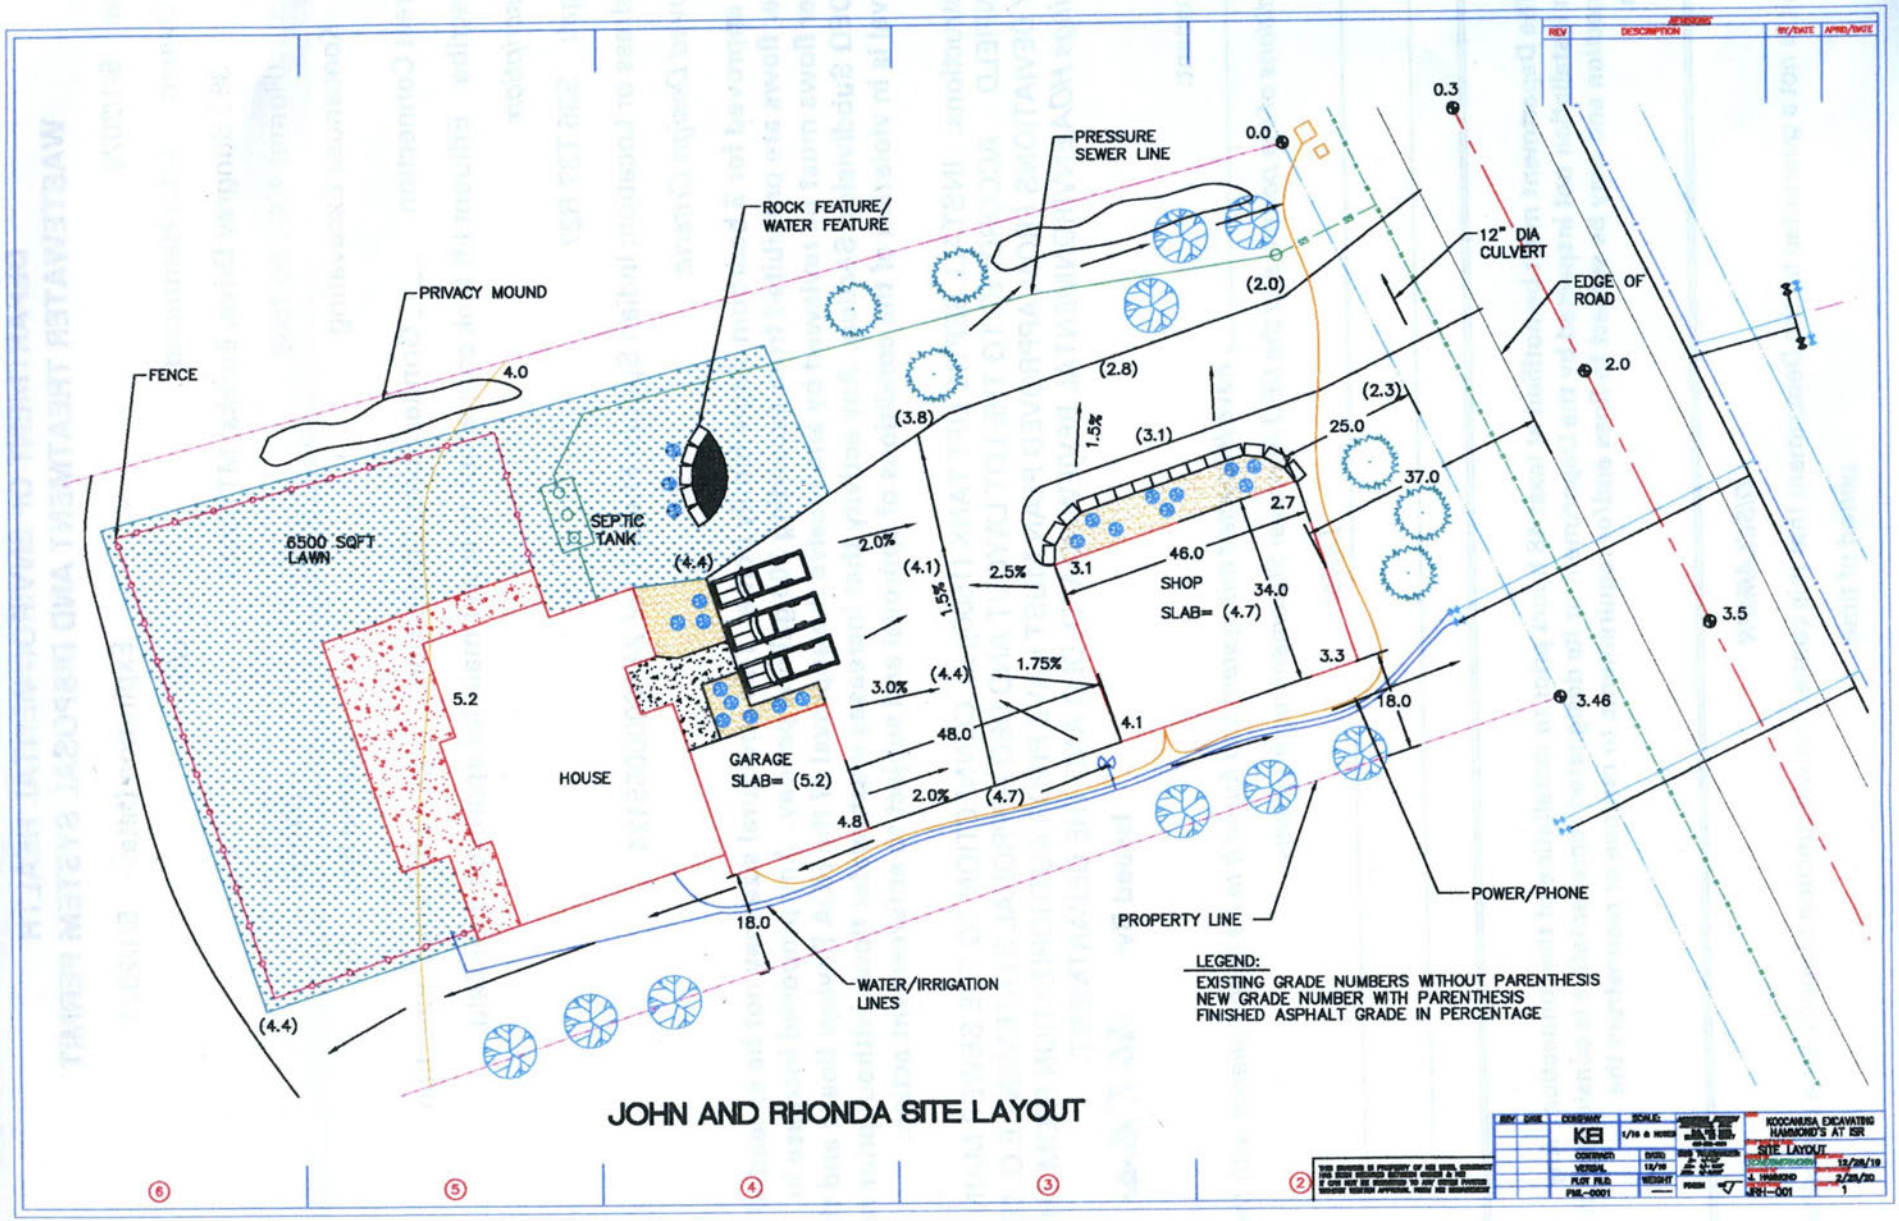

JOHN AND RHONDA SITE LAYOUT