LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 07/07/2020 Expiration Date: 07/07/2021

Property Owner: Daniel Huber c/o:

Address: [redacted]

Telephone: (Home) (Work) [redacted]

Installer: Renkema License No. 78

__XX__ New Installation ____ Existing System

____ Repair _____Replacement ____ Extension ____ Other

Describe: Five 90' pressure dosed laterals using chambers

Parcel Description:

Legal: S26, 36 N, 26 W, CS 3649 PARCEL A IN NE 23.25 ACRES

Address or Location: Parcel A

Geo/Assessors code: 0000055175

Approved Design Criteria:

Bedrooms: 3 Septic Tank Size: 1500/500 gallons Drainfield Size: 450 lineal feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Duck Silvernagle, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* 9/25/24

Title: President - #135


NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442


DISCLAIMER

5✓

This permit is not a guarantee by the Department that the system will function properly

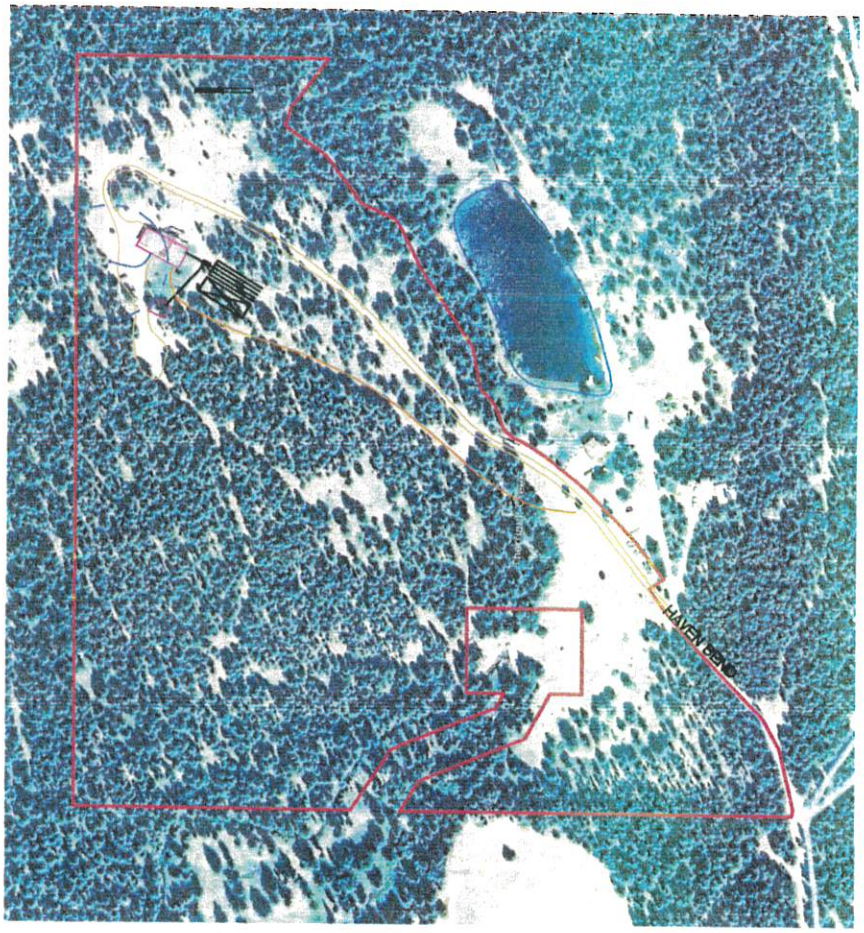

HUBER SITE LAYOUT

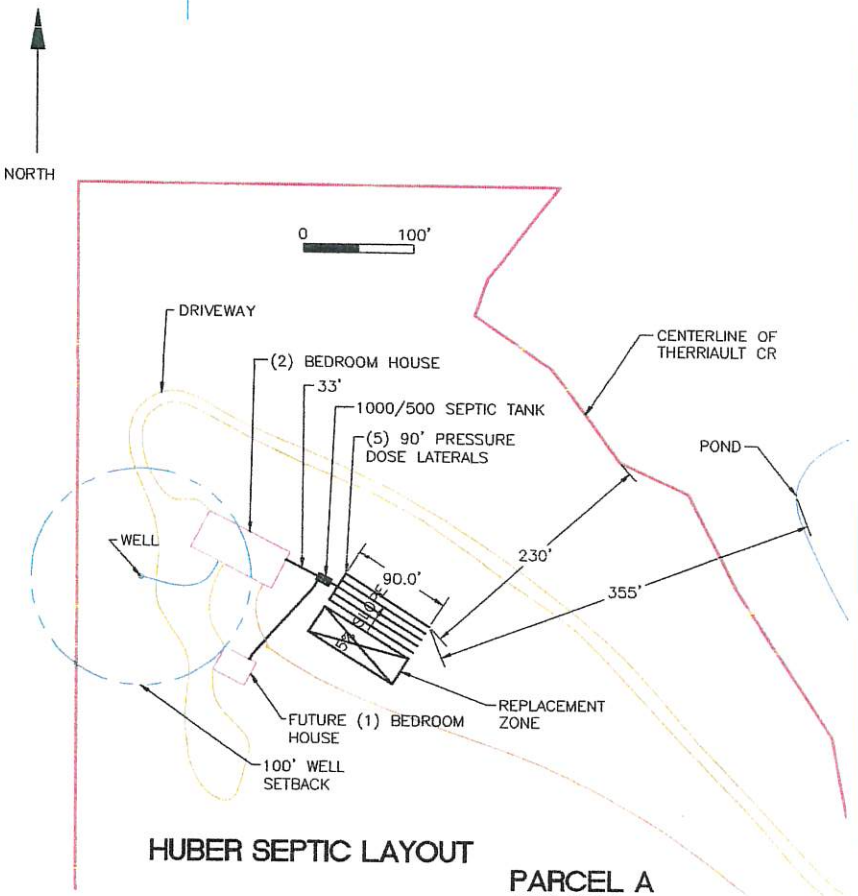

HUBER SEPTIC LAYOUT

PARCEL A
23.25 ACRES
20 PINE CONE LANE, REXFORD, MT 59930
S15, T36N, R28W, PINE BAY NO 2
ASSESSMENT #0000005564
GEO 56-4822-15-1-07-04-0000

REV	DATE	COMPANY	SCALE:	SCHMIDT HAULING & EXCAVATION HUBER SEPTIC
		DSHE	1/16 & NOTED	SITE LAYOUT
		CONTRACT:	DATE: 5/2023	DRAWN: 5/10/24
		VERBAL		CHECKED:
		PLOT FILE: PML-0001	WEIGHT:	D. SCHMIDT 5/XX/24
			FINISH	HUBER-001 1

THIS DRAWING IS PROPERTY OF SCHMIDT EXCAVATION AND HAS BEEN RELEASED BETWEEN OWNER & SCHMIDT IT CAN NOT BE TRANSFERED TO ANY OTHER PARTIES WITHOUT WRITTEN APPROVAL FROM HDS MANAGEMENT