LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: ~~8/21/2015~~

Expiration Date: ~~8/22/2016~~ RENEW 7/17/2018

Property Owner: Donald & Nancy Ingram

c/o: Jim Voyles

Address: [redacted]

Telephone: (Home) [redacted]

(Work)

Installer: JD Voyles

License No. 22

__x__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Four 94' Trenches USING INFILTRATORS SIZE REDUCED PER 0.4 APP R

Parcel Description:

Legal: S26 T36 R26

Address or Location: Lick Lake (South) Site #1

Approved Design Criteria:

Bedrooms 4 Septic Tank Size: 1500 allons Drainfield Size: 375 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: ***INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.***

Issued By: Jake Mertes

Closure Statement:

I, Kurt West, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: Kurt West Date: 7/19/2017

Title: LIC. INSTALLER

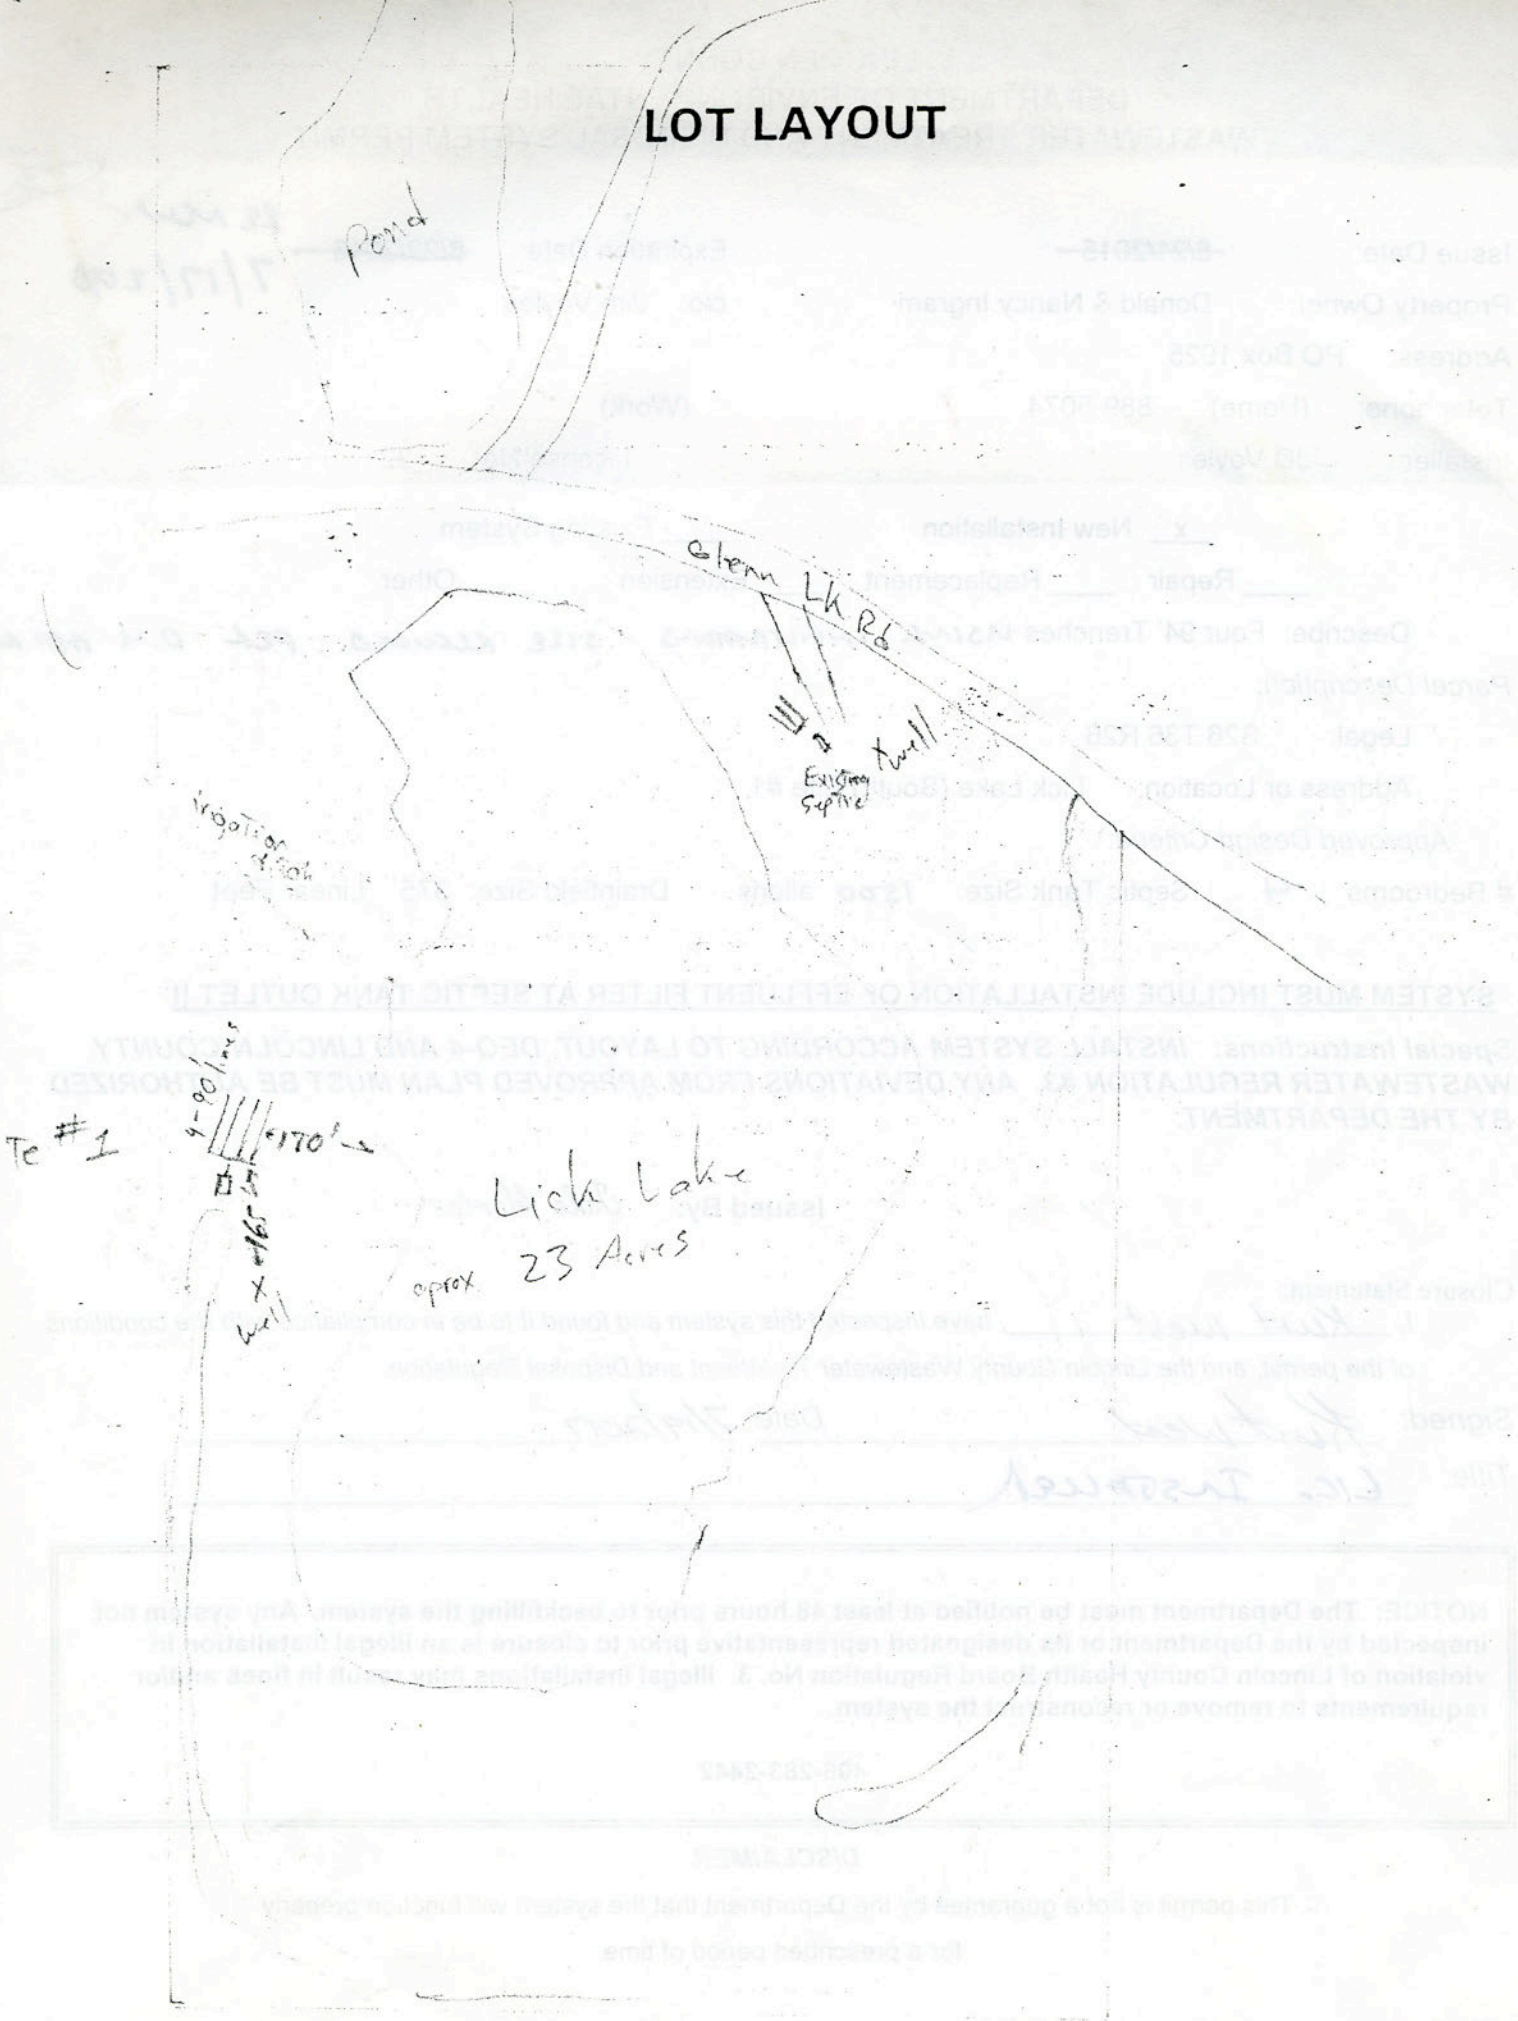
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


Pond
Eberm Lk Rd
Existing Septic
well
Irrigation Area
Te #1
4-00 l/m²
+170'
Lick Lake
aprox 23 Acres
well