LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 12/08/2008 Expiration Date: 12/09/2009

Property Owner: Kootenai Pets for Life c/o:

Address: [redacted]

Telephone: (Home) (Work) [redacted]

Installer: License No.

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Installing system for animal shelter facility—pressure-dosed, sand-lined system required.

Parcel Description:

Legal: S34 T31 R31

Address or Location: 125 County Shops Road

Approved Design Criteria:

Max. Flows: 1056 gpd Septic Tank Size: 3000 gallon Drainfield Size: 1320 Square Feet

Dosing Tank Size: 1000 gallon

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SAND-LINED, PRESSURE-DOSED SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, Lori Kelley-Bowe *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Lori Kelley-Bowe *Date:* 2/19/09

Title: Sanitarian


NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT
KOOTENAI PETS FOR LIFE
125 COUNTY SHOPS ROAD

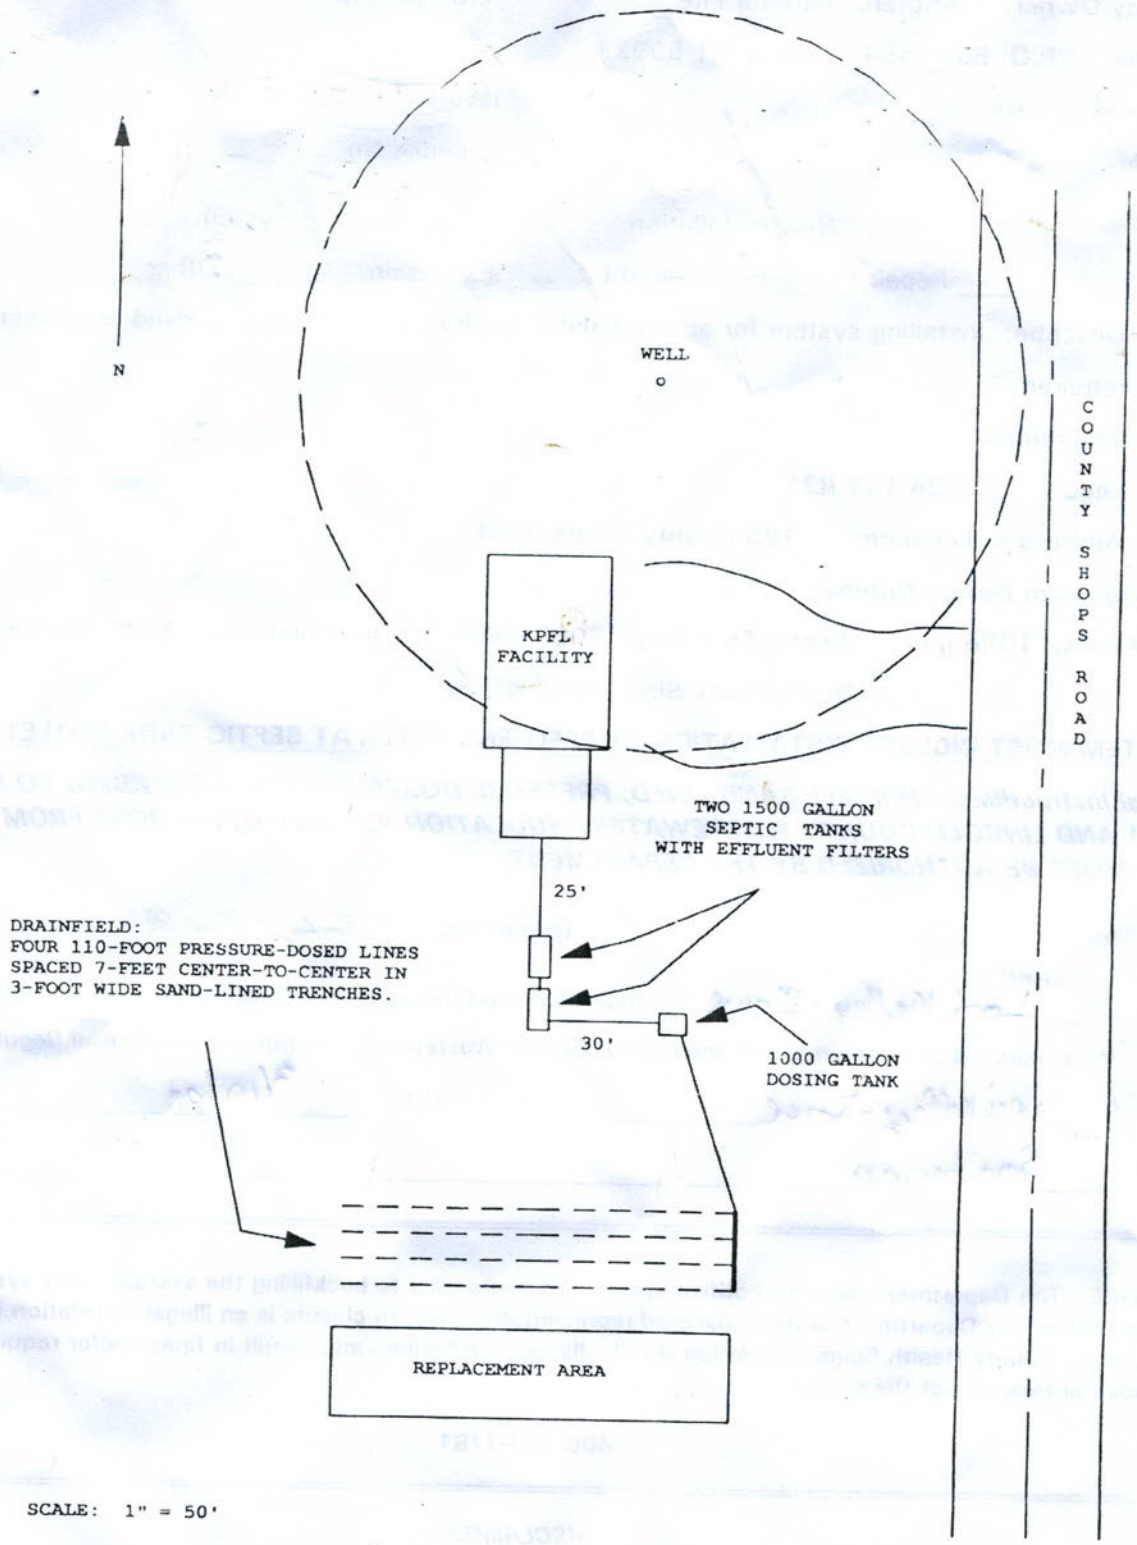

SCALE: 1" = 50'