County

LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 07/29/2020 Expiration Date: 07/29/2021

Property Owner: Kootenai Valley Partners-Habitat For Humanity

Address: [redacted]

Telephone: (Home) (Work)

Installer: License No.

XX New Installation ___ Existing System

___ Repair ___ Replacement ___ Extension ___ Other

Describe: Three 50' laterals using chambers.

Parcel Description:

Legal: WOODWAY PARK 2ND ADDN, S05, T30 N, R31 W, BLOCK 8, ACRES 0.2296, LOT 11

Address or Location: BLOCK 8, LOT 11

Geo/Assessors code: 0000008122

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 150 lineal feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Thomas J. Cole *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Thomas J Cole *Date:* 10-20-20

Title: owner operator


NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly

KLATAWAH STREET PLOT PLAN

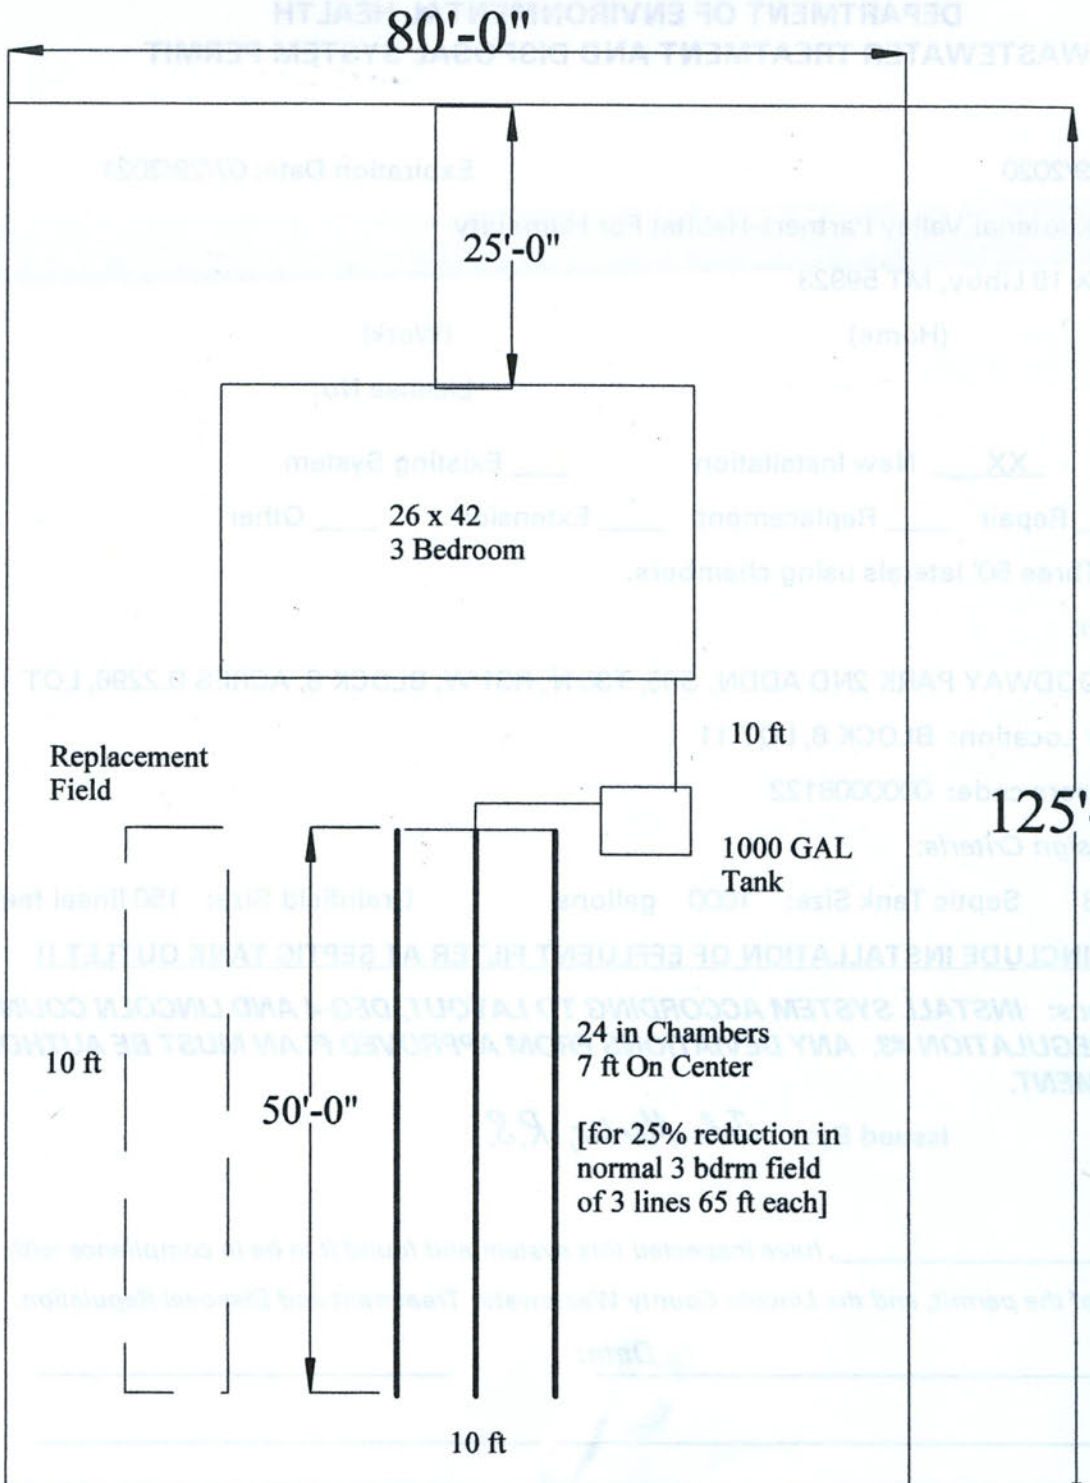

Lot #11 is 80 ft x 125 ft per Woodway Park 2nd Addition

Required Setebacks are:

Well 100 ft
Property line and structures 10 ft
Flood Plain 100 ft