LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 02/19/2025 Expiration Date: 02/18/2026 Permit#25-55093

Property Owner: Doug Luchini

Mailing Address: [redacted]

Installer: Doug Luchini License #: 183

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new gravity system for 1 Bedroom House.

Legal: S13, T27 N, R28 W, ACRES 137.738 REMAINDER PARCEL OF PM 6807 & 6892

Property Address: 246 Loon Connector Rd., Libby, MT 59923 Assessment Code: 55093

DEQ COSA: EQ# Date:

Approved Design Criteria: Installation of new gravity system for 1 Bedroom House with 2 Laterals @ 50'. This permit is not a floodplain determination. Drainfield is to be 800' from Fisher River.

# of Bedrooms: 1 Septic Tank Size: 1000 gallons Trench Width: 24"

# of Laterals: 2 Length of Laterals: 50' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the Lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, Circular DEQ-4, and COSA(if applies). It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, RS

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

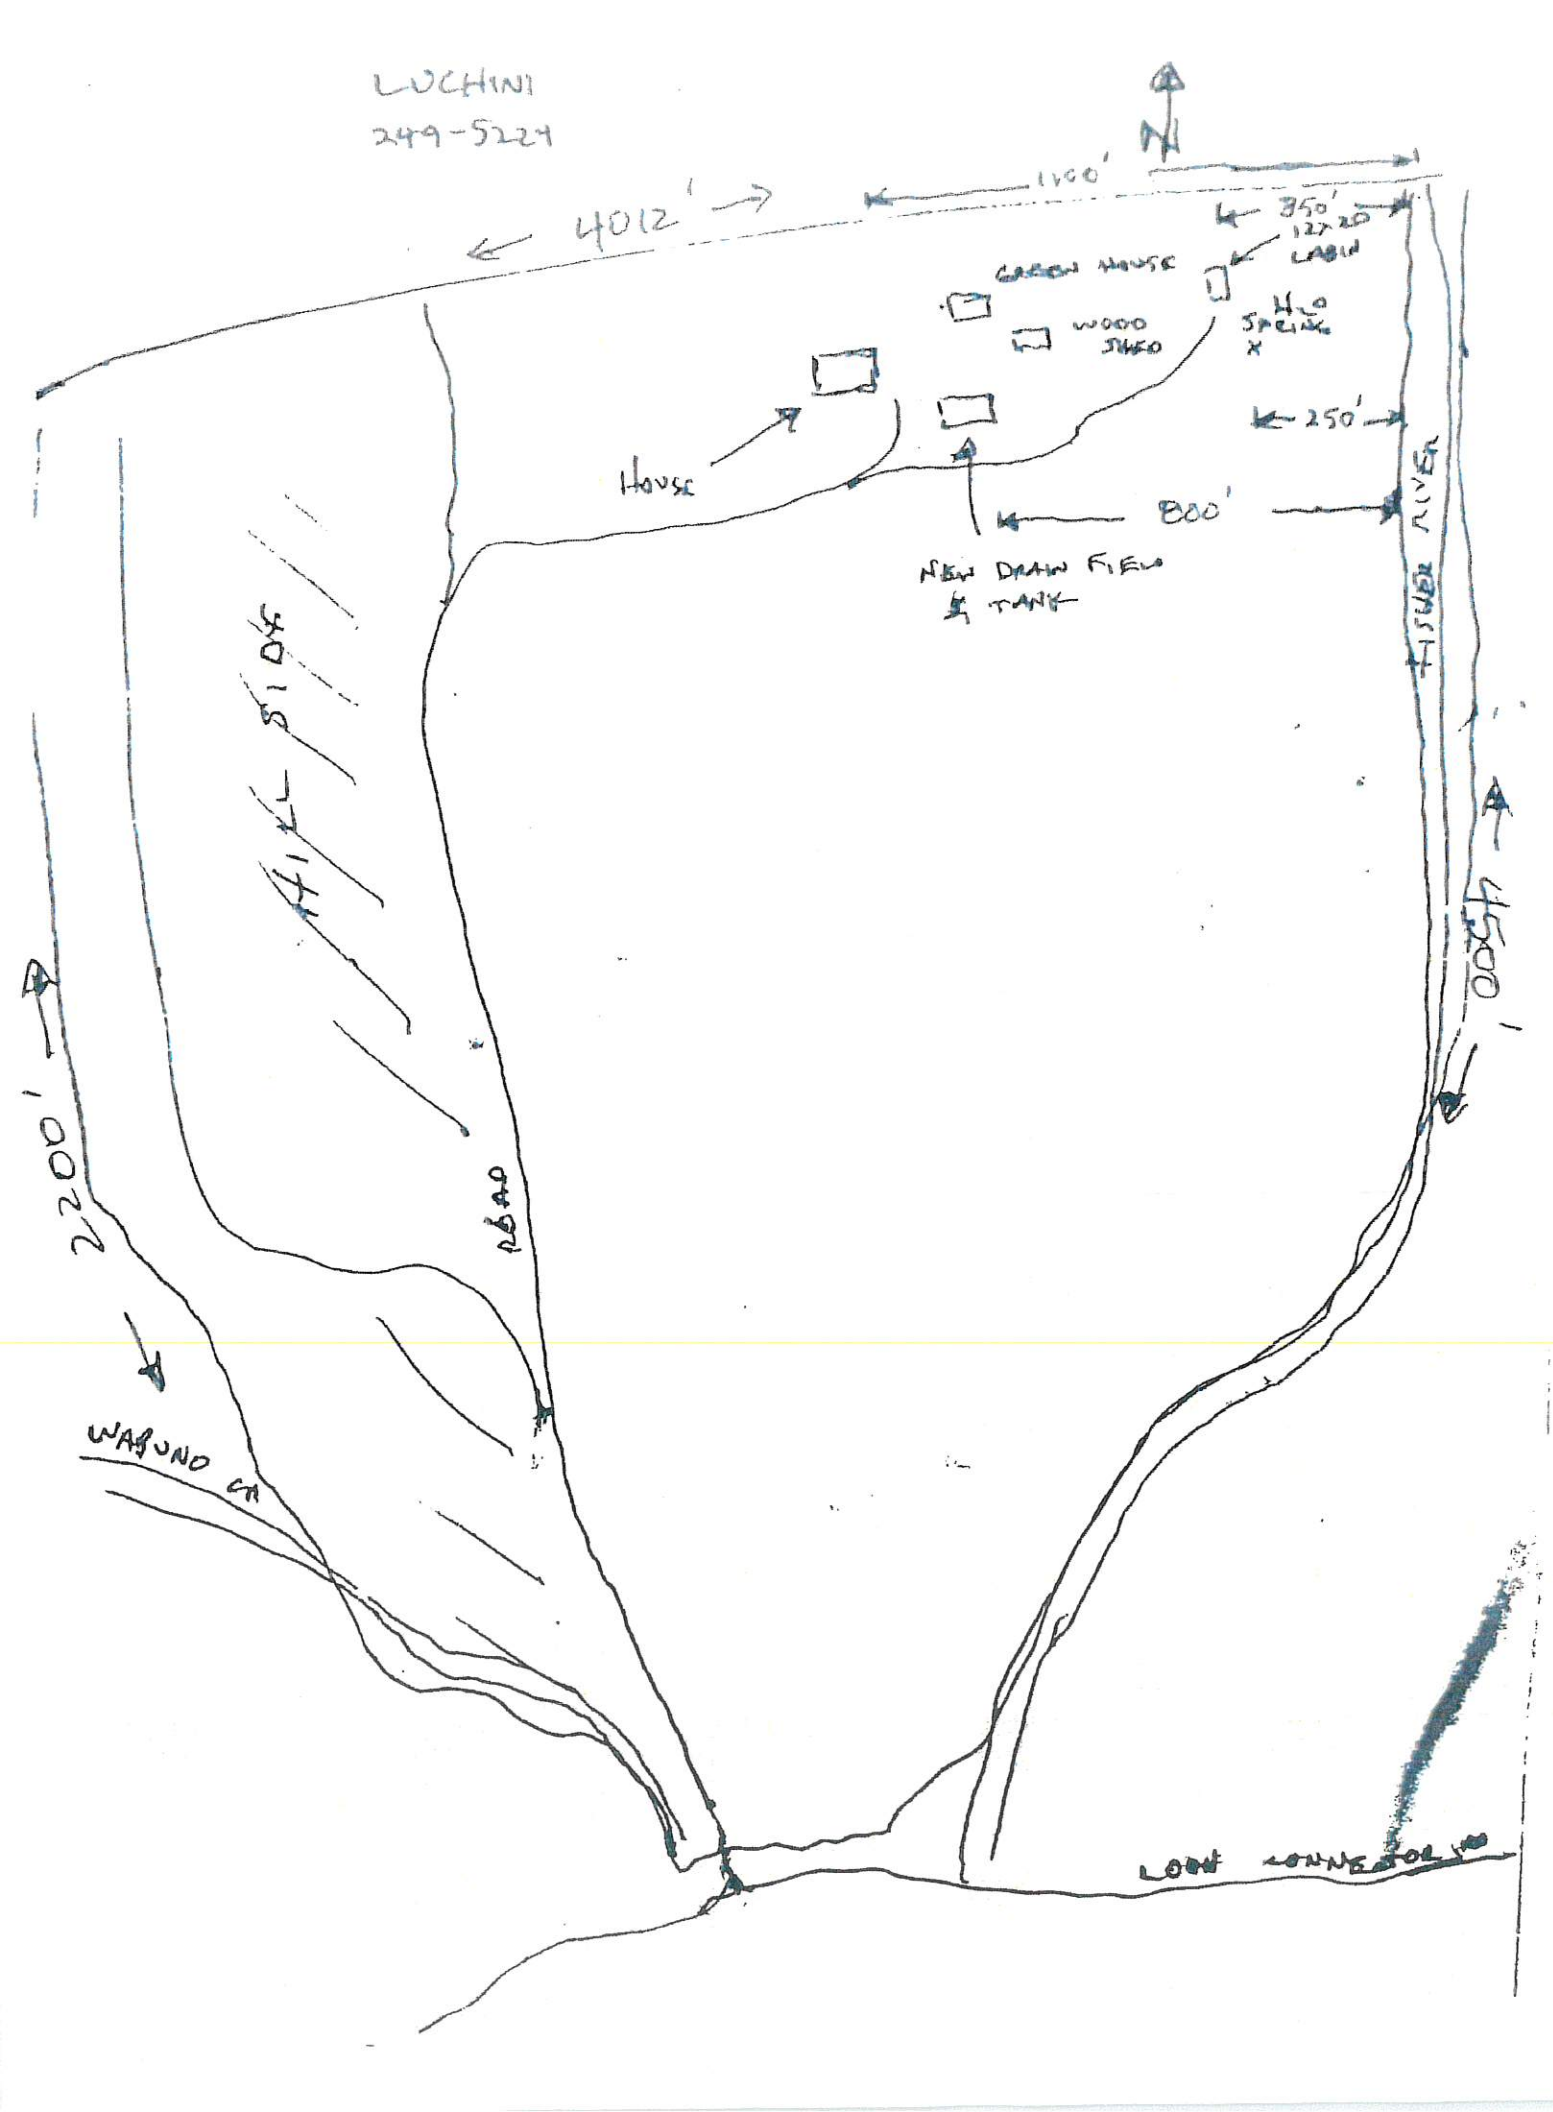
Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 8/22/25

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.


LUCHINI
249-5224
N
4012'
1100'
350'
12x20
CABIN
GREEN HOUSE
WOOD SHED
H2O SPRING
250'
HOUSE
800'
NEW DRAIN FIELD & TANK
FISHER RIVER
4500'
HILL SIDE
2,200'
ROAD
WARUNO CR
LOW CONNECTOR