LINCOLN COUNTY SEPTIC SYSTEM PERMIT

ISSUED TO: CARL LUNDEEN PHONE: [redacted]

ADDRESS: 113 LUNDEEN ROAD EUREKA CONTRACTOR: SELF

ISSUED BY (sign.): Ronald L Anderson RS. DATE: 6-30-89

INSPECTION BY (sign.): _____ DATE: _____

*PLEASE NOTE: The Lincoln County "On-site Sewage Disposal Regulation" does not conform with all requirements of the Montana State "Sanitation in Subdivision Act" Therefore, septic systems permitted under the county regulation may not be approvable for the purpose of future land division health reviews.

You must notify the Department of Environmental Health a minimum of 8 working hrs. before backfilling the septic system, so that it can be inspected.

LOCATION OF PROPOSED SYSTEM: 113 LUNDEEN ROAD S½SW¼ SEC 13 T36 R


SEPTIC TANK: 1000 gal. ABSORPTION AREA: 260 ft²


SEWAGE DISCHARGE: — gal/day No. OF BEDROOMS: 2

WATER SUPPLY SOURCE: City SOIL: SANDY LOAM SLOPE: 1 TO 1.5%

INSTRUCTIONS: DIG A DITCH AT LEAST 130' IN LENGTH X 2½-3' DE
X 2' WIDE ACCORDING TO LOT LAYOUT AND DITCH DIAGRAM
GRADE OF PIPE SHOULD NOT EXCEED 1% DROP.

SKETCH OF LOT LAYOUT:

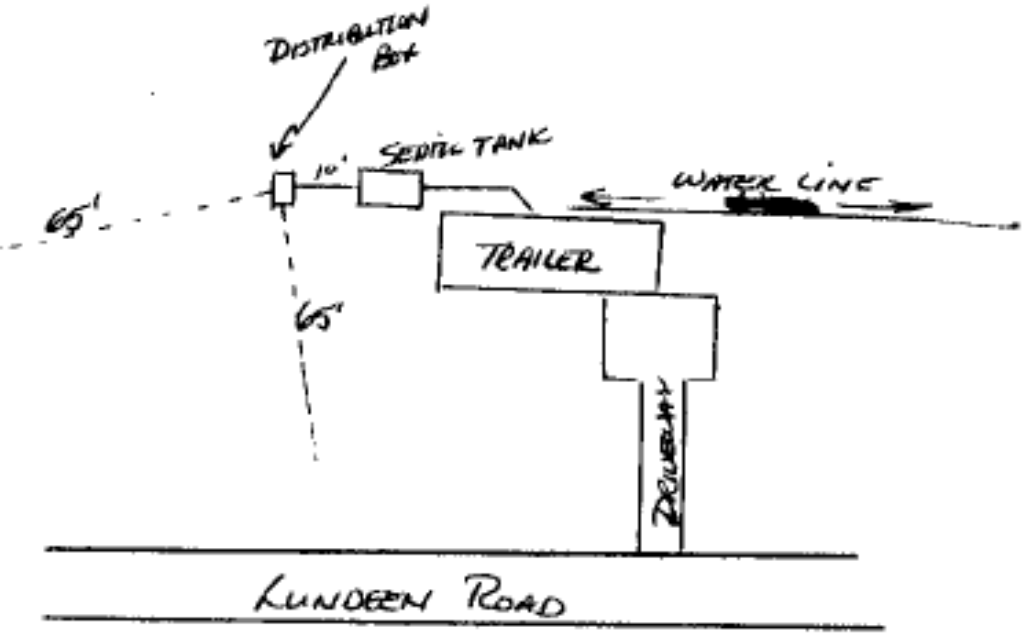

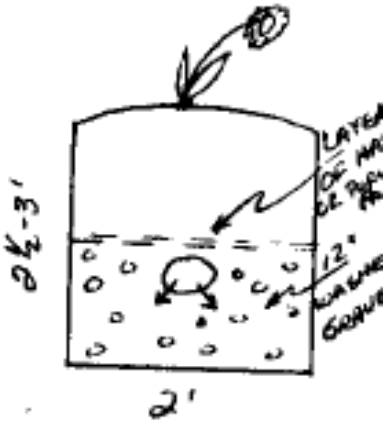

DITCH DIAGRAM