LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 05/09/2011 Expiration Date: 05/10/2012

Property Owner: David McCrimmon c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Gideon Yutzy License No. 113

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Using gravelless chambers – sizing reduction allowed per "Drainfield Size" below.

Parcel Description:

Legal: S26 T37 R28 Lot 3 of Koocanusa Views I

Address or Location: Truman Road

Approved Design Criteria:

Bedrooms: 3 Septic Tank Size: 1500 gallons Drainfield Size: 264 Linear Feet

(Note: Larger septic tank than minimum required size being installed per direction of homeowner)

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kendra J. Lind, R.S.*

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

Title: _____

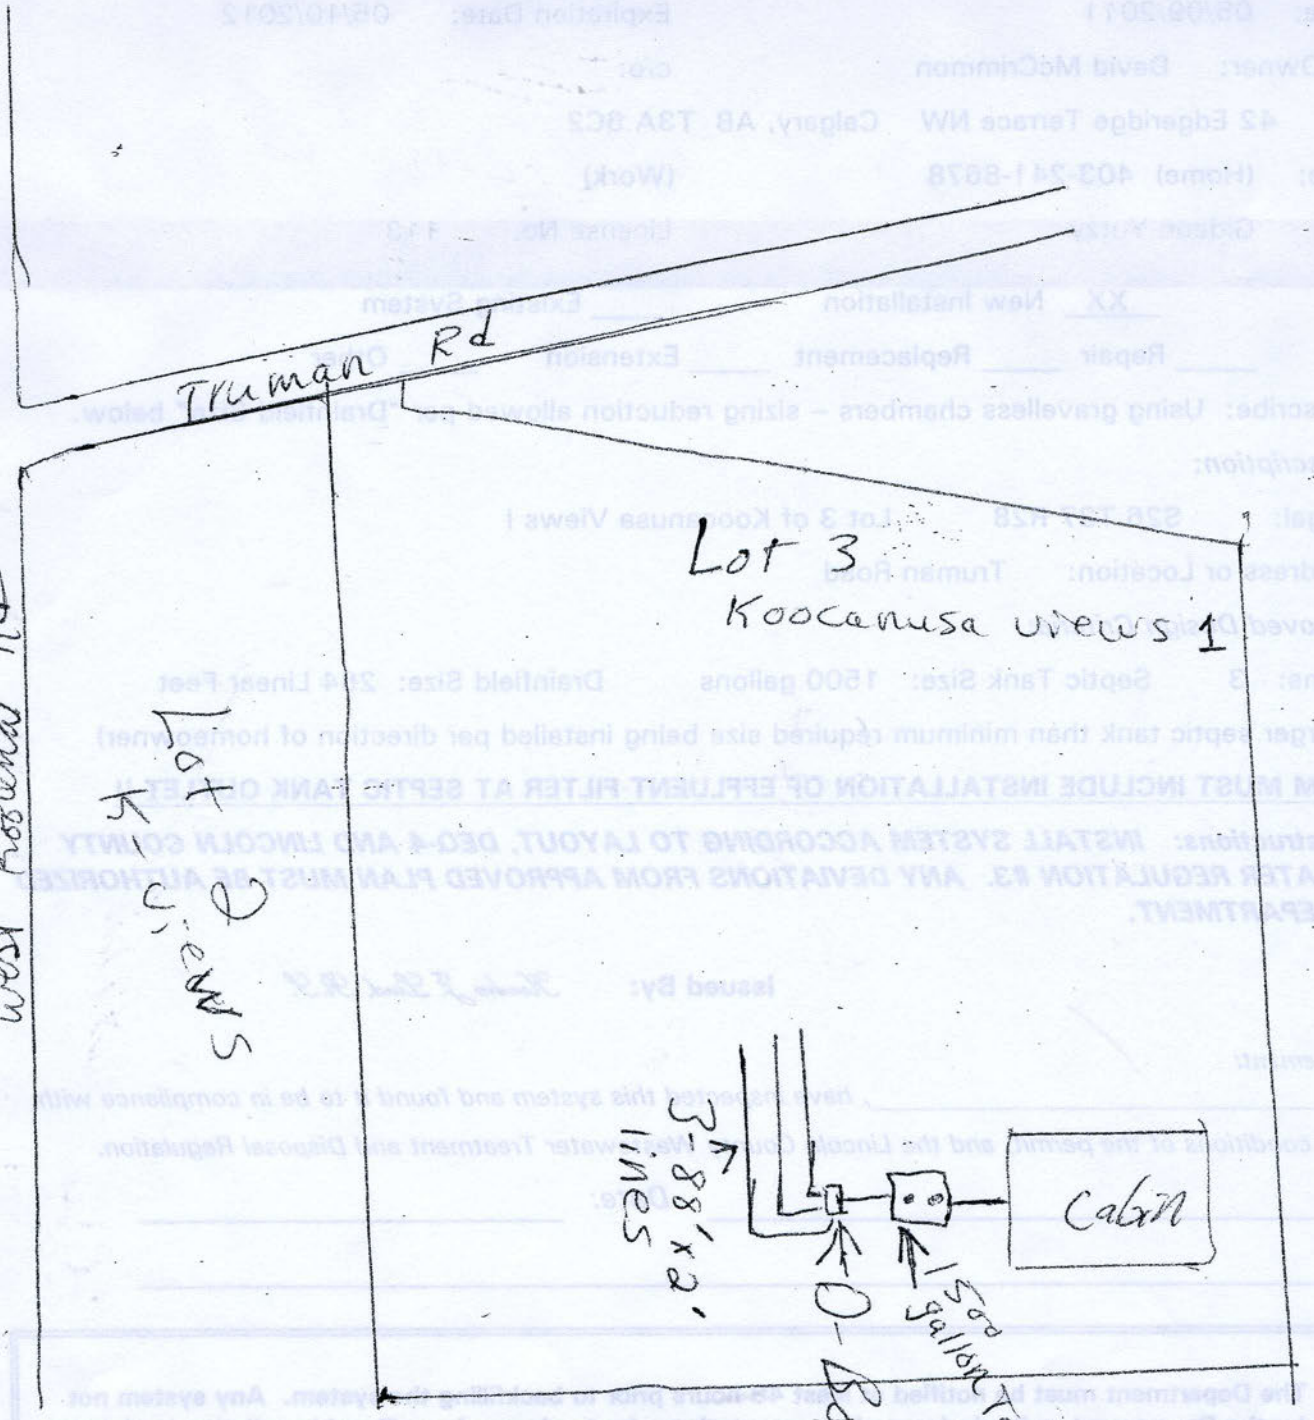
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


Truman Rd
West Kootenai Rd
Lot 3
Koocanusa Views 1
Lot 2
Swiss
3"-88' x 2 lines
Cabin
500 gallon Tank
Box