LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 07/07/2020 Expiration Date: 07/07/2021

Property Owner: Timothy Nagy c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work)

Installer: Kootenai Sand & Gravel Inc License No. 109

__XX__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Four 88' Laterals using drain rock & perf pipe

Parcel Description:

Legal: KSANKA FOOTHILLS, S10, T36 N, R26 W, ACRES 20, PM 6655 LOT 2 IN SW

Address or Location: 926 KSANKA FOOTHILLS RD Eureka, MT 59917

Geo/Assessors code: 0000054644

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 350 lineal feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Donavan Truman *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: _____ *Date:* 8/31/2020

Title: Licensed Installer 109 - Kootenai Sand & Gravel

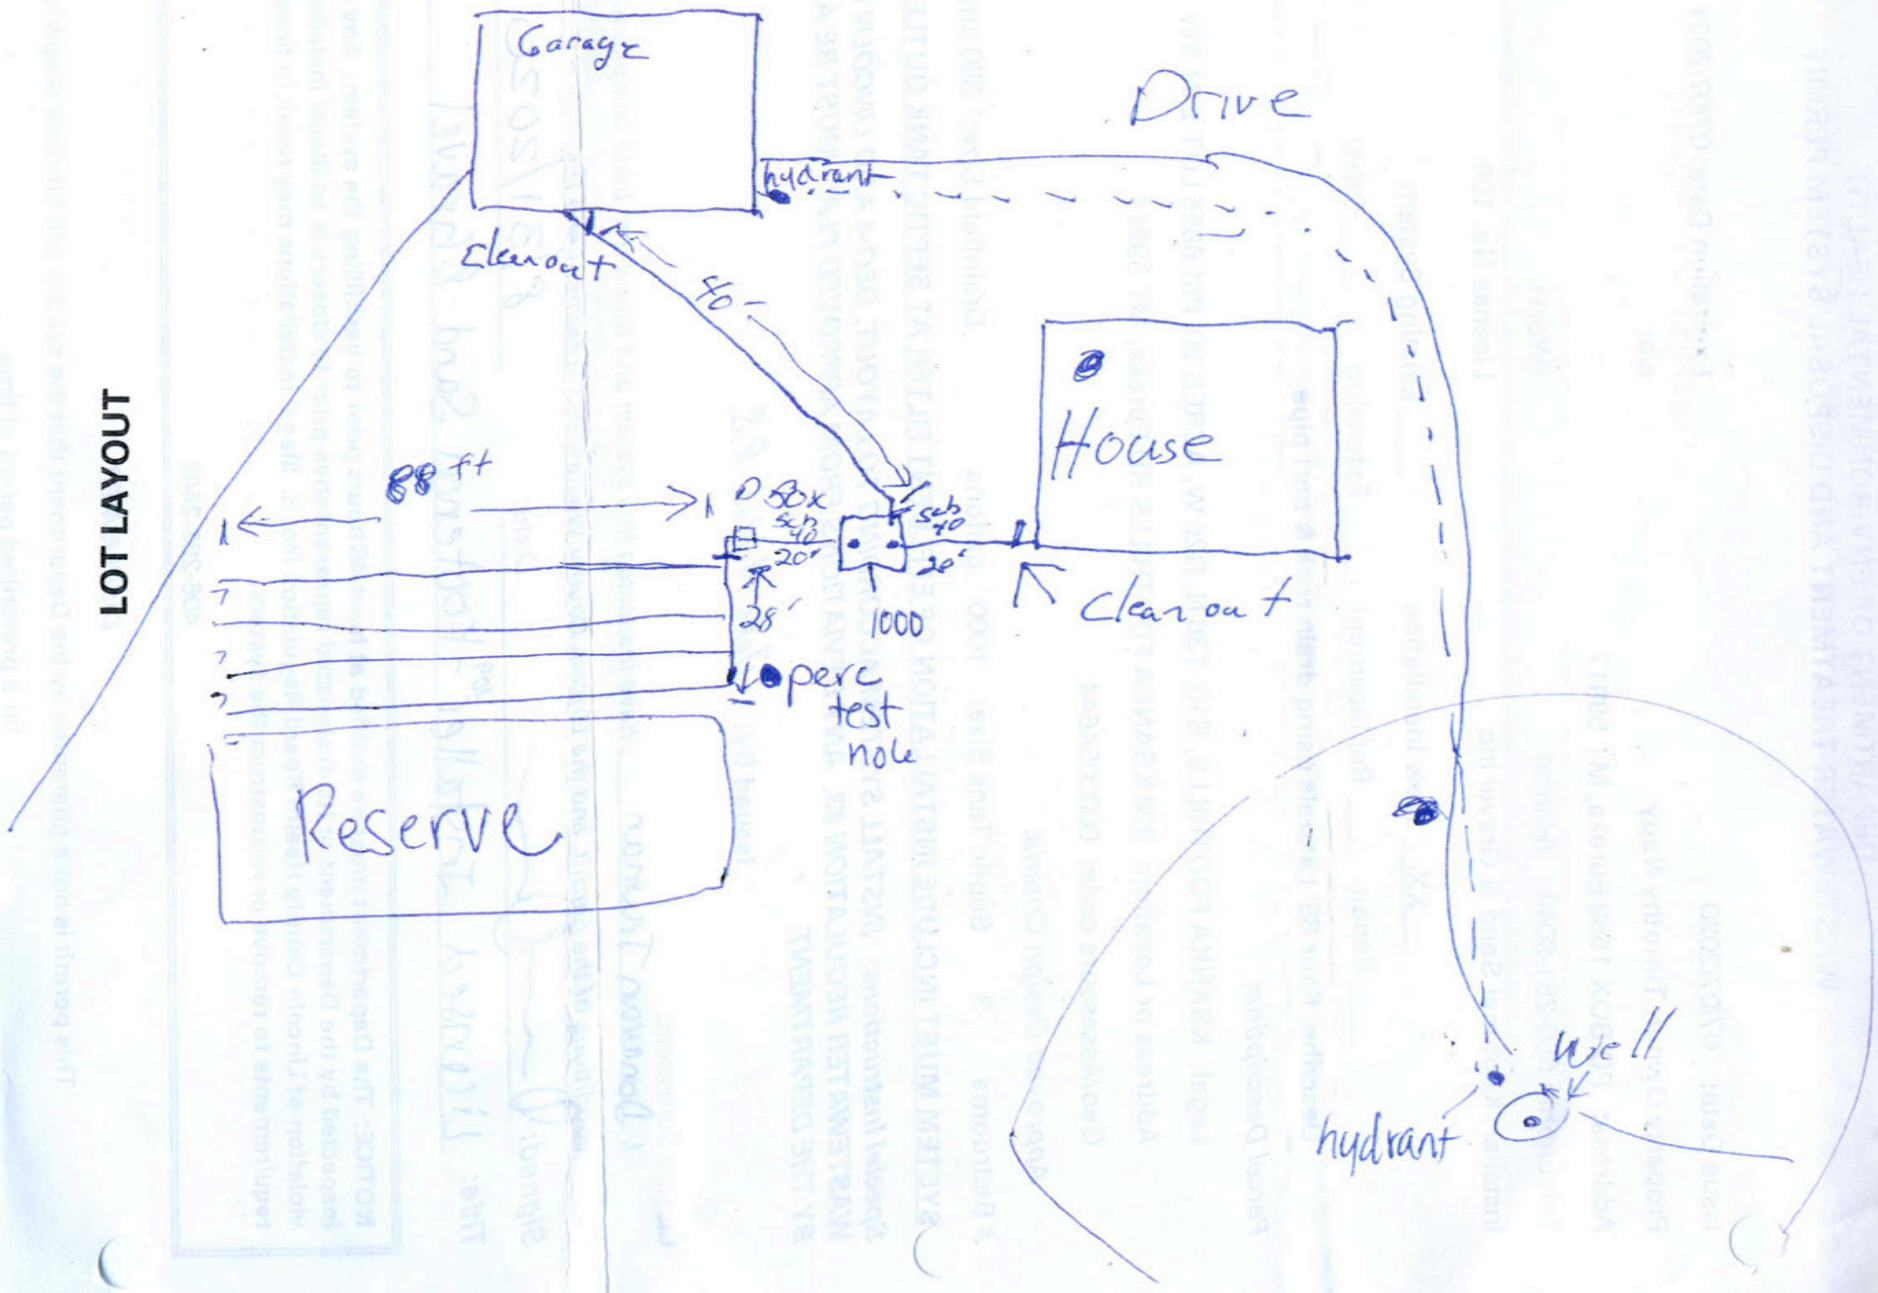
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


Garage
Drive
hydrant
Clean out
50 ft
House
88 ft
D Box
Sch 40
Sch 40
20'
20'
25'
1000
Clean out
perc test hole
Reserve
well
hydrant