# LINCOLN COUNTY
# DEPARTMENT OF ENVIRONMENTAL HEALTH
# WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/09/2019 Expiration Date: 10/20/2020

Property Owner: Tiffany Nixon c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work)

Installer: Earth Works License No. 164

__X__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: 1,000 Gallon Gravity System, Effluent Filter, 3-150' ft lats using graveless trenches

*Parcel Description*:

Legal: LICK LAKE, S26, T36 N, R26 W, ACRES 3.213, LOT 1 PM 6347

Address or Location: LOT 1

Geo/Assessors code: 56-4824-26-2-02-08-0000

*Approved Design Criteria*:

# Bedrooms 3 Septic Tank Size: 1,000 gallons Drainfield Size: 3-150 Linear Feet

**SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!**

***Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.***

**Issued By:** Jake Mertes, R.S.

Closure Statement:

I, Darrin D Plaid, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

*Signed:* Darrin D Plaid *Date:* 11/29/19

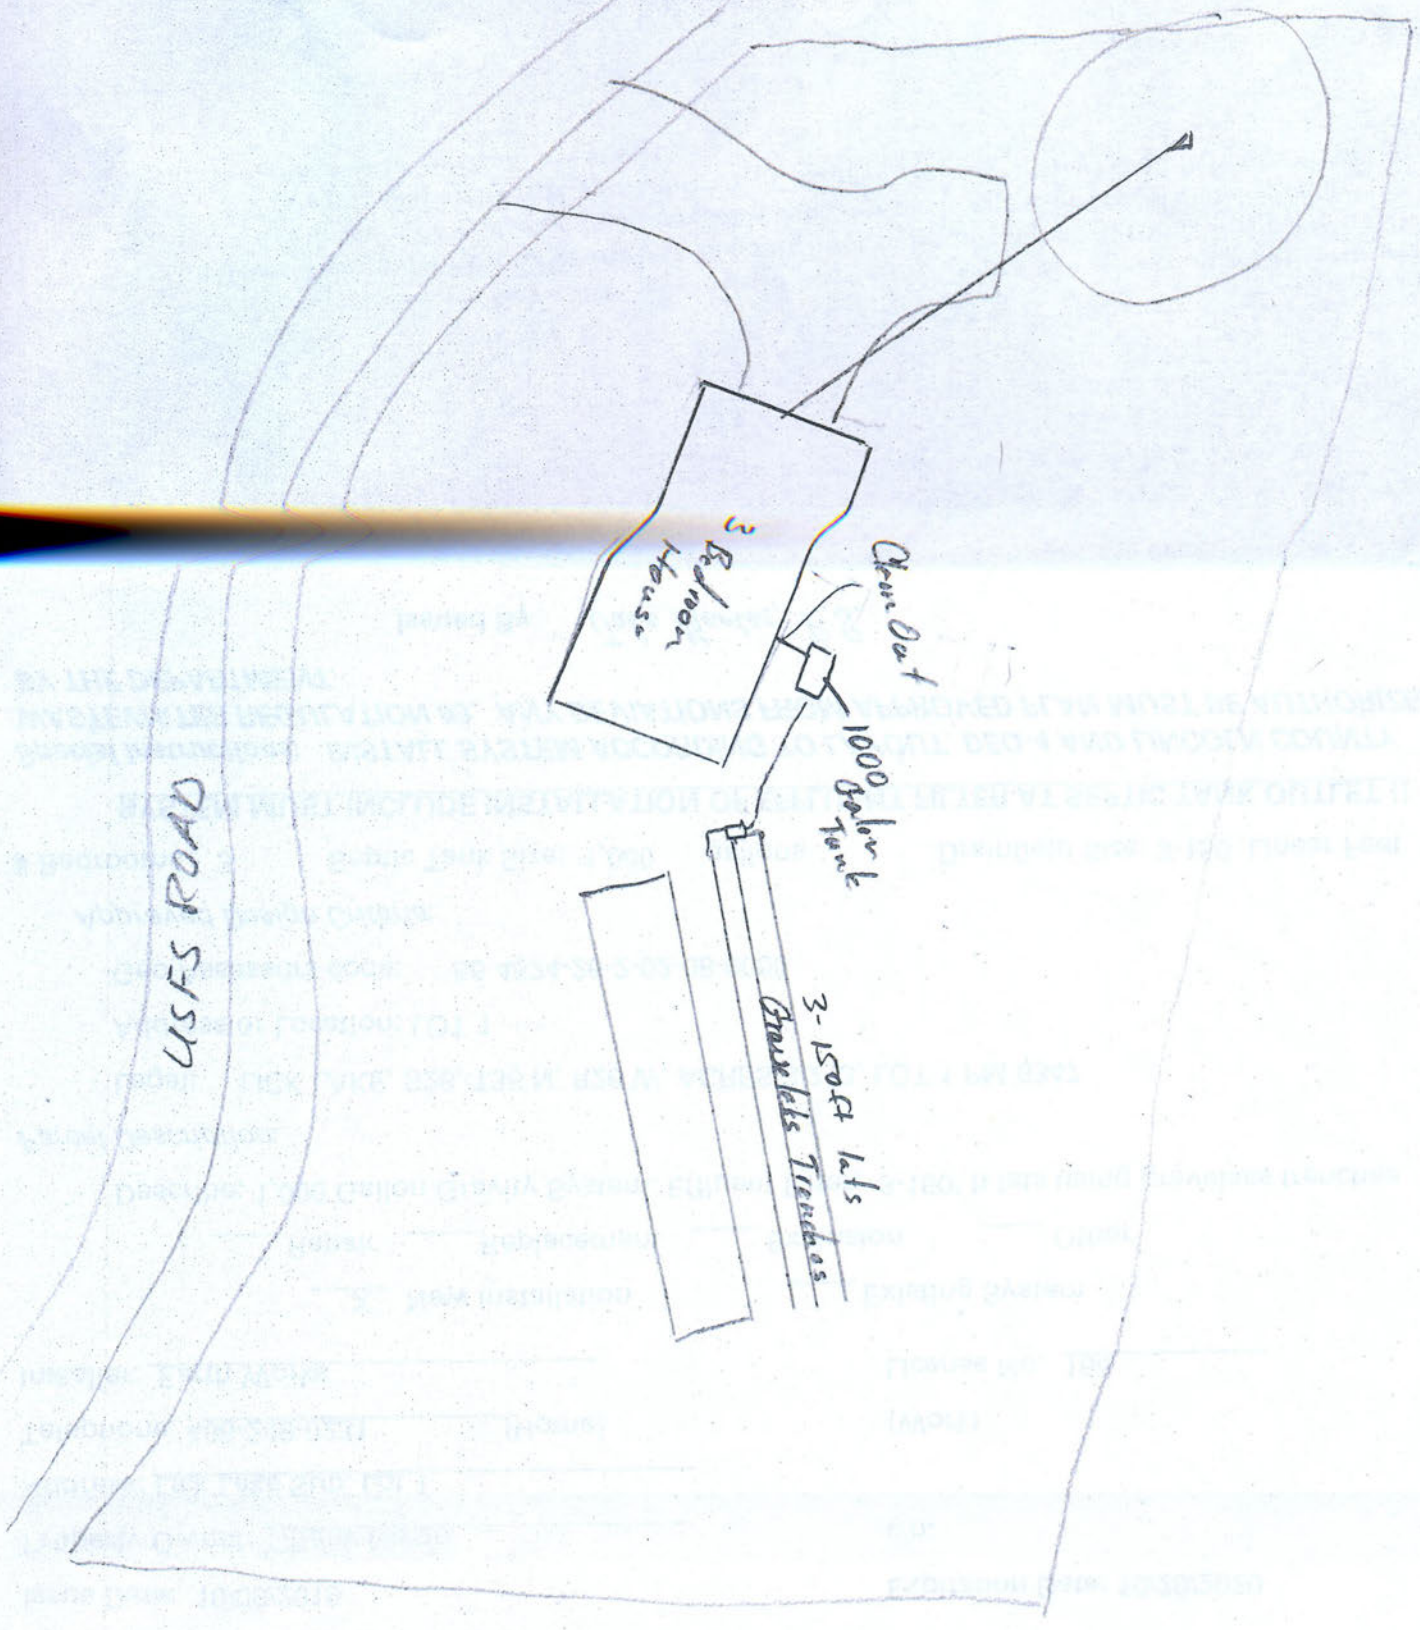
*Title:* Earth Works Owner

**NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.**

**406-283-2442**

***DISCLAIMER***

# LOT LAYOUT


USFS ROAD
3 Bedroom House
Clean Out
1000 Gallon Tank
3- 150ft lats
Gravelless Trenches