LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 06/2/2020 Expiration Date: 06/2/2021

Property Owner: North Point Inc c/o: Greg Johnson

Address: [redacted]

Telephone: (Home) (Work)

Installer: Bruce Todd License No. 54

____ New Installation __xx__ Existing System

____ Repair __xx__ Replacement ____ Extension ____ Other

Explain: Resturant/Bar

Describe: Four 84' pressure dosed laterals in 3' wide chambers.

Parcel Description:

Legal: S11 T36 R27

Address or Location: COS 272 Tract 7H

Geo/Assessors code: 00000007366

Approved Design Criteria:

550 Gal/day Septic Tank Size ------ gallons Drainfield Size: 336 linear feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, BRUCE TODD *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

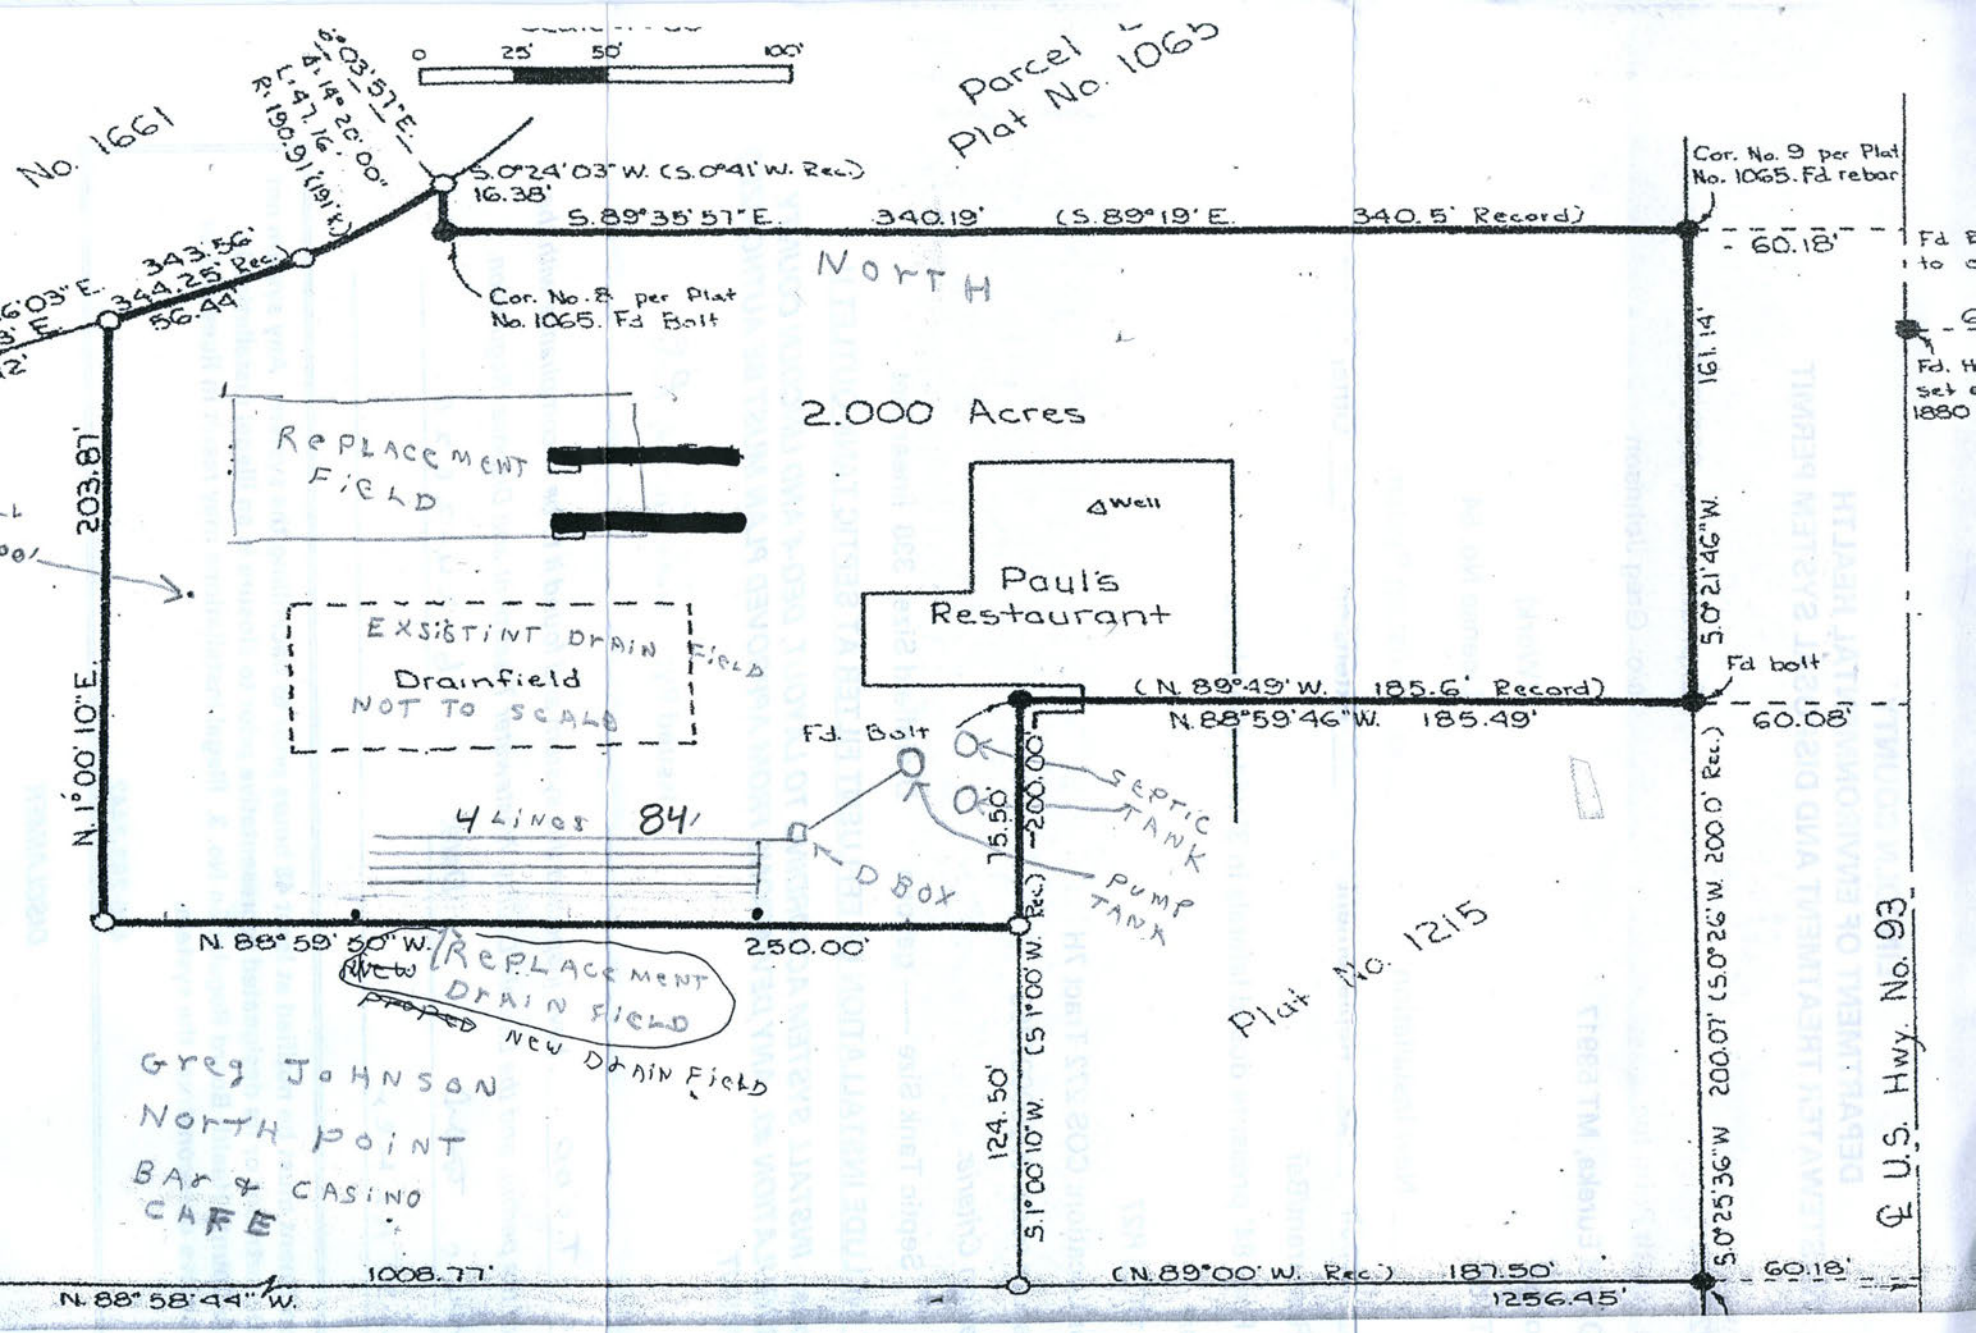
Signed: Bruce Todd *Date:* 6-24-2020

Title: INSTALLER

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER


No. 1661
Parcel
Plat No. 1065
0 25' 50' 100'
S.6°03'57"E.
L. 47.16'
R. 190.91' (191' K.)
Δ 14° 20' 00"
S.0°24'03"W. (S.0°41'W. Rec.)
16.38'
S.89°35'57"E. 340.19' (S.89°19'E. 340.5' Record)
Cor. No. 9 per Plat No. 1065. Fd rebar
60.18'
Cor. No. 8 per Plat No. 1065. Fd Bolt
NORTH
343.56'
344.25' Rec.
56.44
S.6°03'E.
2.000 Acres
REPLACEMENT FIELD
203.87'
Well
Paul's Restaurant
161.14'
S.0°21'46"W.
EXSISTINT DRAIN FIELD
Drainfield
NOT TO SCALE
Fd bolt
(N.89°49'W. 185.6' Record)
N.88°59'46"W. 185.49'
60.08'
Fd. Bolt
SEPTIC TANK
PUMP TANK
D BOX
4 LINES 84'
N.1°00'10"E.
200.00'
76.50'
N.88°59'50"W.
250.00'
REPLACEMENT DRAIN FIELD
NEW
PROPOSED
NEW DRAIN FIELD
Plat No. 1215
Greg JOHNSON
NORTH POINT
BAR & CASINO
CAFE
124.50'
S.1°00'10"W. (S1°00'W. Rec.)
S.0°25'36"W 200.07' (S.0°26'W. 200.0' Rec.)
℄ U.S. Hwy. No. 93
1008.77'
N.88°58'44"W.
(N.89°00'W. Rec.) 187.50'
1256.45'
60.18'