LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
AFFIDAVIT OF WASTEWATER TREATMENT AND DISPOSAL SYSTEM COMPLIANCE REVIEW FOR SYSTEM INSTALLED, REPAIRED OR REPLACED WITHOUT A VALID PERMIT

Issue Date: 06/03/2020 /2021

Property Owner: Brenda & Tony Oberdorf

Mailing Address: [redacted]

Telephone: [redacted] (Home) (Work) [redacted]

Name of Person Who Installed System Being Reviewed: Charley Follensbee #96

Type of System Work Reviewed:

_X_ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Three Lines at 88' inf & 2 End caps

Property Description:

Legal: COS 777 Parcel D E/12N1/2SW1/4 S17 T34N R25W

Address or Location: 18 Ant Flat Road

Reviewed Design Components:

Wastewater Flows: 300 gals/day Sewer Lines: SCHD 40 Septic Tank: 1000 Effluent Filter: YE

Dosing or Lift Tank: NO Drainfield Size: 270 Lineal Feet Drainfield Construction: Chambers

Hydraulic Function: YES

Comments:

System Review Documentation Statement:

I, Charles Follensbee *have inspected/reviewed the components of this system as listed above and found it to be in compliance with the sizing, construction, orientation and operating requirements of Chapter 17, Subchapter 9 A.R.M., Circular DEQ-4 and Lincoln County Wastewater Regulation #3.*

Signed: [signature] *Date:* 6/11/20

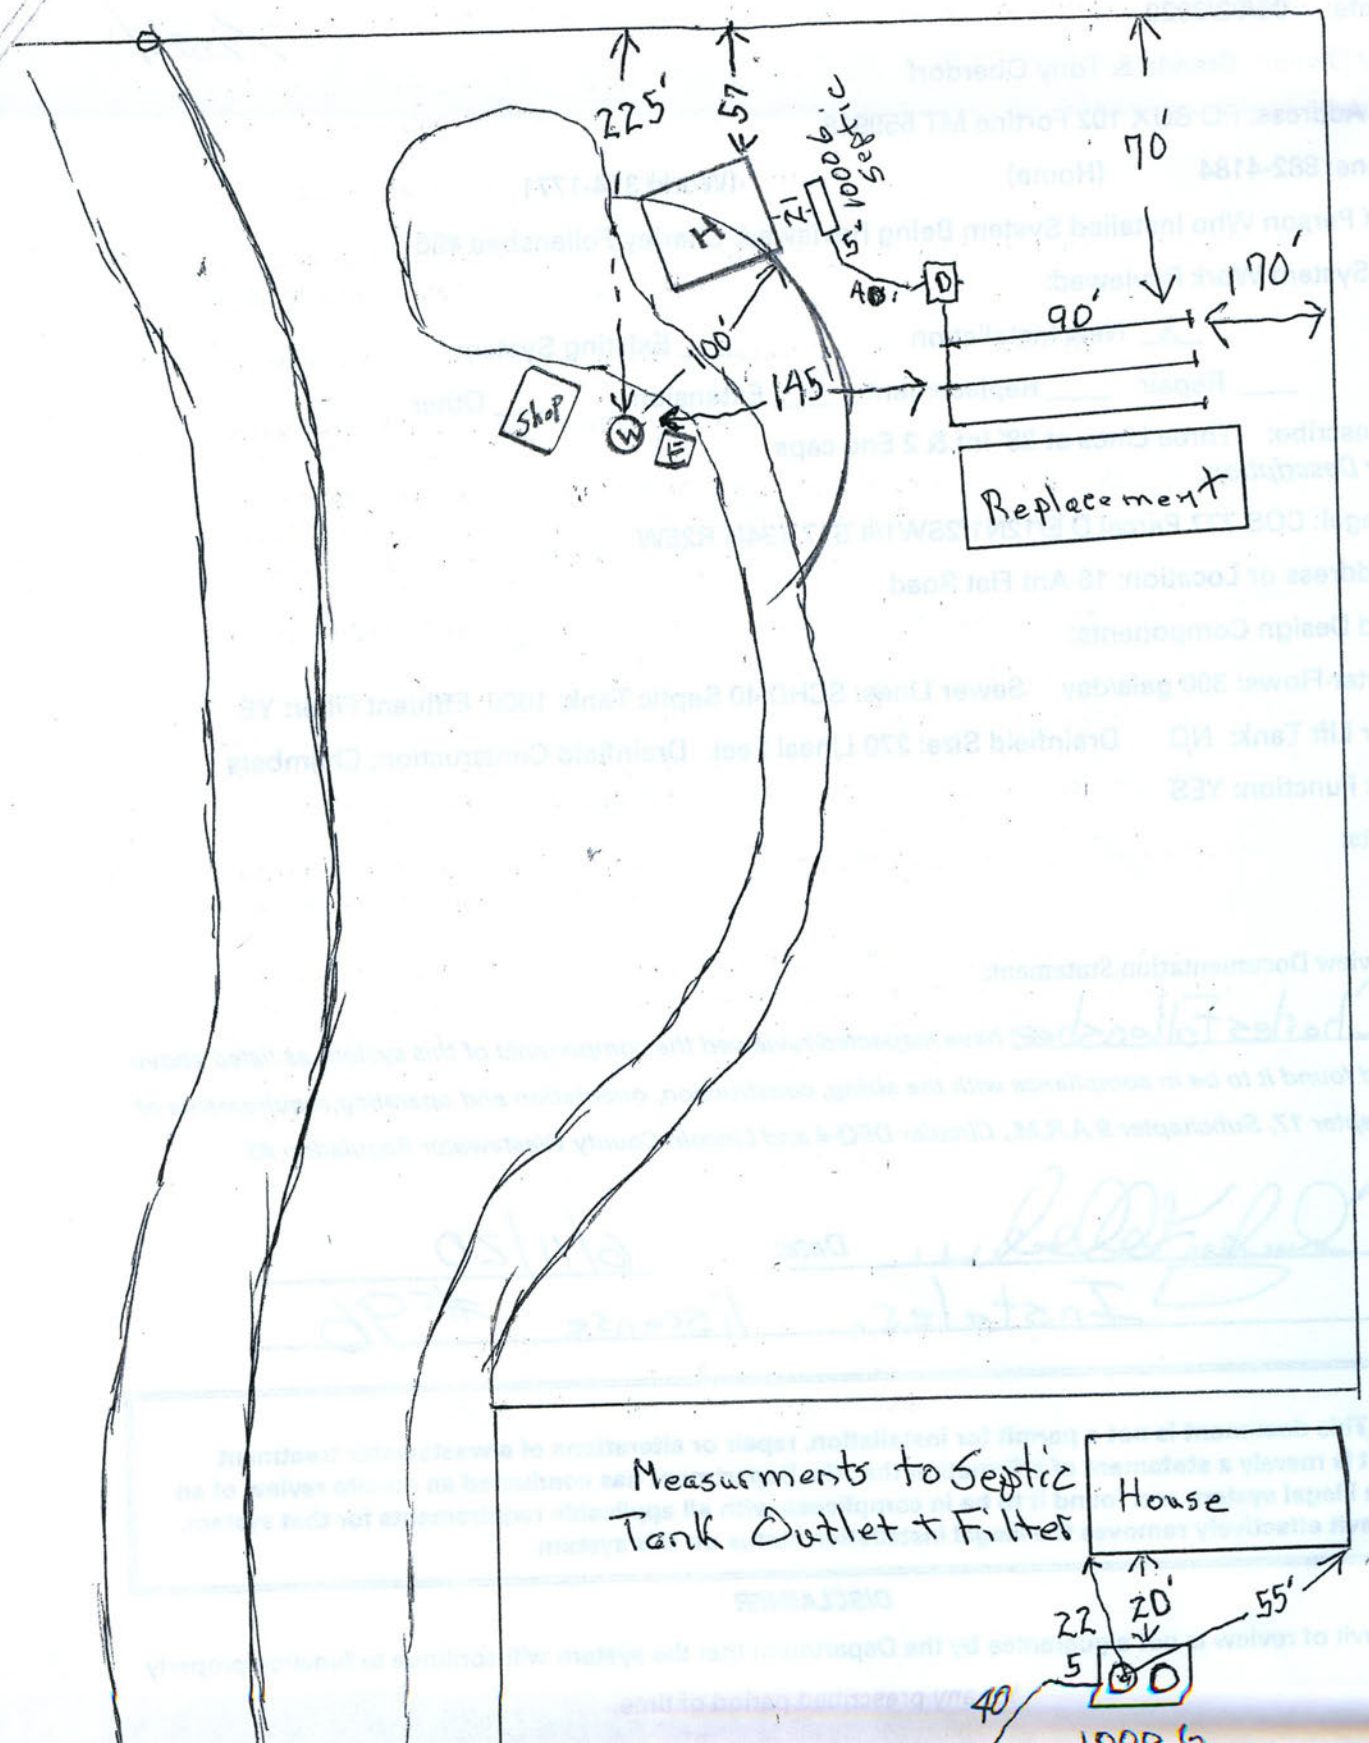
Title: Installer License #96

NOTICE: This document is not a permit for installation, repair or alterations of a wastewater treatment system. It is merely a statement of affirmation that the Department has conducted an on-site review of an otherwise illegal system and found it to be in compliance with all applicable requirements for that system. This affidavit effectively removes the illegal installation status on this system.

DISCLAIMER

This affidavit of review is not a guarantee by the Department that the system will continue to function properly for any prescribed period of time.

LOT LAYOUT


225'
57'
70'
H
1000 gal Septic
5'
40'
D
90'
170'
100'
145'
Shop
W
F
Replacement
Measurments to Septic Tank Outlet + Filter
House
22'
20'
55'
5'
40'