LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/4/2019 Expiration Date: 10/4/2020

Property Owner: Lerah Parker c/o:

Address: [redacted]

Telephone: (Home) (Work)

Installer: Tally Hoe self License No. #1

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Three 85' laterals using gravelless chambers.

Parcel Description:

Legal: S25 T31 R31

Address or Location: MBMI Development Inc. Subdivision, Lot 2A

Geo/Assessors code: 0000050467

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 255 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Thomas J Cole *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Thomas J Cole *Date:* 10-8-19

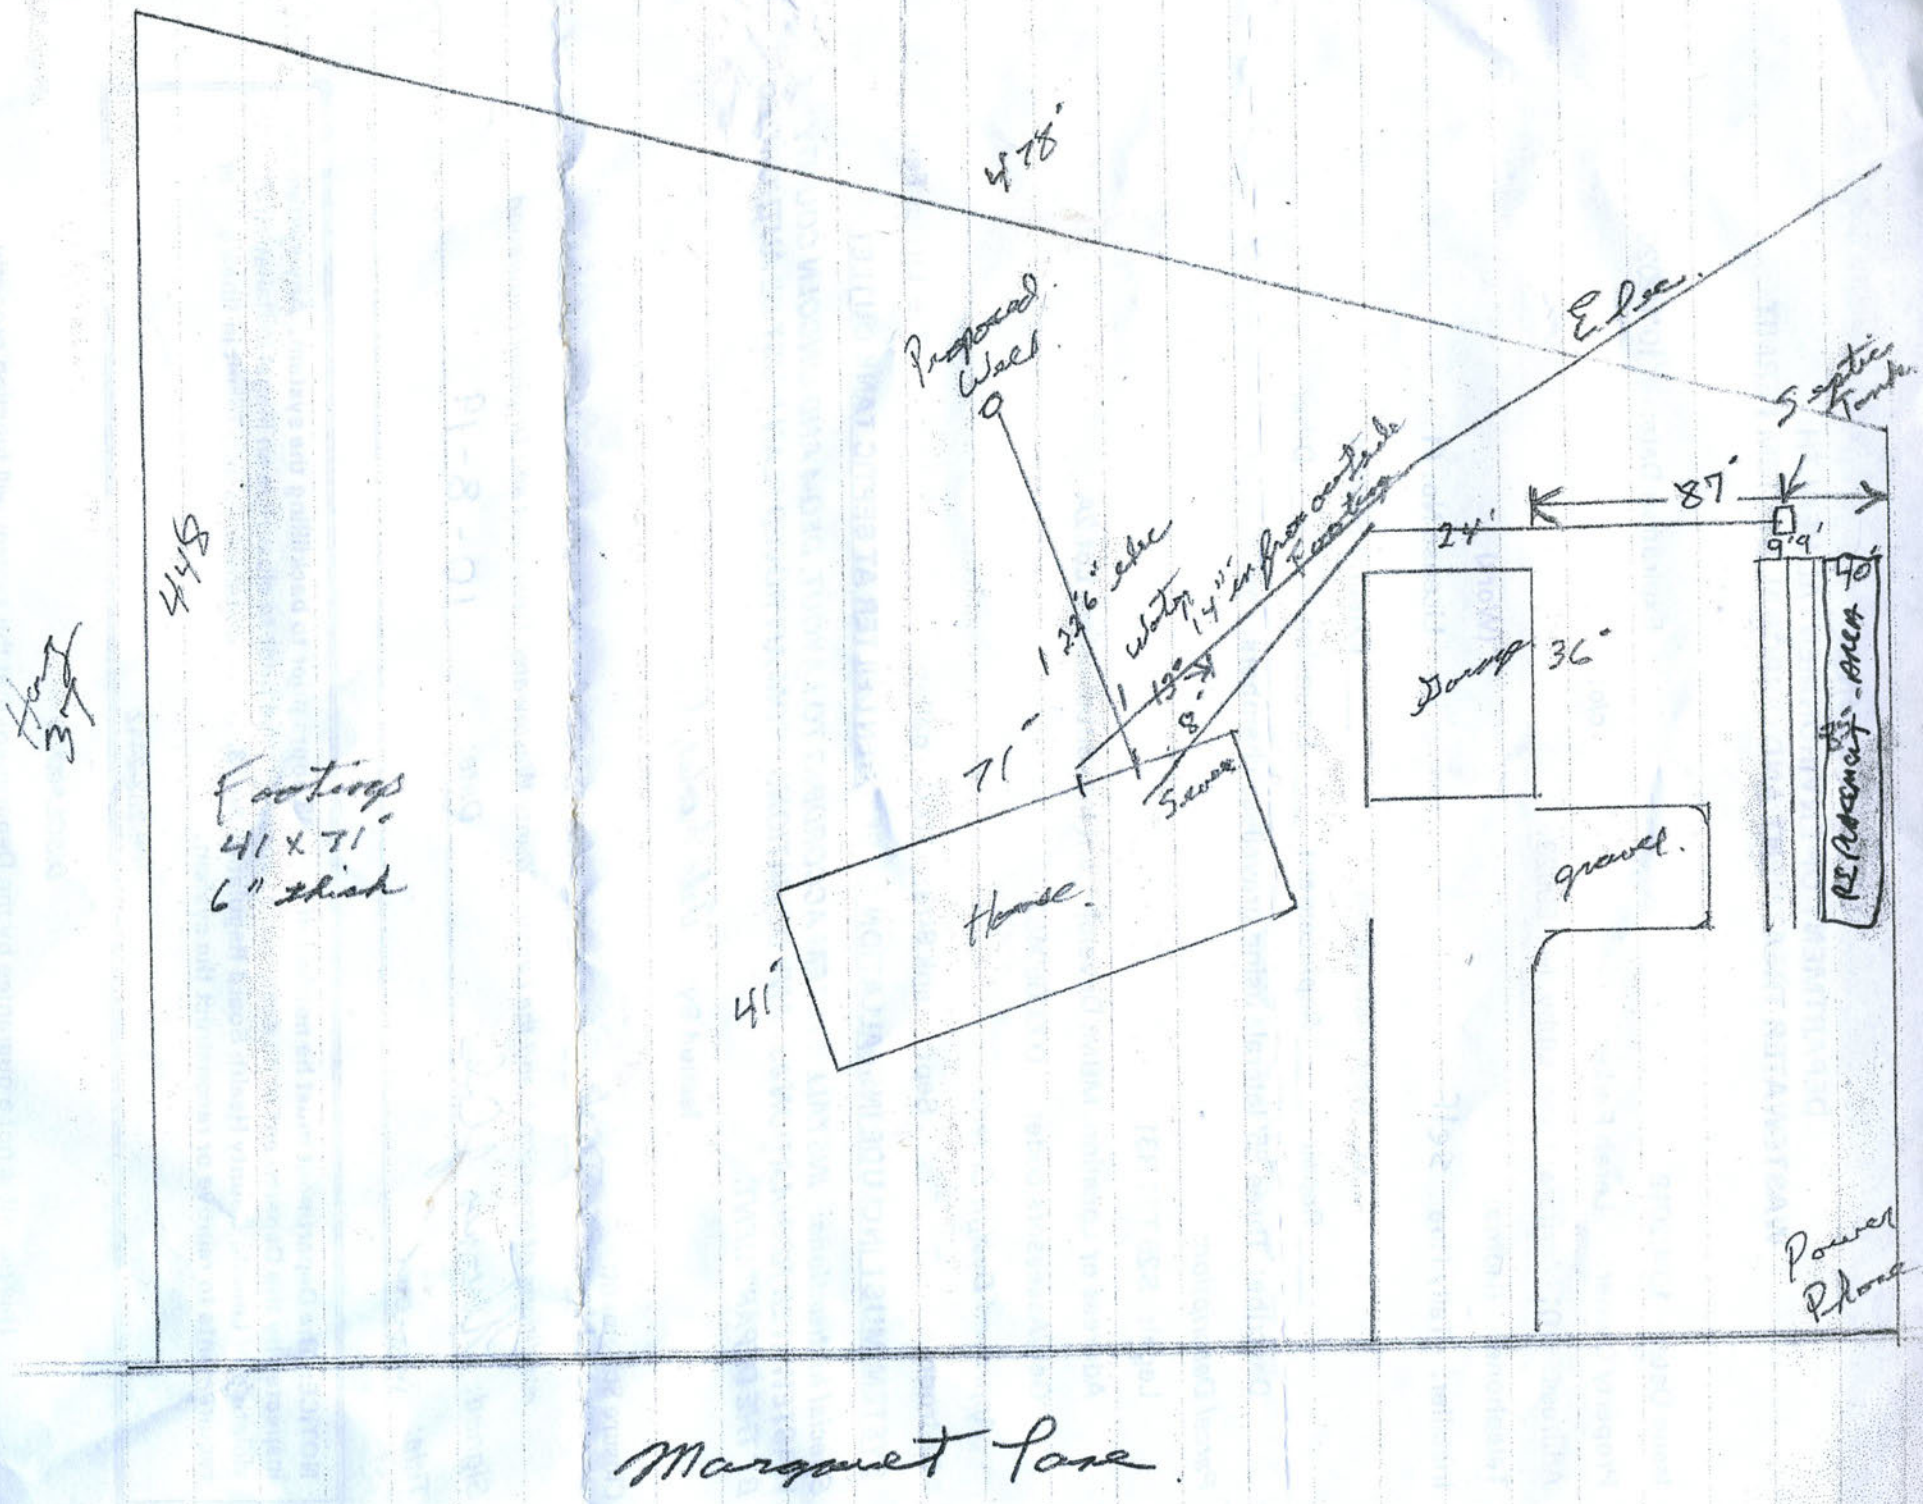
Title: inspector

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


478'
448'
Proposed Well
E. Elec.
Septic Tank
87'
24'
9'
9'
40'
Dump 36'
12'6" elec
water
14" in from edge
Fence
8'
71'
Sewer
House
41'
gravel.
Power Pole
Footings
41 x 71'
6" thick
Marquet Lane