LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 8/5/2016 Expiration Date: 8/5/2017

Property Owner: Greg Petersen c/o: Oedewaldt Const. Inc.

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Terry Oedewaldt License No. 2

___ New Installation __xx_ Existing System

____ Repair __xx_ Replacement ____ Extension ____ Other

Describe: 2 100' trenches using gravelless chambers.

Parcel Description:

Legal: S10 T26 R29

Address or Location: TR-4F 62264 US HWY 2

Geo/Assessors code: 0000001216

Approved Design Criteria:

Bedrooms 2 Septic Tank Size: 1000 gallons Drainfield Size: 200 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, TERRY OEDEWALDT, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: [signature] *Date:* 10/28/2016


Title: PRESIDENT

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

LOT LAYOUT

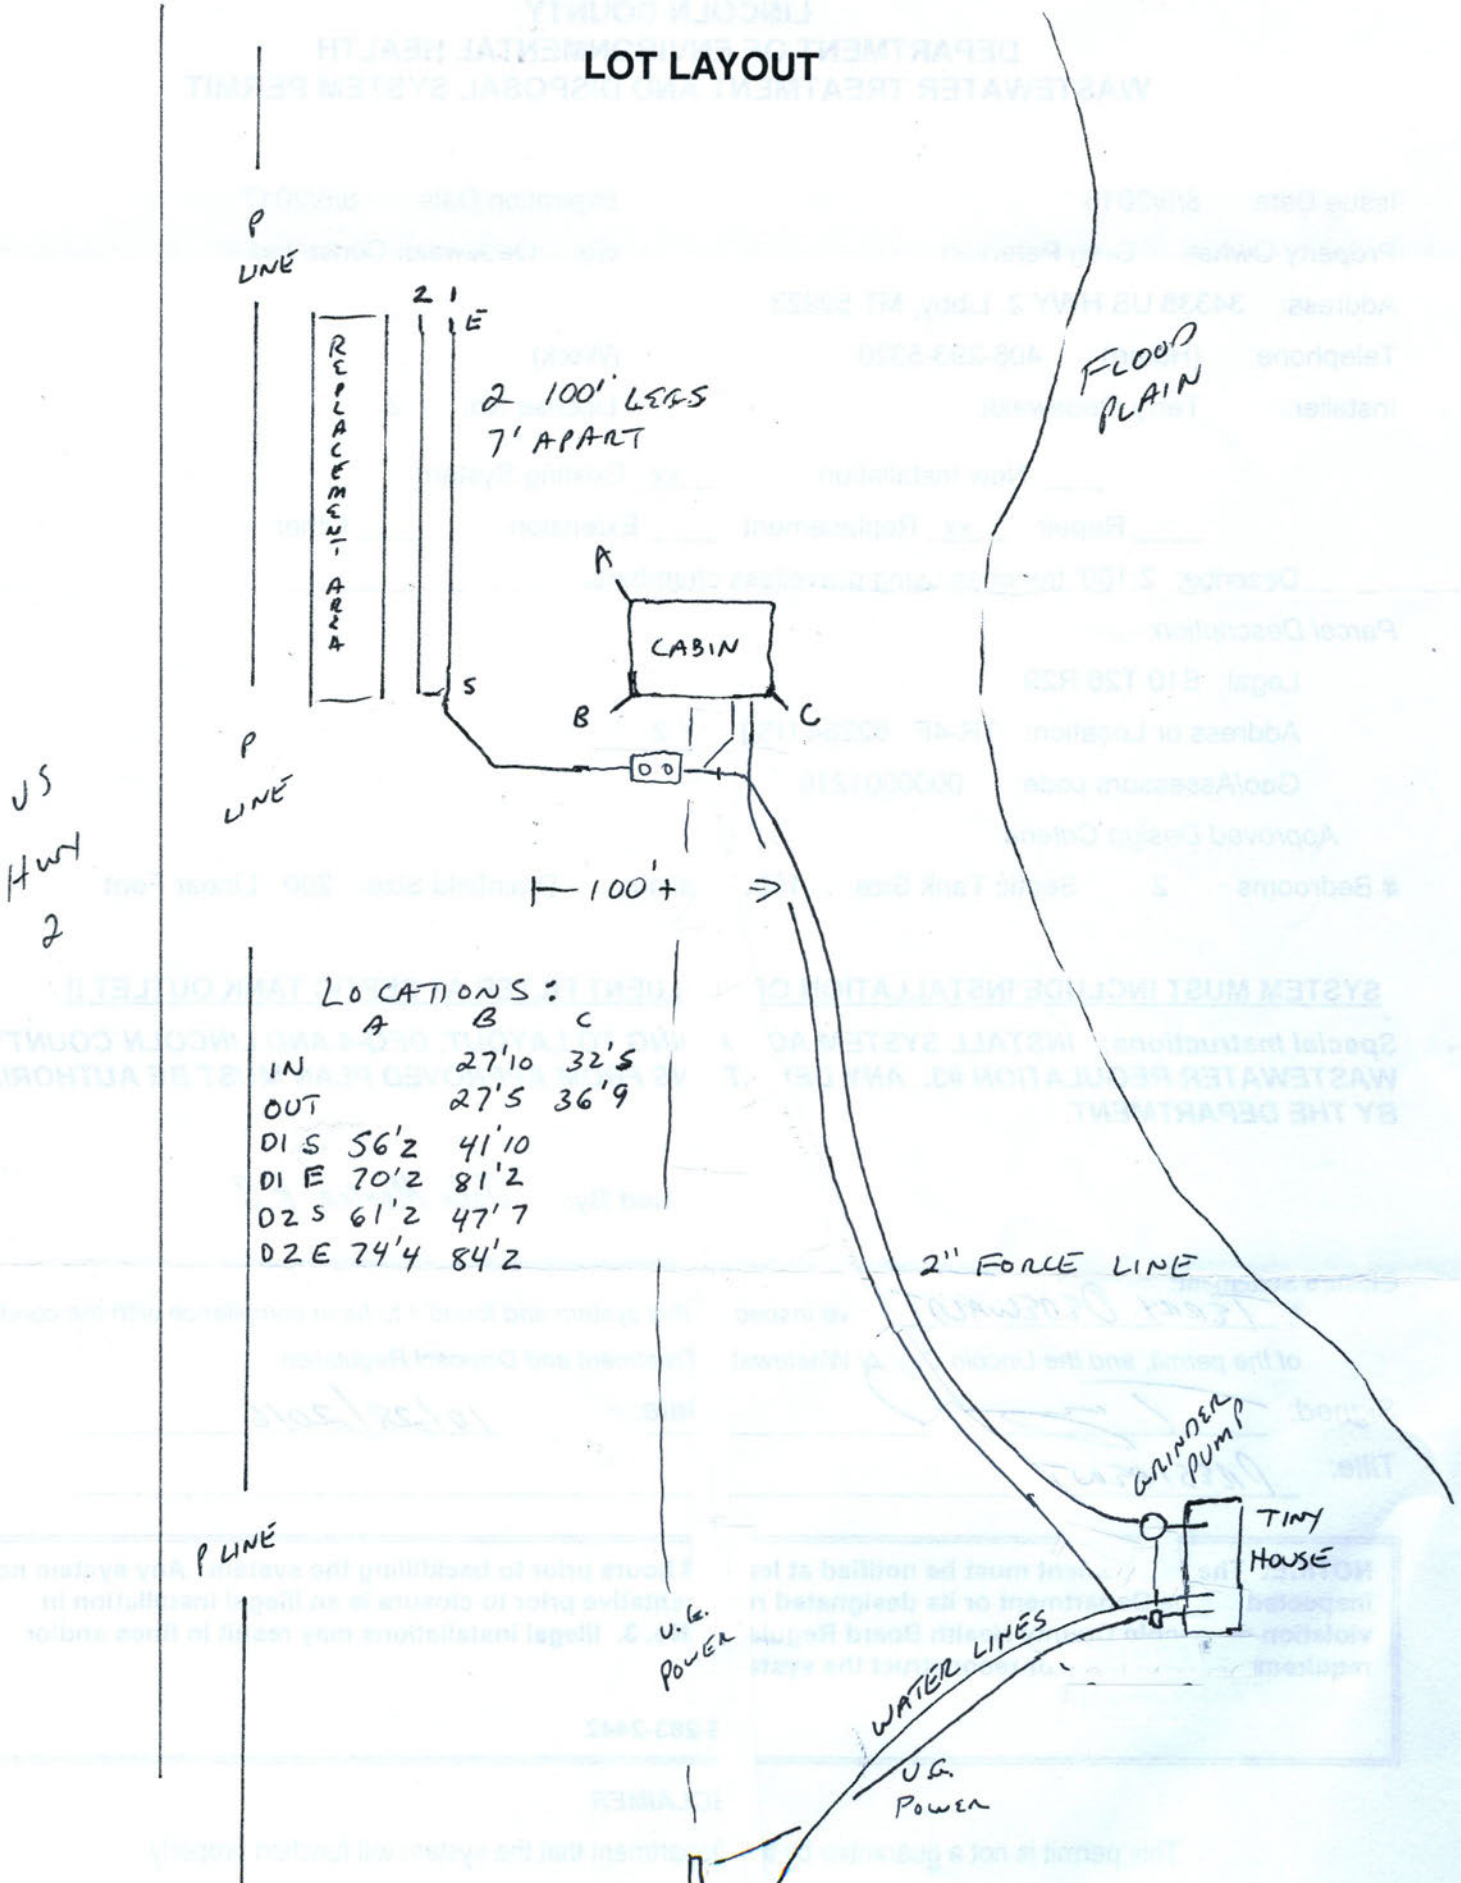

LOCATIONS:

	A	B	C
IN		27'10	32'5
OUT		27'5	36'9
D1 S	56'2	41'10	
D1 E	70'2	81'2	
D2 S	61'2	47'7	
D2 E	74'4	84'2	