# LINCOLN COUNTY
# DEPARTMENT OF ENVIRONMENTAL HEALTH
# WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 02/21/2020 Expiration Date: 02/21/2021

Property Owner: Tim Pinkston c/o:

Address: [redacted]

Telephone: [redacted] (Home) [redacted] (Work)

Installer: Koocanusa Excavating LLC License No. 135

___ New Installation ____ Existing System

____ Repair _____ Replacement __xx__ Extension ____ Other

Explain: Previous COSA #06-1432 Replaced by COSA#20-1193

Describe: Existing drainfield has (4) 75' Laterals, (1) 75' lateral to be added to existing

*Parcel Description*:

Legal: 23, T37 N, R27 W, C.O.S. CS 3485, PARCEL C, ACRES 9

Address or Location: 162 Schatzel Road, Eureka MT 59917

Geo/Assessors code: 0000054609

*Approved Design Criteria*:

# Bedrooms (1)-bedrooms, (1)2-bedroom Septic Tank Size(2) 1000/500 gallons

Drainfield Size: (5) 75' laterals Lineal Feet

**SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!**

***Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.***

**Issued By:** Jake Mertes, R.S.

Closure Statement:

*I,* Buck Scheumerhorn *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*


*Signed:* [signature] *Date:* 8/4/20

*Title:* President

**NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.**

**406-283-2442**

**DISCLAIMER**

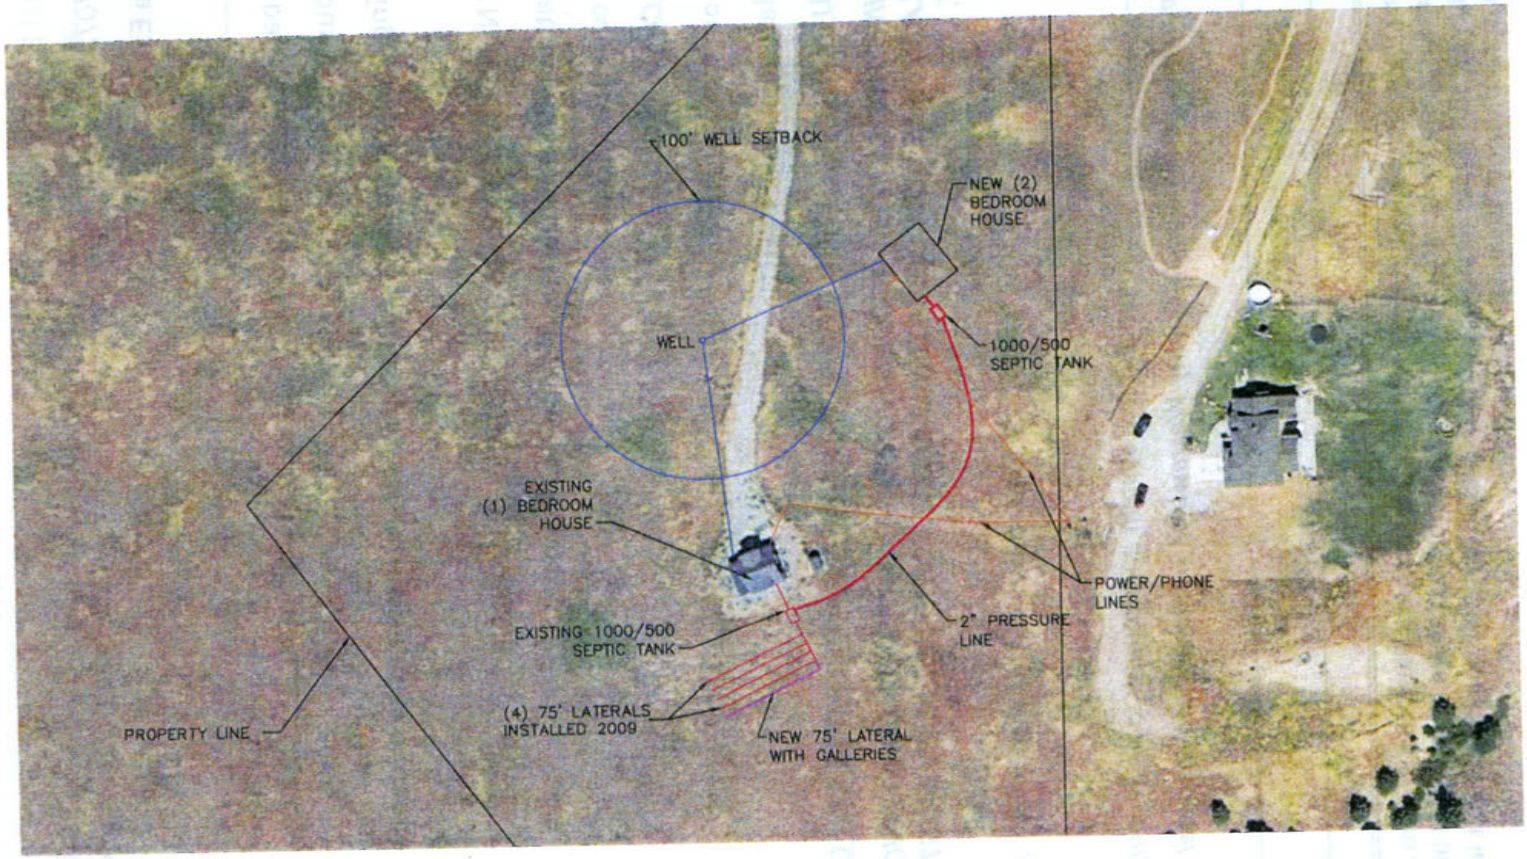


TIM PINKSTON SITE LAYOUT

| REV | DESCRIPTION | BY/DATE | APPRD/DATE |
|---|---|---|---|

| | | | | | |
|---|---|---|---|---|---|
| REV | DATE | COMPANY: KEI | SCALE: 1/16 & NOTED | KOOCANUSA EXCAVATING PINKSTON SEPTIC | |
| | | CONTRACT: VERBAL | DATE: 10/2019 | SITE LAYOUT | 1/9/20 |
| | | PLOT FILE: PNL-0001 | WEIGHT: | S. MCNAMARA | 1/9/20 |
| | | | | PINKSTON | 1 |

THIS DRAWING IS PROPERTY OF KEI UNTIL CONTRACT HAS BEEN SECURED BETWEEN OWNER & KEI IT CAN NOT BE SUBMITTED TO ANY OTHER PARTIES WITHOUT WRITTEN APPROVAL FROM KEI MANAGEMENT