LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 07/25/2025 Expiration Date: 07/24/2026 Permit#25-55058

Property Owner: Terri Przewoznik

Mailing Address: [redacted]

Installer: Doug Luchini License #: 183

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new pressure dosed system for 3 Bedroom House.

Legal: MCGINNIS CREEK FLATS, 3.508, T26 N, R28 W, LOT 1, ACRES 11.71, PM 6837

Property Address: 104 McGinnis Creek Rd., Libby, MT 59923 Assessment Code: 55058

DEQ COSA: E.Q. # 08-1100 McGinnis Creek Flats III Date: 11/8/2007

Approved Design Criteria: Installation of new pressure dosed system for 3 Bedroom House with 3 Laterals @ 84'.

# of Bedrooms: 3 Septic Tank Size: 1000/500 Trench Width: 36"

# of Laterals: 3 Length of Laterals: 84' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, Circular DEQ-4, and COSA(If Applies). It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, RS*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

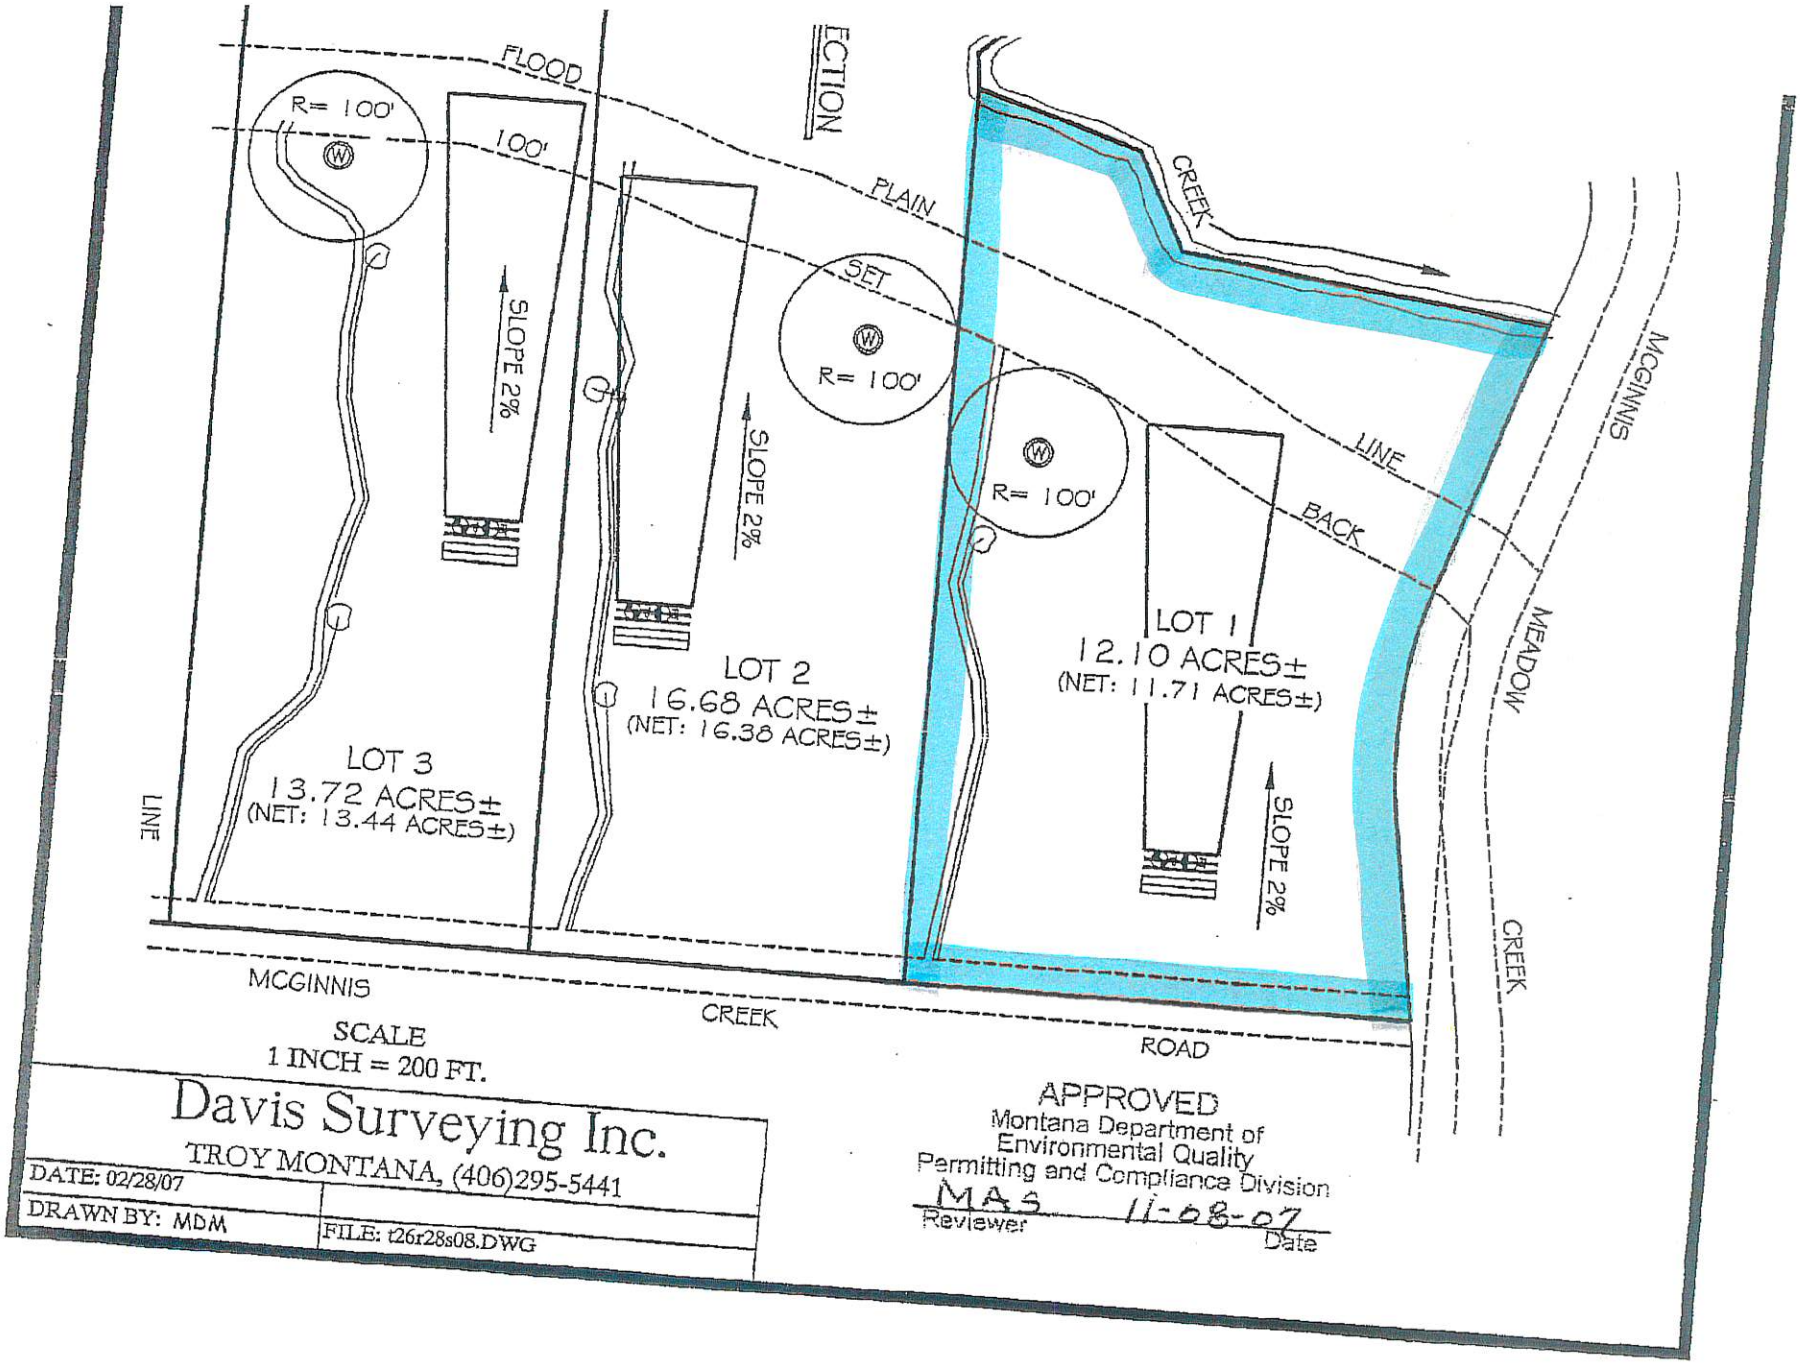
Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 8/22/25

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.


FLOOD
PLAIN
SECTION
LINE
R= 100'
100'
SLOPE 2%
SET
R= 100'
SLOPE 2%
R= 100'
BACK
LINE
CREEK
MCGINNIS
MEADOW
CREEK
LOT 3
13.72 ACRES±
(NET: 13.44 ACRES±)
LOT 2
16.68 ACRES±
(NET: 16.38 ACRES±)
LOT 1
12.10 ACRES±
(NET: 11.71 ACRES±)
SLOPE 2%
LINE
MCGINNIS
CREEK
ROAD
SCALE
1 INCH = 200 FT.
Davis Surveying Inc.
TROY MONTANA, (406)295-5441
DATE: 02/28/07
DRAWN BY: MDM
FILE: t26r28s08.DWG
APPROVED
Montana Department of
Environmental Quality
Permitting and Compliance Division
MAS
Reviewer
11-08-07
Date