County

LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 03/02/2020 Expiration Date: 03/01/2021

Property Owner: Edna Reed c/o:

Address: [redacted]

Telephone: (Home) (Work)

Installer: Tally Hoe License No. 1

Proposed Work: (Check One) ☐ New Installation ☒ Existing System

☐ Repair ☒ Replacement ☐ Extension ☐ Other _____

Describe: Install rockless chambers - 3 laterals at 54' each

Parcel Description:

Legal: S02 T31N R31W

Address or Location: Pipe Dream Lot 1, 229 Pipe Creek Hill Rd

Approved Design Criteria:

Bedrooms: 3 Septic Tank Size: 1000 gallons Drainfield Size: 162 lineal feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

Closure Statement:

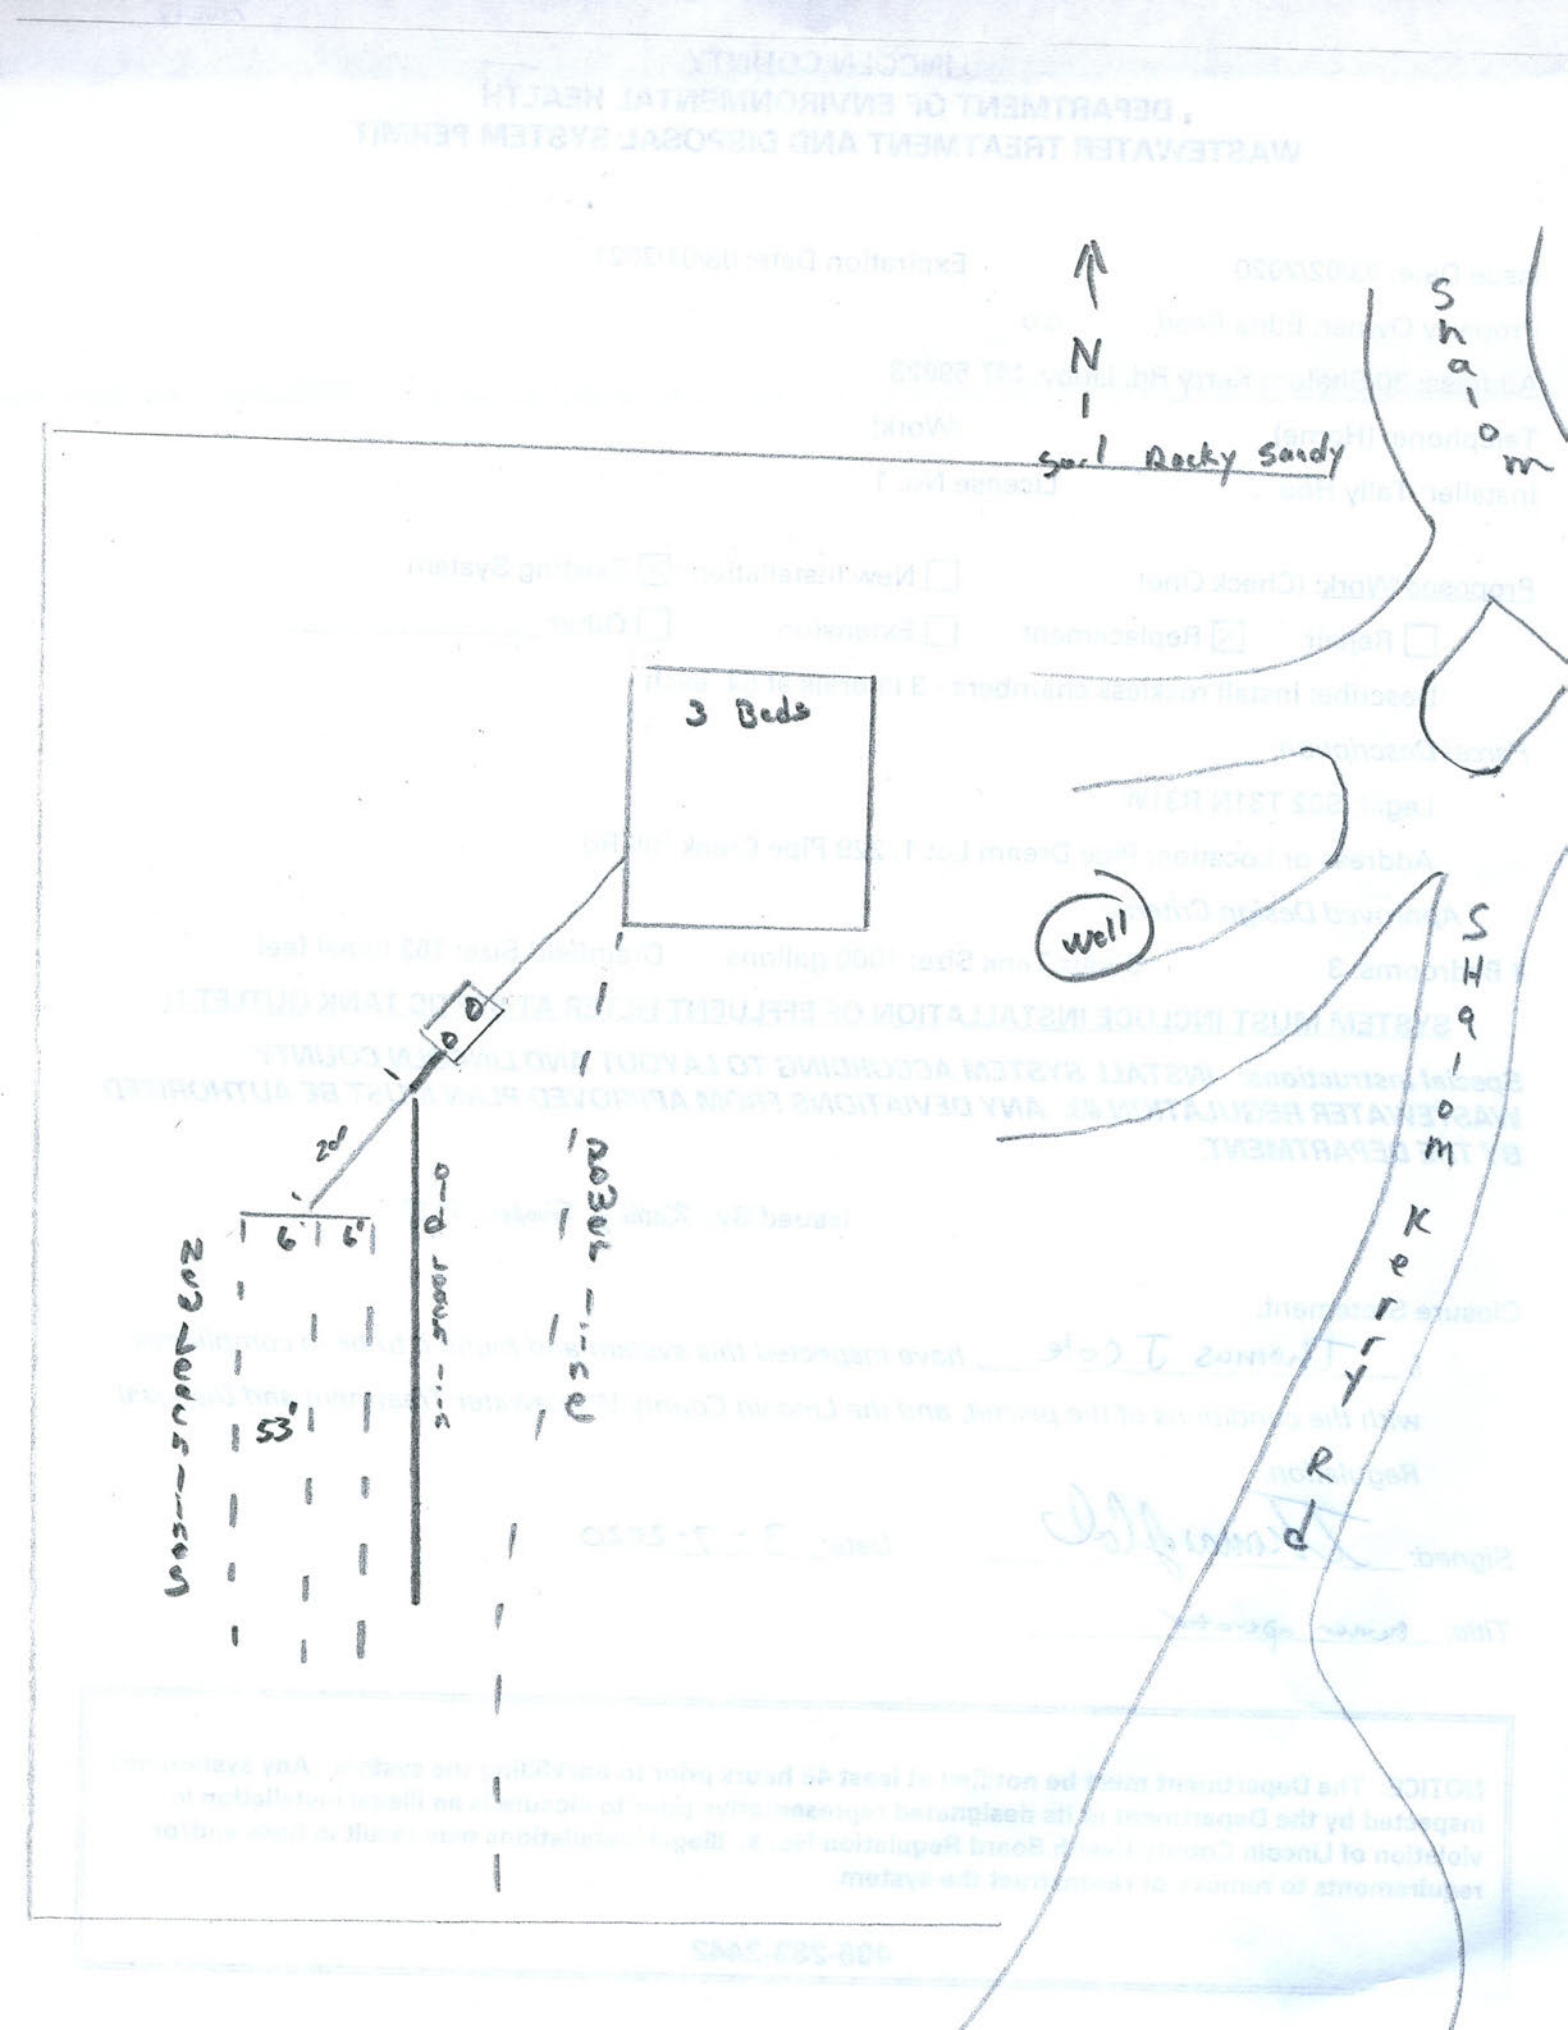
I, Thomas J Cole *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Thomas J Cole *Date:* 3-7-2020

Title: owner operator

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442


N
Sand Rocky Sandy
Shalom
3 Beds
Well
SHALOM
Kerry
Rd
20'
Power line
Old Power line
Easement
6'
6'
53'