LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 04/29/2010 Expiration Date: 04/20/2011

Property Owner: Jim Stewart c/o: Gideon Yutzy

Address: [redacted]

Telephone: (Home) (Work) 889-3081

Installer: License No.

__XX__ New Installation _____ Existing System

_____ Repair _____ Replacement _____ Extension _____ Other

Describe: Using gravelless chambers for installation.

Parcel Description:

Legal: NE-1/4 SE-1/4 S10 T37 R28 Lot 5 of Ten Lakes Estates

Address or Location: at end of Constance Lane

Approved Design Criteria:

Bedrooms: 3 Septic Tank Size: 1000 gallons Drainfield Size: 336 Linear Feet

added 500 gal lift chamber in case its ever needed

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !! GY

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Kendra J. Lind, R.S.

Closure Statement:

I, Gideon Yutzy *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Gideon Yutzy *Date:* Jun- 20-2010

Title: Licensed Installer

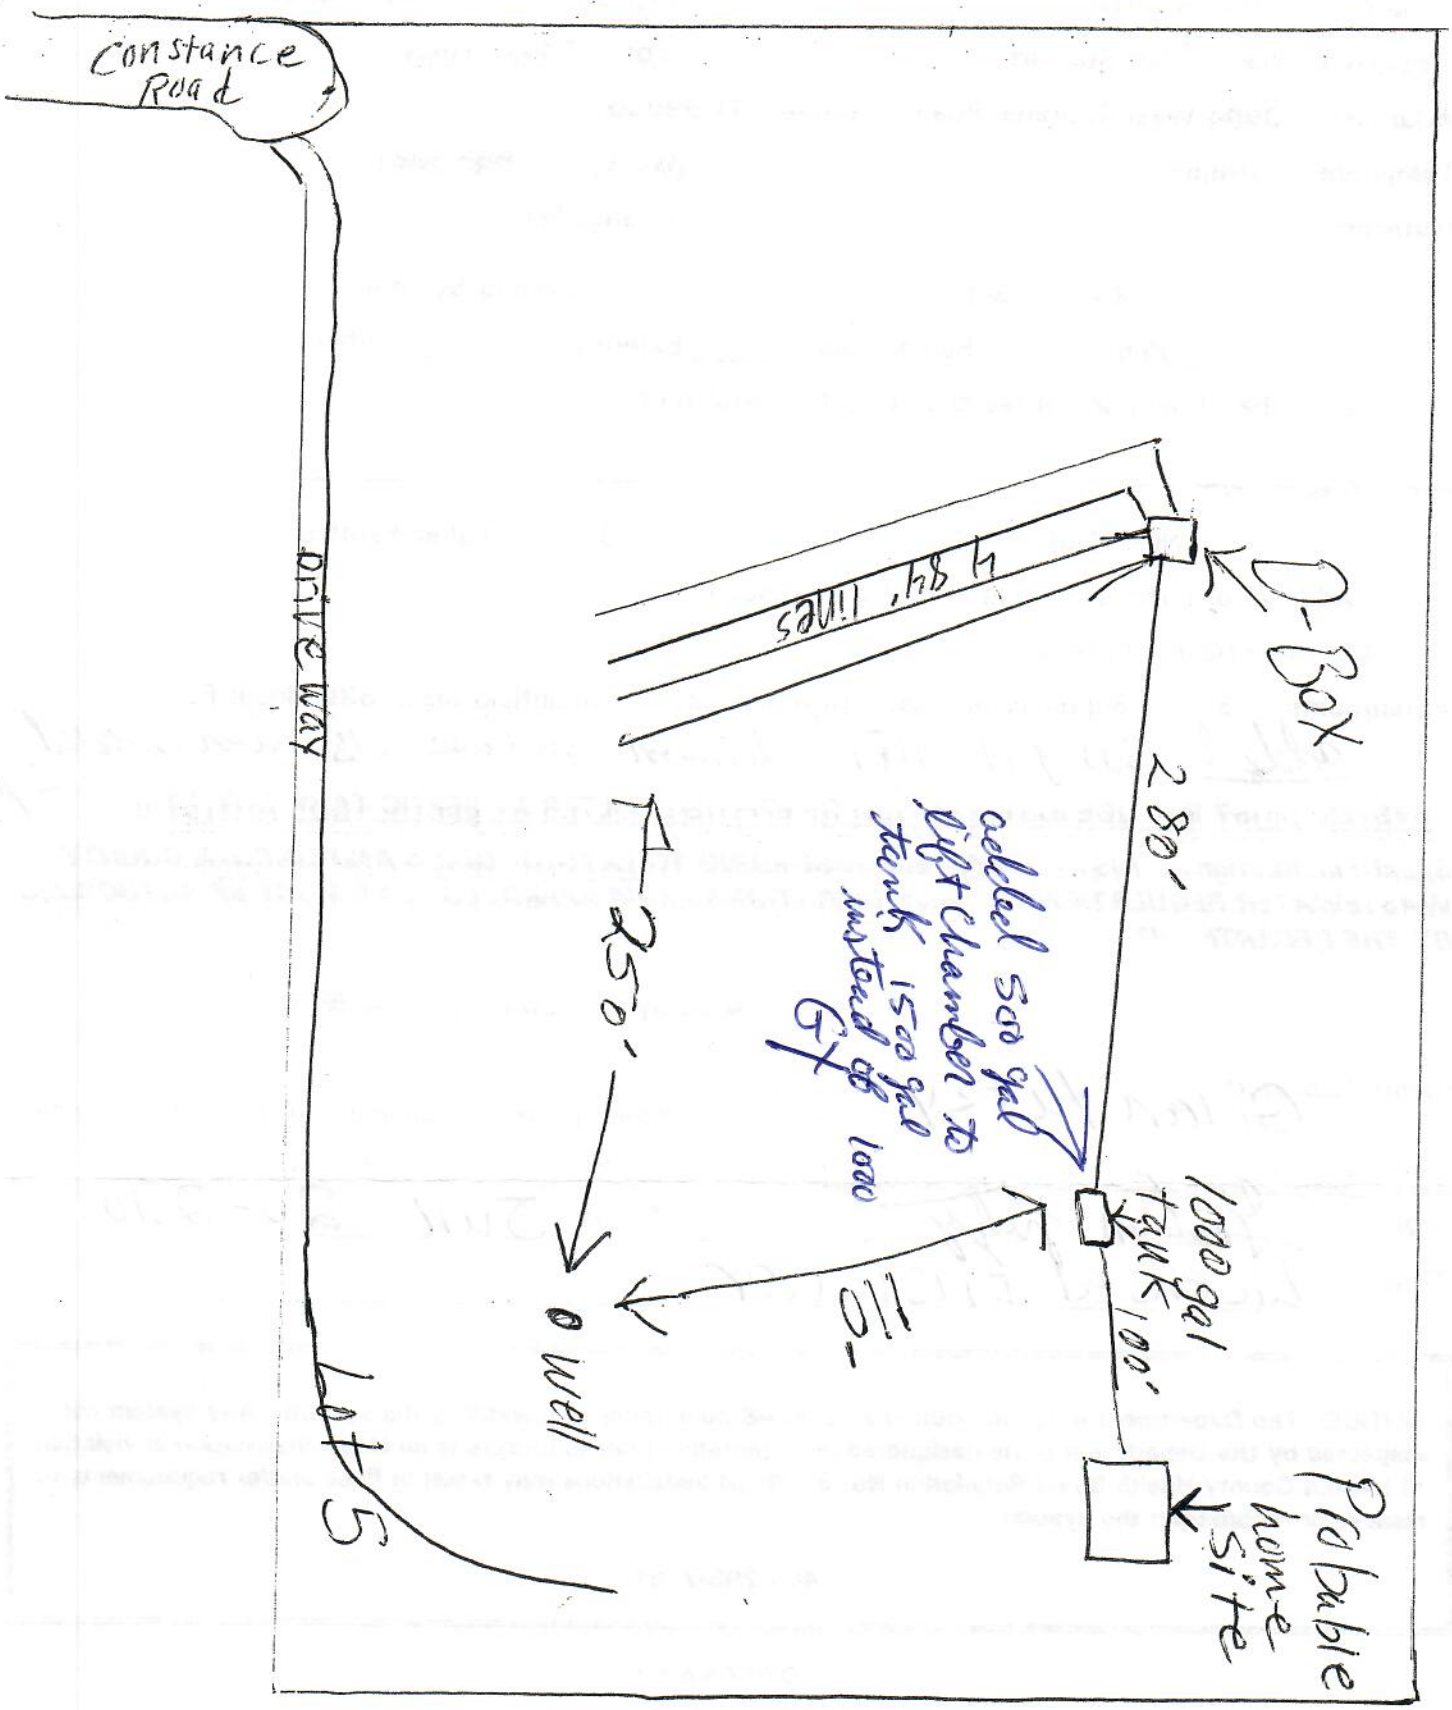
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


Constance Road
Driveway
Lot 5
4 qty lines
D-Box
280'
added 500 gal lift chamber to tank 1500 gal instead of 1000 gal
250'
well
100'
1000 gal tank
Probable home site
N