LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 12/18/2019 Expiration Date: 12/18/2020

Property Owner: Steve Thomas c/o:

Address: [redacted]

Telephone: (cell) [redacted] (Work)

Installer: Terry Oedewaldt License No. 2

___ New Installation __xx__ Existing System

____ Repair ___xx_ Replacement ____ Extension ____ Other

Describe: Three 35' laterals using gravelless chambers to replace failed drywell.

Parcel Description:

Legal: S29, T31 N, R31 W

Address or Location: Rawlings Road 2nd Addition S2 Lot 88

Geo/Assessors code: 0000008420

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size 140 Lineal feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, TERRY OEDEWALDT, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: _____ *Date:* 12/20/2019

Title: PRESIDENT


NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly

STEVE AND LISA THOMAS
12/20/2019

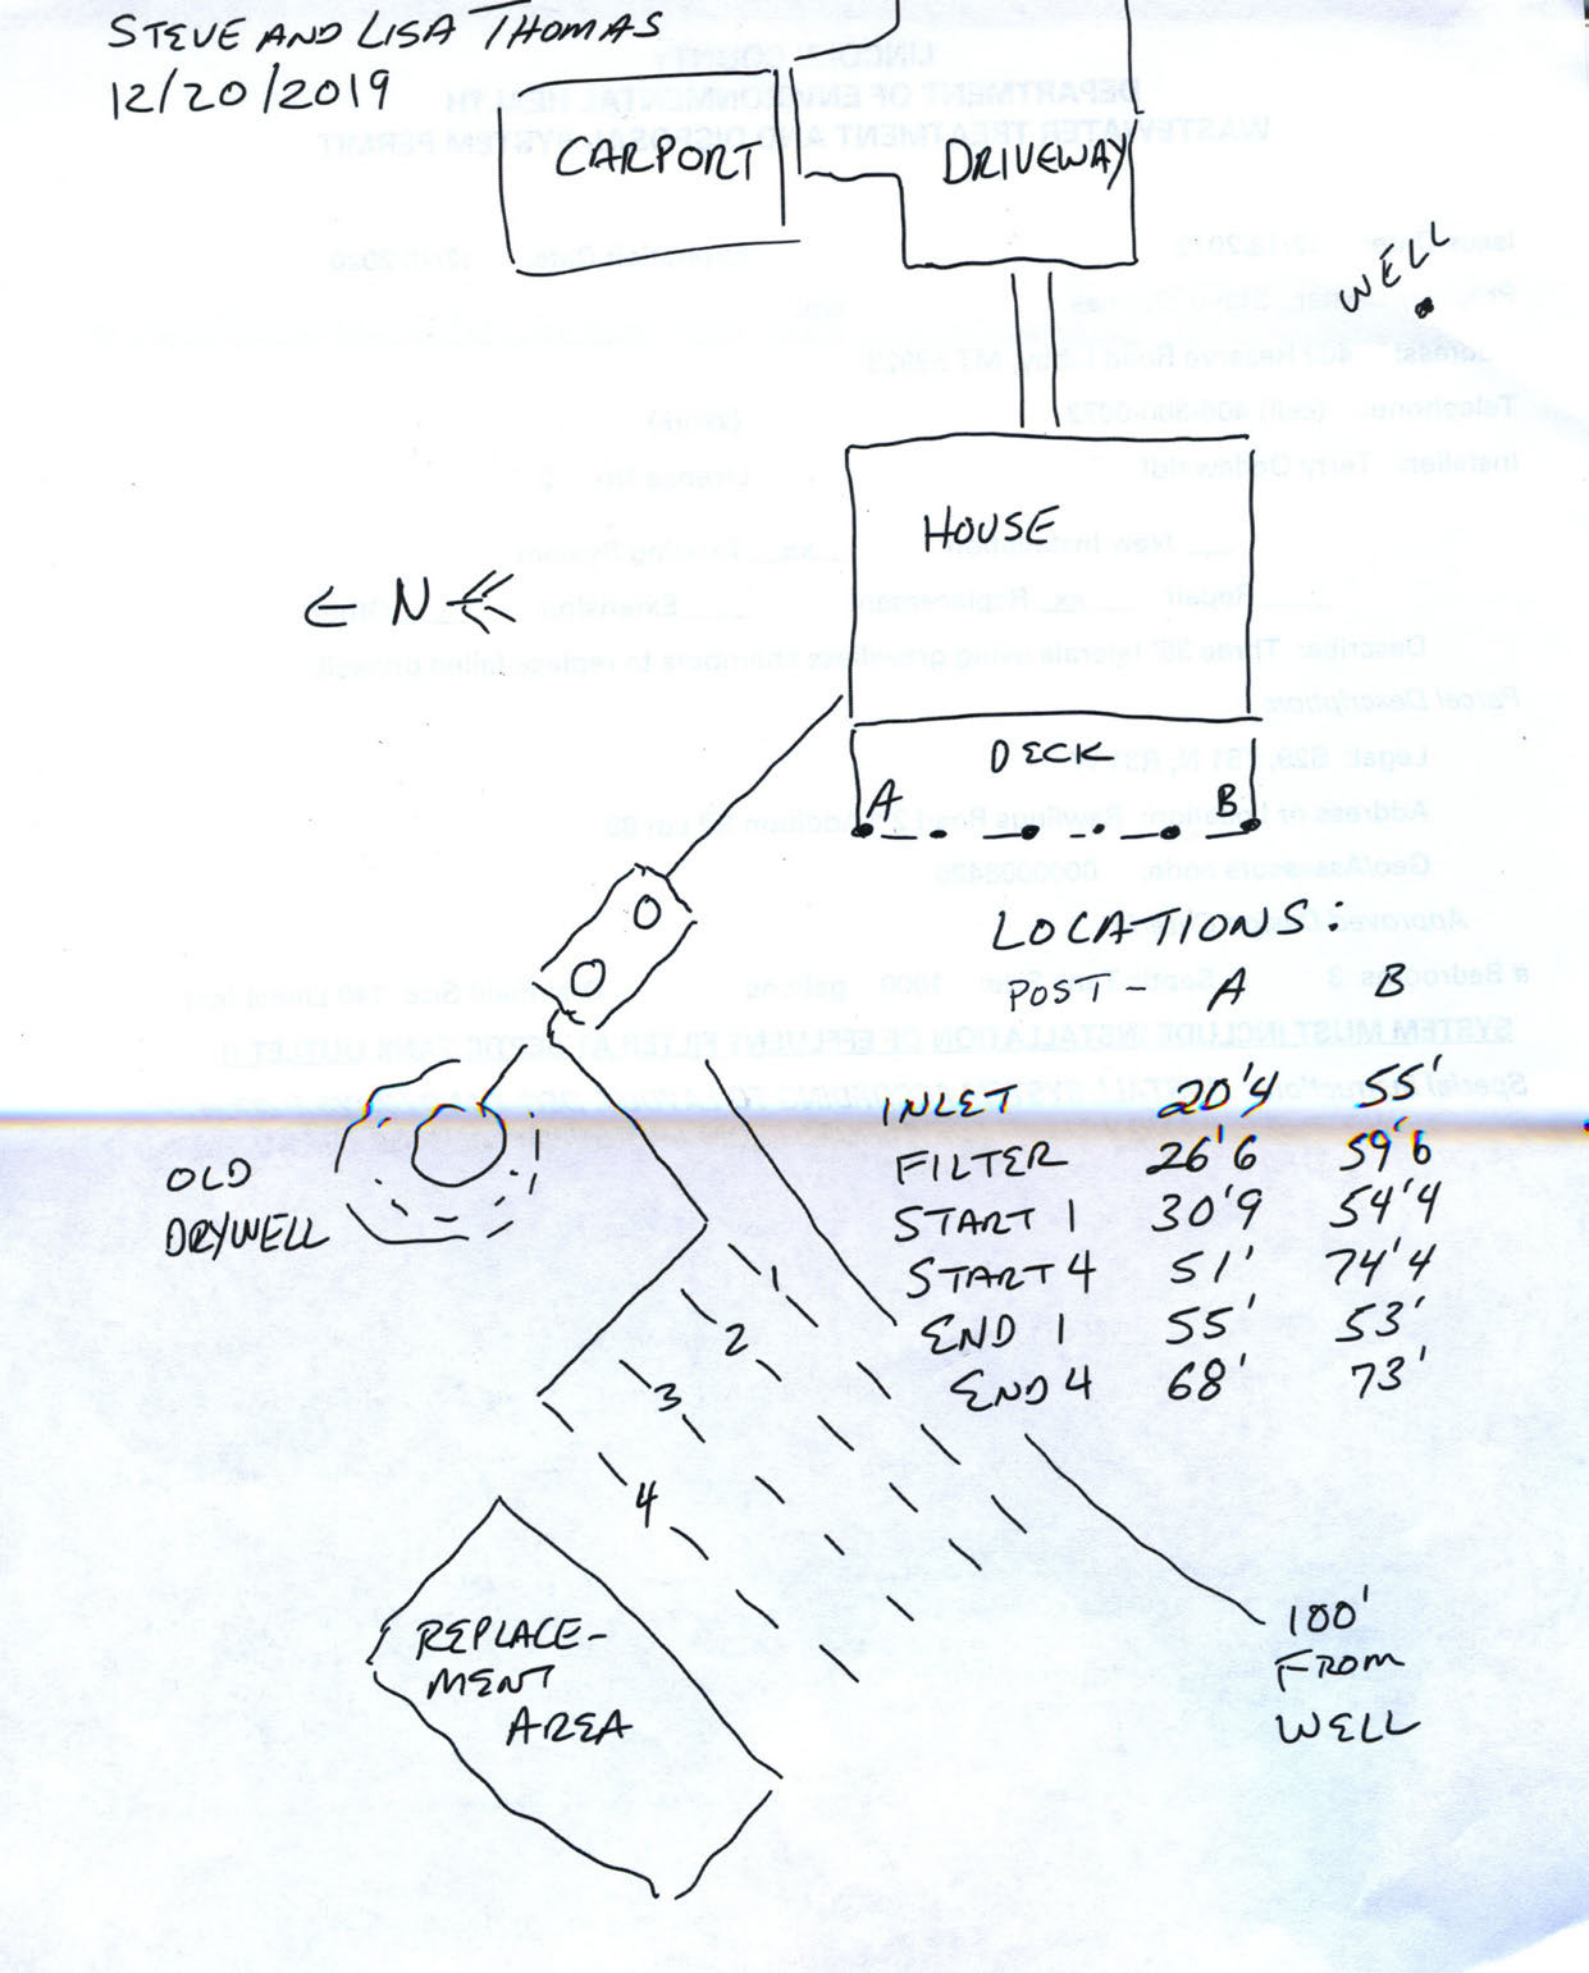

LOCATIONS:

POST -	A	B
INLET	20'4	55'
FILTER	26'6	59'6
START 1	30'9	54'4
START 4	51'	74'4
END 1	55'	53'
END 4	68'	73'