LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 07/08/2025 Expiration Date: 07/07/2026 Permit#25-53616

Property Owner: Susan Trenkle

Mailing Address: [redacted]

Installer: Marty Goucher License #: 196

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new sand lined pressure dosed system for 2 Bedroom House.

Legal: SILVER TIP RANCH, S22, T37 N, R31 W, BLOCK 2, LOT 8, ACRES 1.2336

Property Address: 238 N. Silver Dr., Troy, MT 59935 Assessment Code: 53616

DEQ COSA: E.Q.# Silvertip Ranch 27-92-L2-31 Date: 03/29/93

Approved Design Criteria: Installation of new sand lined pressure dosed system for 2 Bedroom House with 2 Laterals @ 35' with reduction for chambers.

# of Bedrooms: 2 Septic Tank Size: 1000/500 Trench Width: 36"

# of Laterals: 2 Length of Laterals: 35' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, Circular DEQ-4, and COSA(If Applies). Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, RS*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

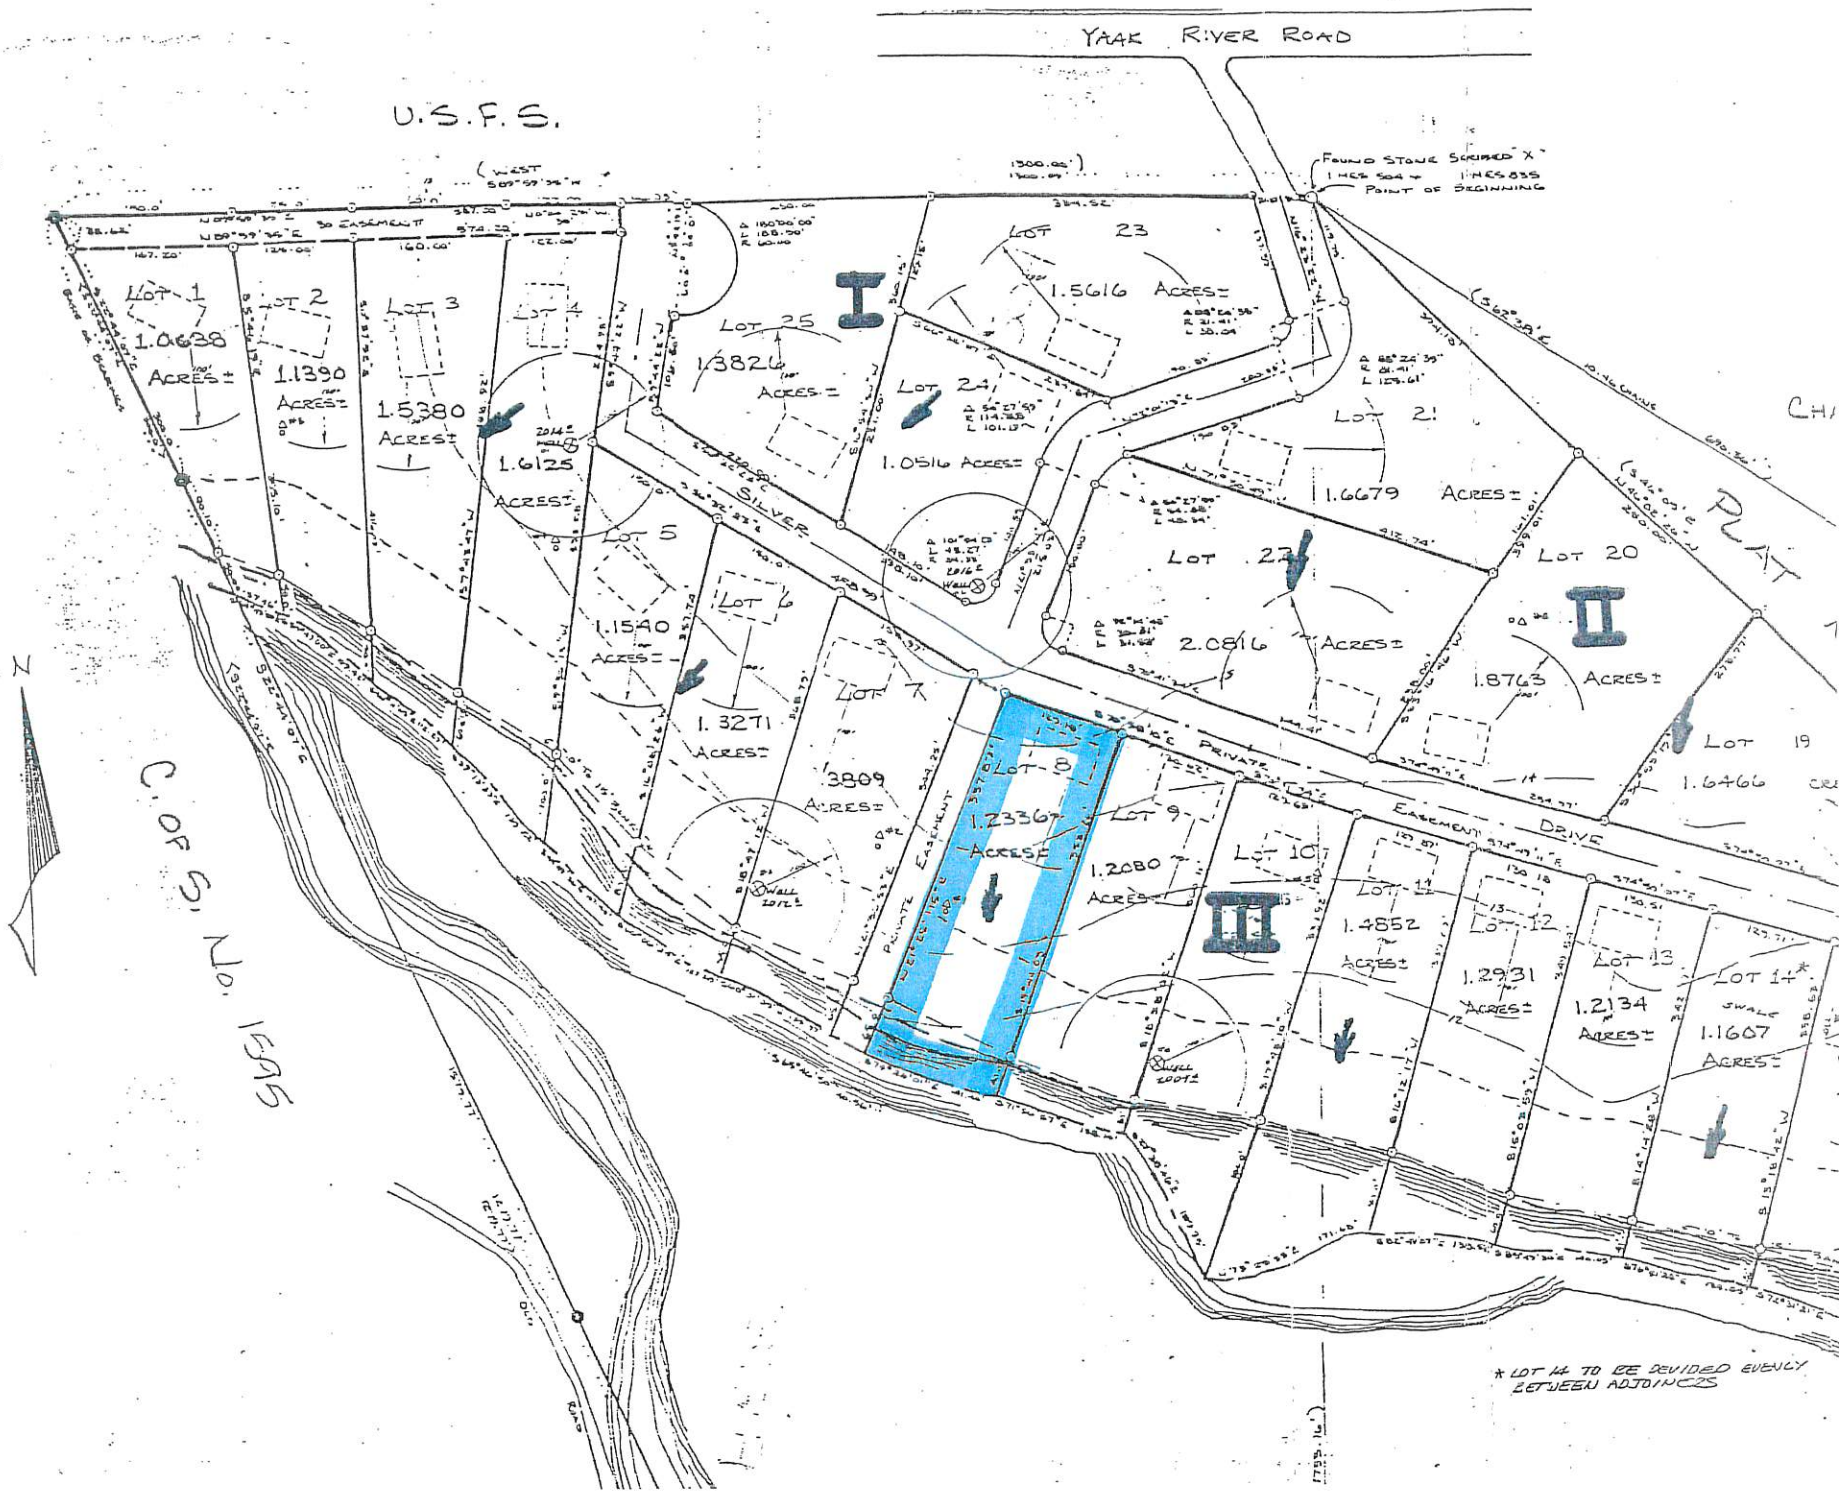
Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 7/29/25

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.


YAAK RIVER ROAD
U.S.F.S.
FOUND STONE SCRIBED X
1 INCH 504 W 1 INCH 835
POINT OF BEGINNING
LOT 1
1.0638 ACRES±
LOT 2
1.1390 ACRES±
LOT 3
1.5380 ACRES±
LOT 4
1.6125 ACRES±
LOT 5
1.1540 ACRES±
LOT 6
1.3271 ACRES±
LOT 7
1.3809 ACRES±
LOT 8
1.2336 ACRES±
LOT 9
1.2080 ACRES±
LOT 10
1.4852 ACRES±
LOT 11
1.2931 ACRES±
LOT 12
1.2134 ACRES±
LOT 13
1.1607 ACRES±
LOT 14*
LOT 25
1.3824 ACRES±
LOT 24
1.0516 ACRES±
LOT 23
1.5616 ACRES±
LOT 21
1.6679 ACRES±
LOT 22
2.0816 ACRES±
LOT 20
1.8763 ACRES±
LOT 19
1.6466 ACRES±
SILVER
PRIVATE EASEMENT
DRIVE
C.O.S. NO. 1595
N
* LOT 14 TO BE DEVIDED EVENLY BETWEEN ADJOINERS