County

LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 12/18/2019 Expiration Date: 12/18/2020

Property Owner: Elizabeth Waxbom c/o:

Address: [redacted]

Telephone: (cell) [redacted] (Work)

Installer: Tom Cole (Tally Hoe) License No. 1

___ New Installation __xx__ Existing System

____ Repair __xx__ Replacement ____ Extension ____ Other

Describe: New concrete tank and two 3' drywells

Parcel Description:

Legal: S03, T30 N, R31 W

Address or Location: Mountain View Park Block 8 Lot 5&6

Geo/Assessors code: 0000009382

Approved Design Criteria:

Bedrooms 2 Septic Tank Size: 1000 gallons Drainfield Size Two 3' drywells

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Thomas J Cole *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Thomas J Cole *Date:* 12-23-19

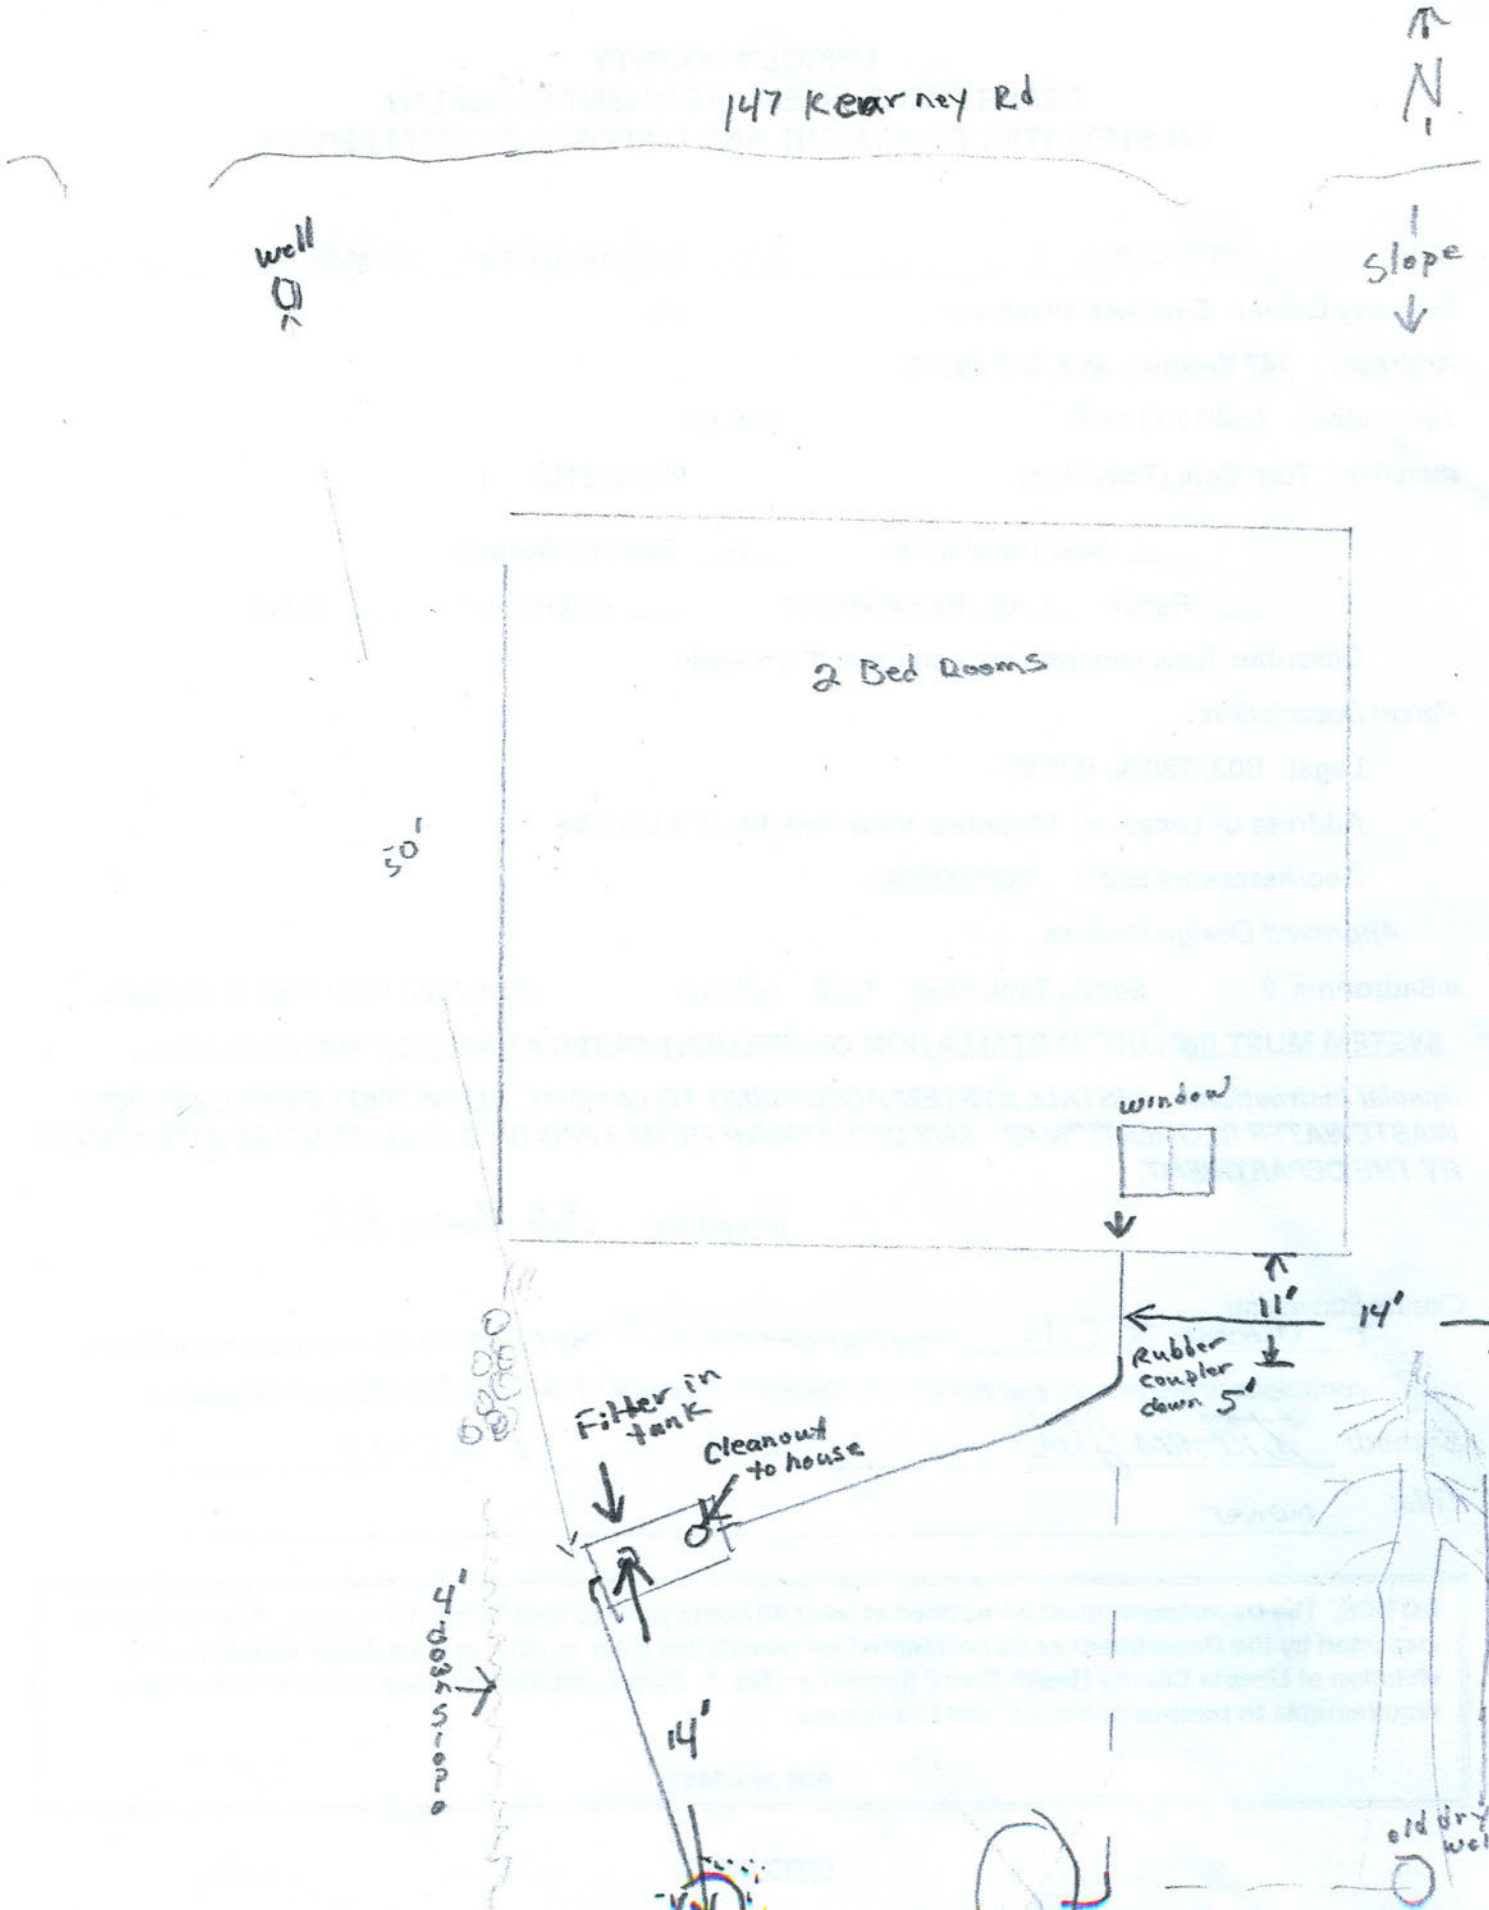
Title: owner

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


147 Kearney Rd
N
well
Slope
2 Bed Rooms
5'-0"
window
11'
14'
Rubber coupler down 5'
Fitter in tank
Cleanout to house
4' rock slope
14'
old dry well