# LINCOLN COUNTY
# DEPARTMENT OF ENVIRONMENTAL HEALTH
# WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 4/2/2019 Expiration Date: 4/2/2020

Property Owner: Shane Willoughby c/o: Brenneman

Address: NHN Lake View Lane

Telephone: [redacted] (Work)

Installer: Brennemans Excavation License No. 170

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Three 94' laterals using gravelless chambers.

*Parcel Description*:

Legal: S18 T36 R27

Address or Location: COS 4239

Geo/Assessors code: 0000011655

*Approved Design Criteria*:

# Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 280 Linear Feet

**SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!**

***Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.***

**Issued By:** Jake Mertes, R.S.

Closure Statement:

I, Elmer Brenneman, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

*Signed:* Elmer Brenneman *Date:* 4-29-2019

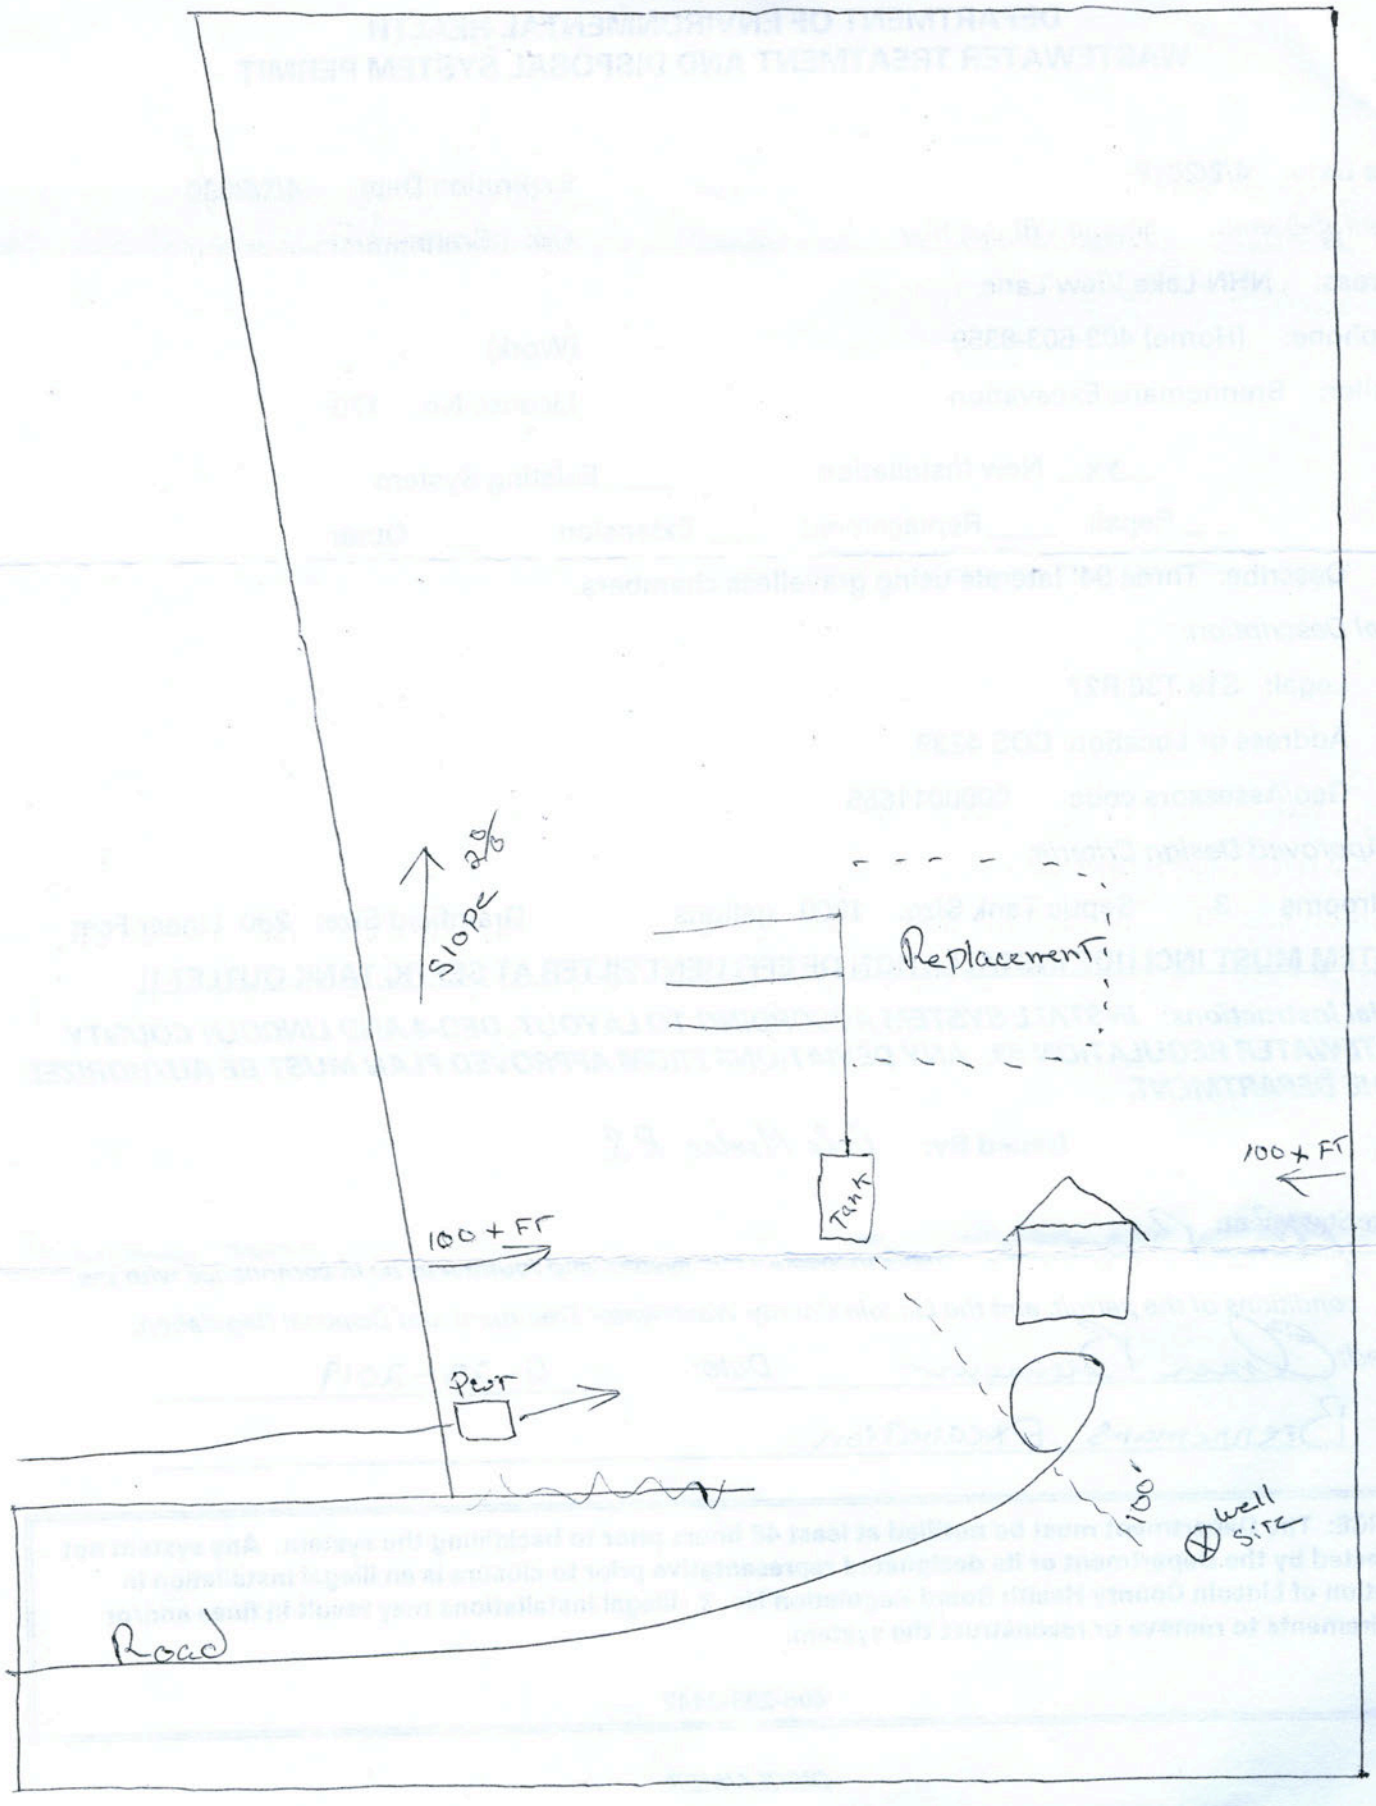
*Title:* Brennemans Excavation

**NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.**

**406-283-2442**

***DISCLAIMER***

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Slope 2%
Replacement
Tank
100+ FT
100+ FT
Pump
100'
well site
Road