LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 8/27/2019 Expiration Date: 8/27/2020

Property Owner: Steve Wilske c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Tom Cole License No. 1

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Two 70' laterals using gravelless chambers. Size reduced per 0.8 app rate.

Parcel Description:

Legal: S21 T31 R33

Address or Location: Shannon Flats Lot 3

Geo/Assessors code: 0000052512

Approved Design Criteria:

3 Bedrooms Septic Tank Size: 1000 gallons Drainfield Size: 140 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

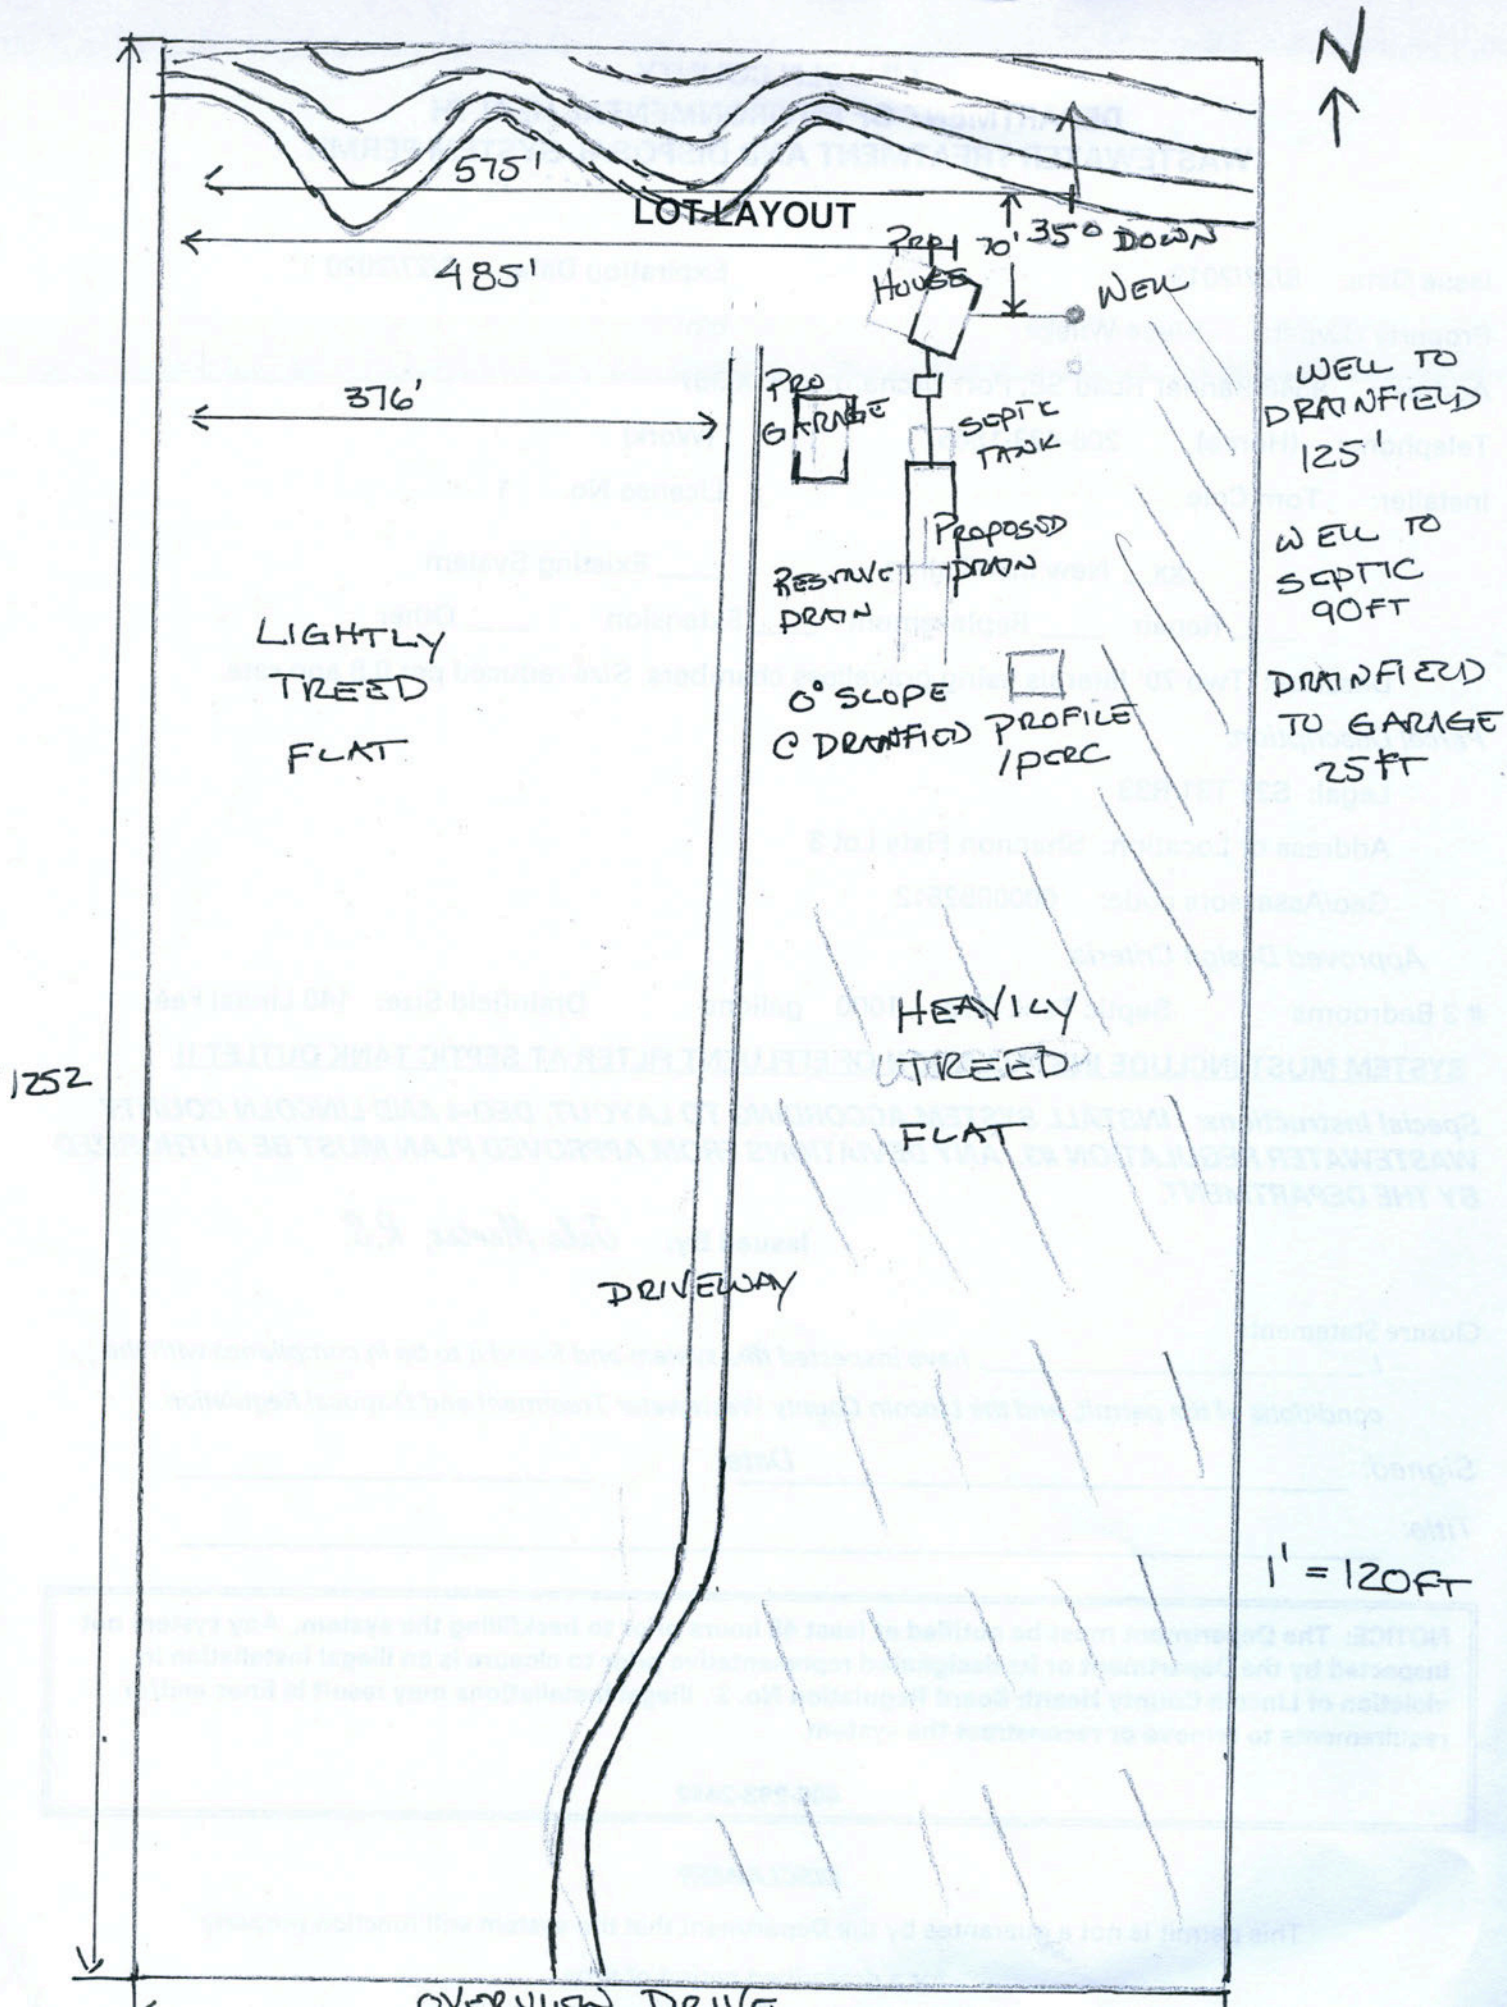
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


N
575'
LOT LAYOUT
485'
PROP HOUSE
70'
35° DOWN
WELL
376'
PROP GARAGE
SEPTIC TANK
PROPOSED DRAIN
RESERVE DRAIN
WELL TO DRAINFIELD 125'
WELL TO SEPTIC 90FT
DRAINFIELD TO GARAGE 25FT
LIGHTLY TREED FLAT
0° SLOPE
C DRAINFIELD PROFILE
1PERC
HEAVILY TREED FLAT
1252
DRIVEWAY
1' = 120FT