LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 09/12/2019 Expiration Date: 09/12/2020

Property Owner: Tom Wilson c/o:

Address: [redacted]

Telephone: (cell) [redacted] (Work)

Installer: Rupert Schreiner License No. 19

___ New Installation ____ Existing System

____ Repair ___xx_ Replacement ____ Extension ____ Other

Describe: Three 85' Laterals using drain rock & perf pipe

Parcel Description:

Legal: S36, T34 N, R25 W, ACRES 9.68, TRS 1C & 1C1 IN NENW

Address or Location: 64 WHITE PL STRYKER, MT 59933

Geo/Assessors code: 0000001598

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size 255 lineal ft

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Rupert Schreiner, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: Rupert Schreiner *Date:* 9-25-19

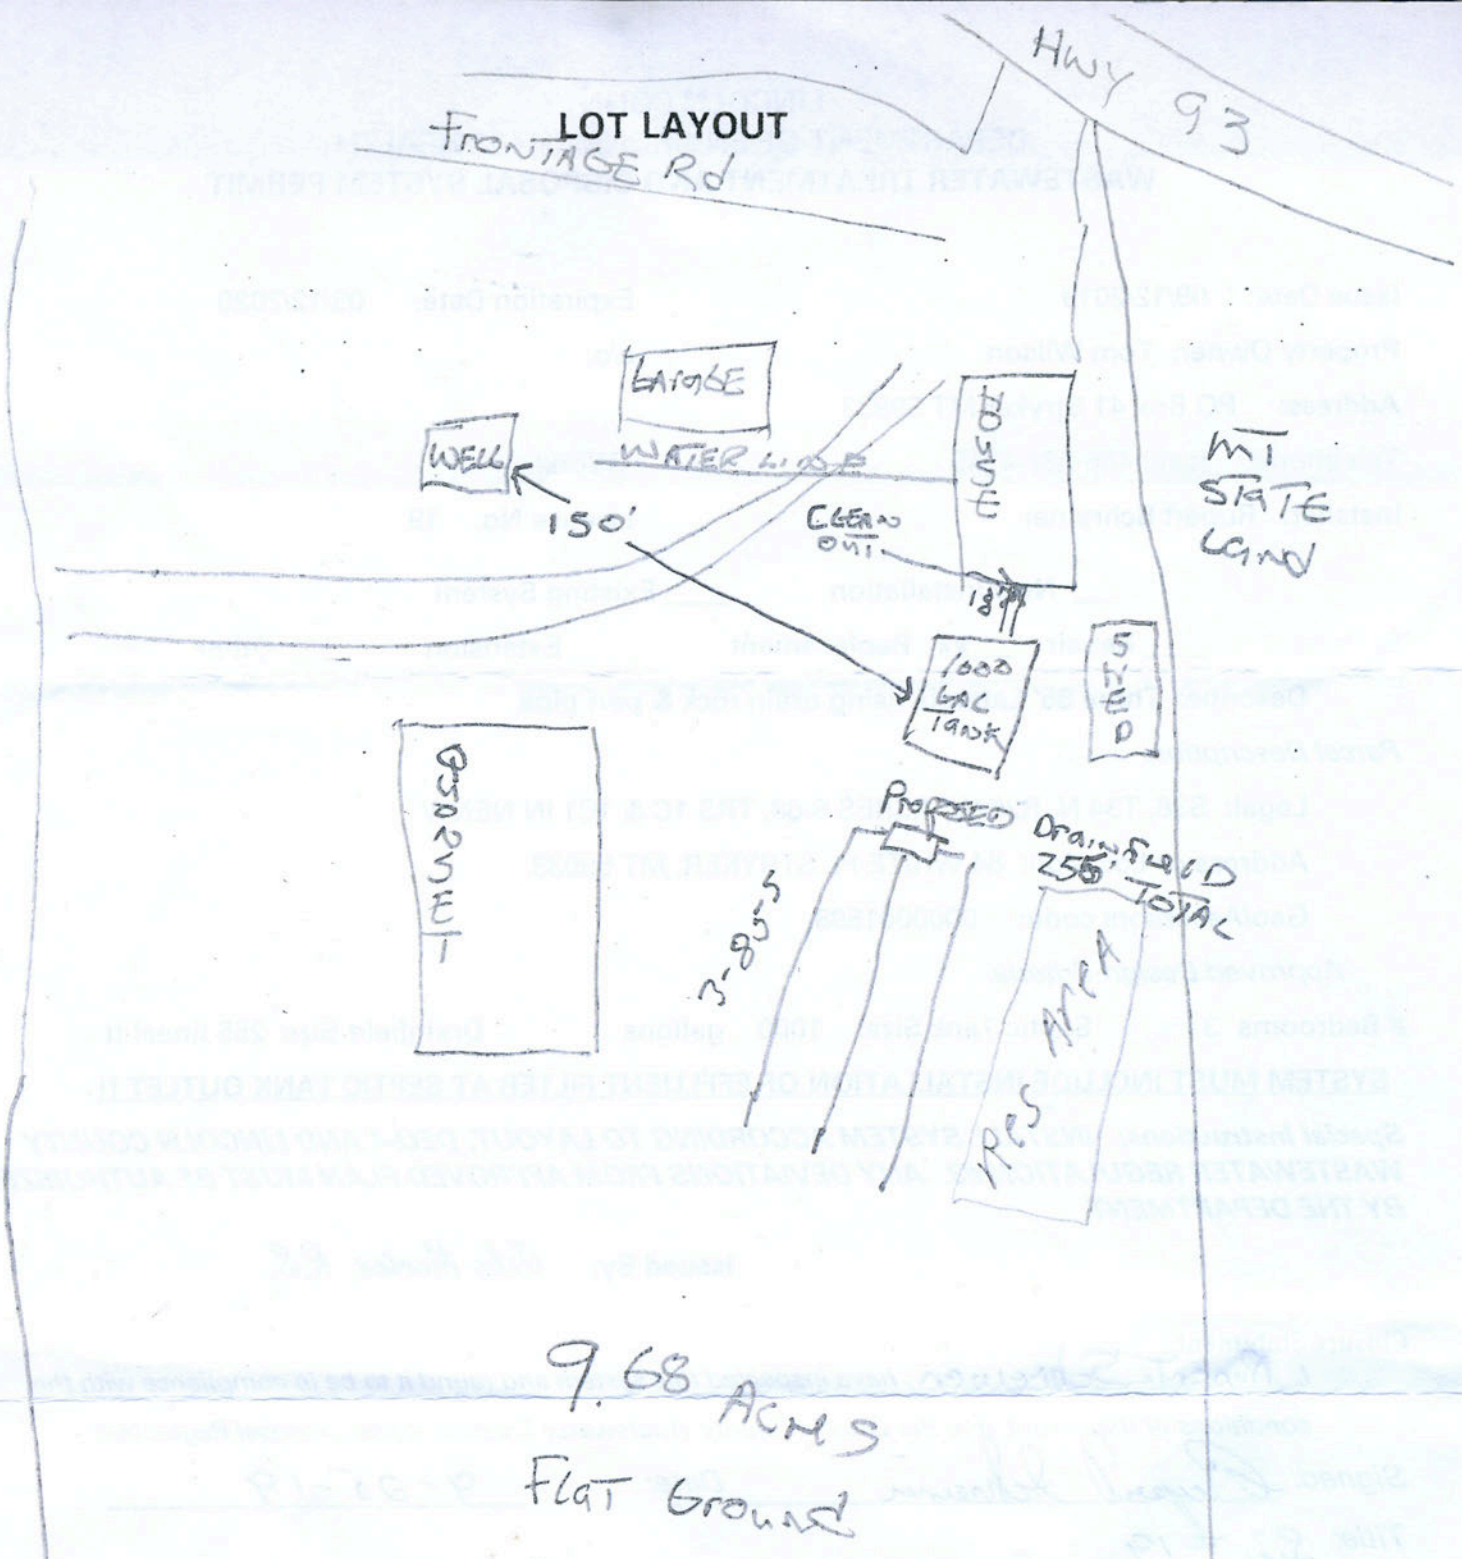
Title: Lic #19

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


LOT LAYOUT
FRONTAGE Rd
HWY 93
RAILROAD
GARAGE
WELL
WATER LINE
150'
HOUSE
CLEAN OUT
MT STATE LAND
1000 GAL TANK
SHED
PROPOSED
DRAIN FIELD
TOTAL
3'-8'-5
RES AREA
9.68 ACRS
FLAT GROUND