LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 3/20/2019

Expiration Date: 3/20/2020

Property Owner: 5 Kids Trust

c/o: Ken Carrol

Address: [redacted]

Telephone: (Home) [redacted]

(Work)

Installer: Self / Dustin Welch

License No. 155

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Two 65' sand-lined pressure dosed laterals in 3' wide trenches.

Parcel Description:

Legal: S22 T32 R34

Address or Location: 1500 Forest Drive Troy, MT 59935

Geo/Assessors code: 0000013540

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000/500 gallons Drainfield Size: 130 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Dustin Welch, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: [signature] *Date:* 6-9-19

Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442


DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT

EASTSIDE SUBDIVISION
SEPTEMBER 1996

Lincoln County
13.075 Acres

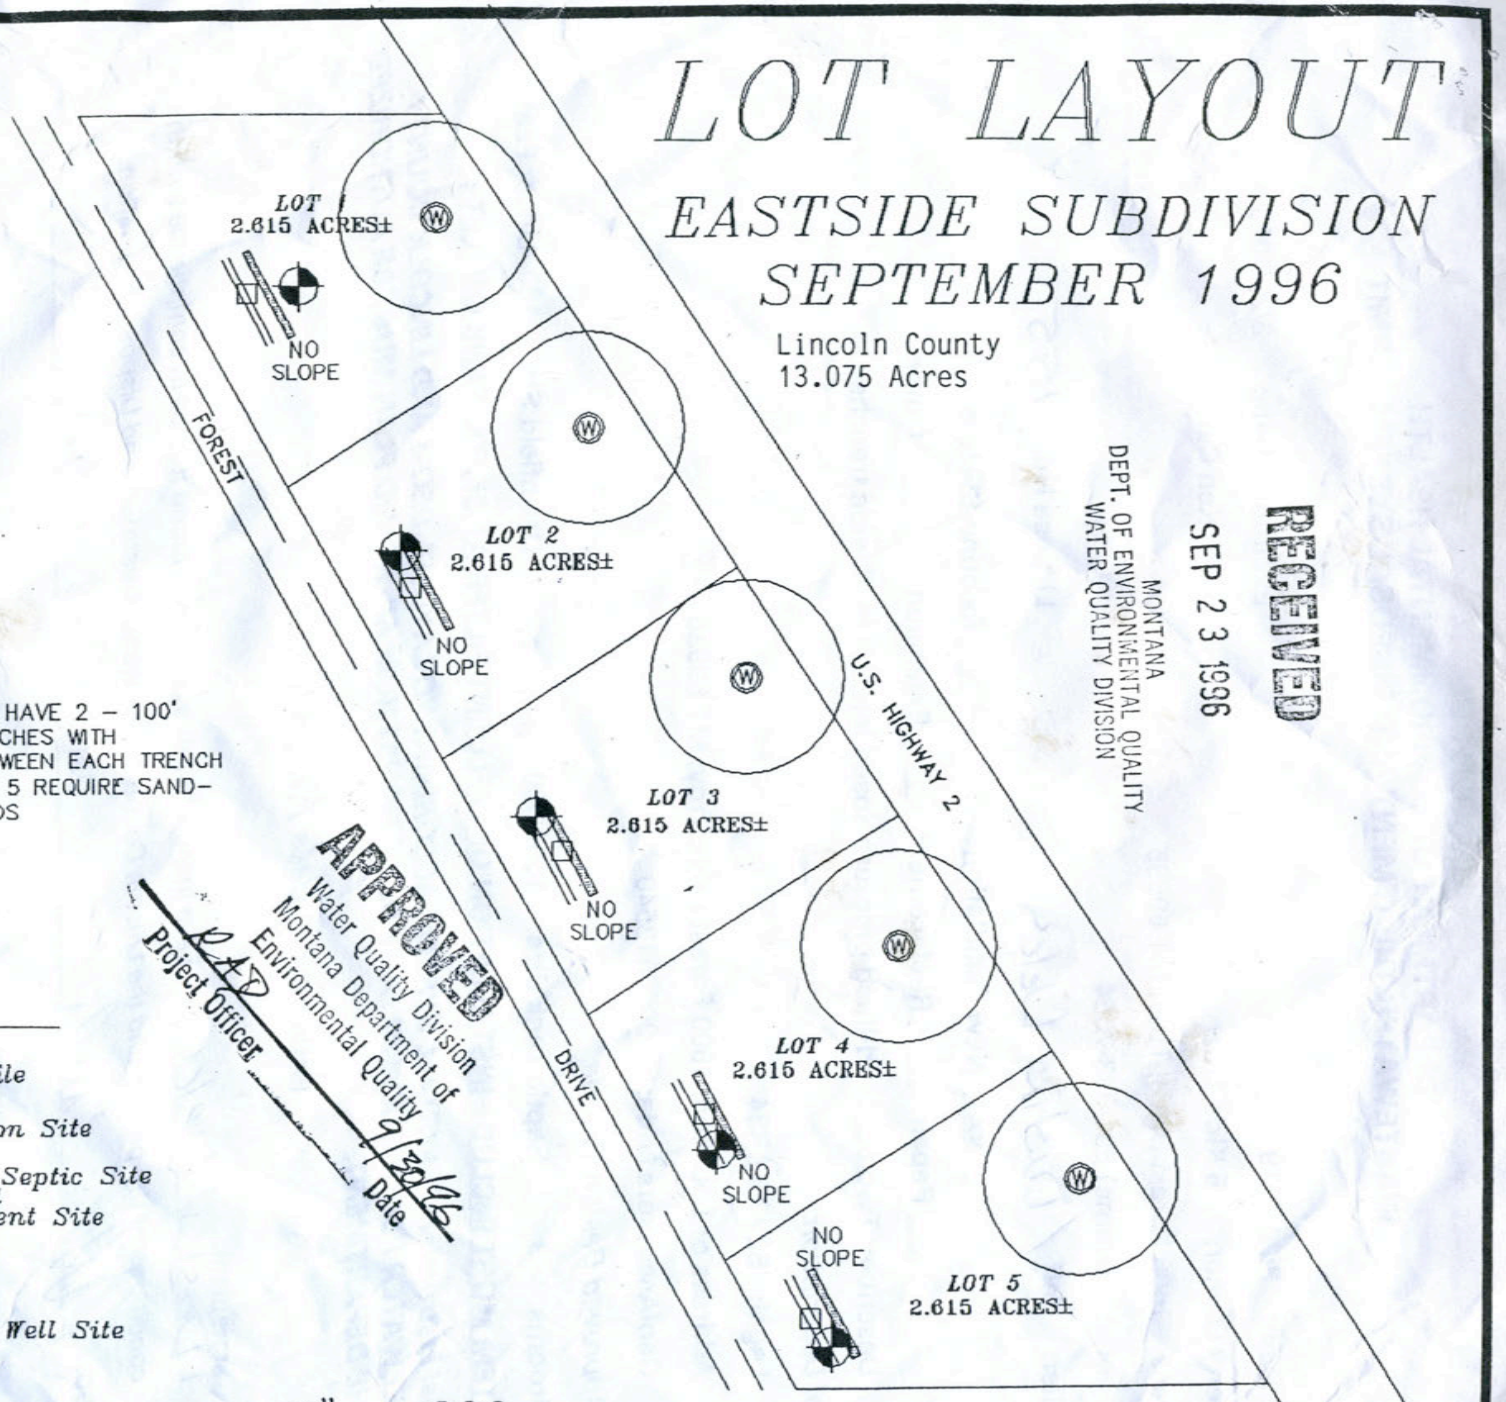

RECEIVED
SEP 23 1996
MONTANA
DEPT. OF ENVIRONMENTAL QUALITY
WATER QUALITY DIVISION

NOTE: ALL LOTS HAVE 2 – 100' DRAINFIELD TRENCHES WITH 10' SPACING BETWEEN EACH TRENCH LOTS 1,2,4, AND 5 REQUIRE SAND–LINED DRAINFIELDS

APPROVED
Water Quality Division
Montana Department of
Environmental Quality
RAP
Project Officer
9/30/96
Date

LEGEND

- Soil Profile
- Perculation Site
- Proposed Septic Site and Replacement Site
- Slope
- Proposed Well Site

1" = 200