LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 08/11/2025 Expiration Date: 08/10/2026 Permit#25-5661

Property Owner: Gerald Akin

Mailing Address: [redacted]

Installer: Marty Goucher License #: 196

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new gravity system for 1 Bedroom House.

Legal: S18, T31 N, R33 W, N2NE & GOVT LOT 3 & SENE 151.286 ACRES

Property Address: 2200 Rabbit Obrien Creek Rd., Troy, MT 59935 Assessment Code: 5661

DEQ COSA: E.Q.# Date:

Approved Design Criteria: Installation of new gravity system for 1 Bedroom House with 2 Laterals @ 50' with reduction for chambers.

# of Bedrooms: 1 Septic Tank Size: 1000 Trench Width: 24"

# of Laterals: 2 Length of Laterals: 50' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, Circular DEQ-4, and COSA(If Applies). Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, RS

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

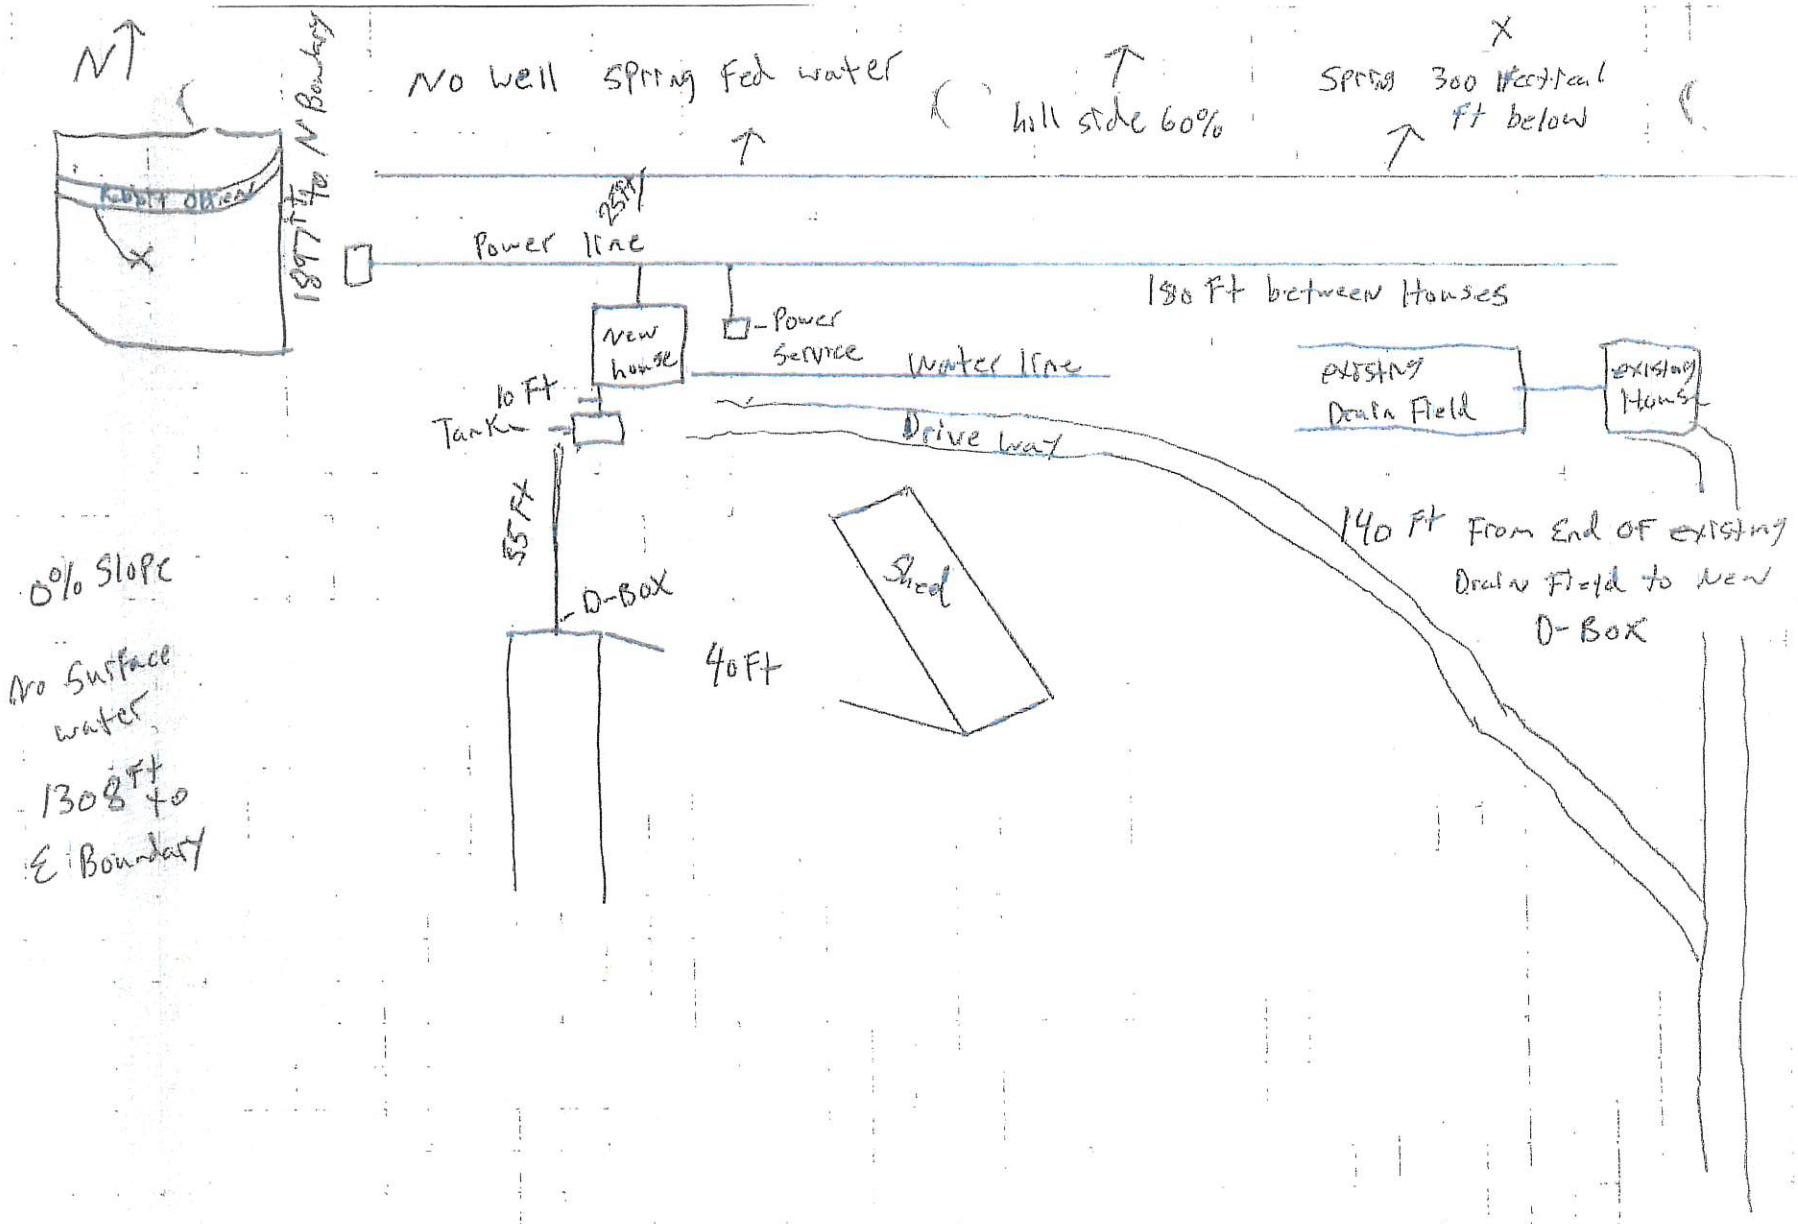
Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 9/17/25

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.


N
No well spring fed water
hill side 60%
Spring 300 Vertical Ft below
X
Rocky Ground
X
1897 Ft to N Boundary
25 Ft
Power line
180 Ft between Houses
New house
Power Service
Water line
10 Ft
Tank
Drive way
existing Drain Field
existing House
55 Ft
D-Box
Shed
40 Ft
140 Ft From End of existing Drain Field to New D-Box
0% Slope
No Surface water
1308 Ft to E Boundary
AKIN