LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 4/24/2018 Expiration Date: 4/24/2019

Property Owner: Allen Alberts c/o:

Address: [redacted]

Telephone: (Home) [redacted] (Work)

Installer: Rich Thompson License No. 73

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Three 84' laterals using gravelless chambers.

Parcel Description:

Legal: S14 T27 R28

Address or Location: Parkside @ Fisher River Lot 33

Geo/Assessors code: 0000056109

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 250 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Rich Thompson *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: R Thompson *Date:* 5-18-18

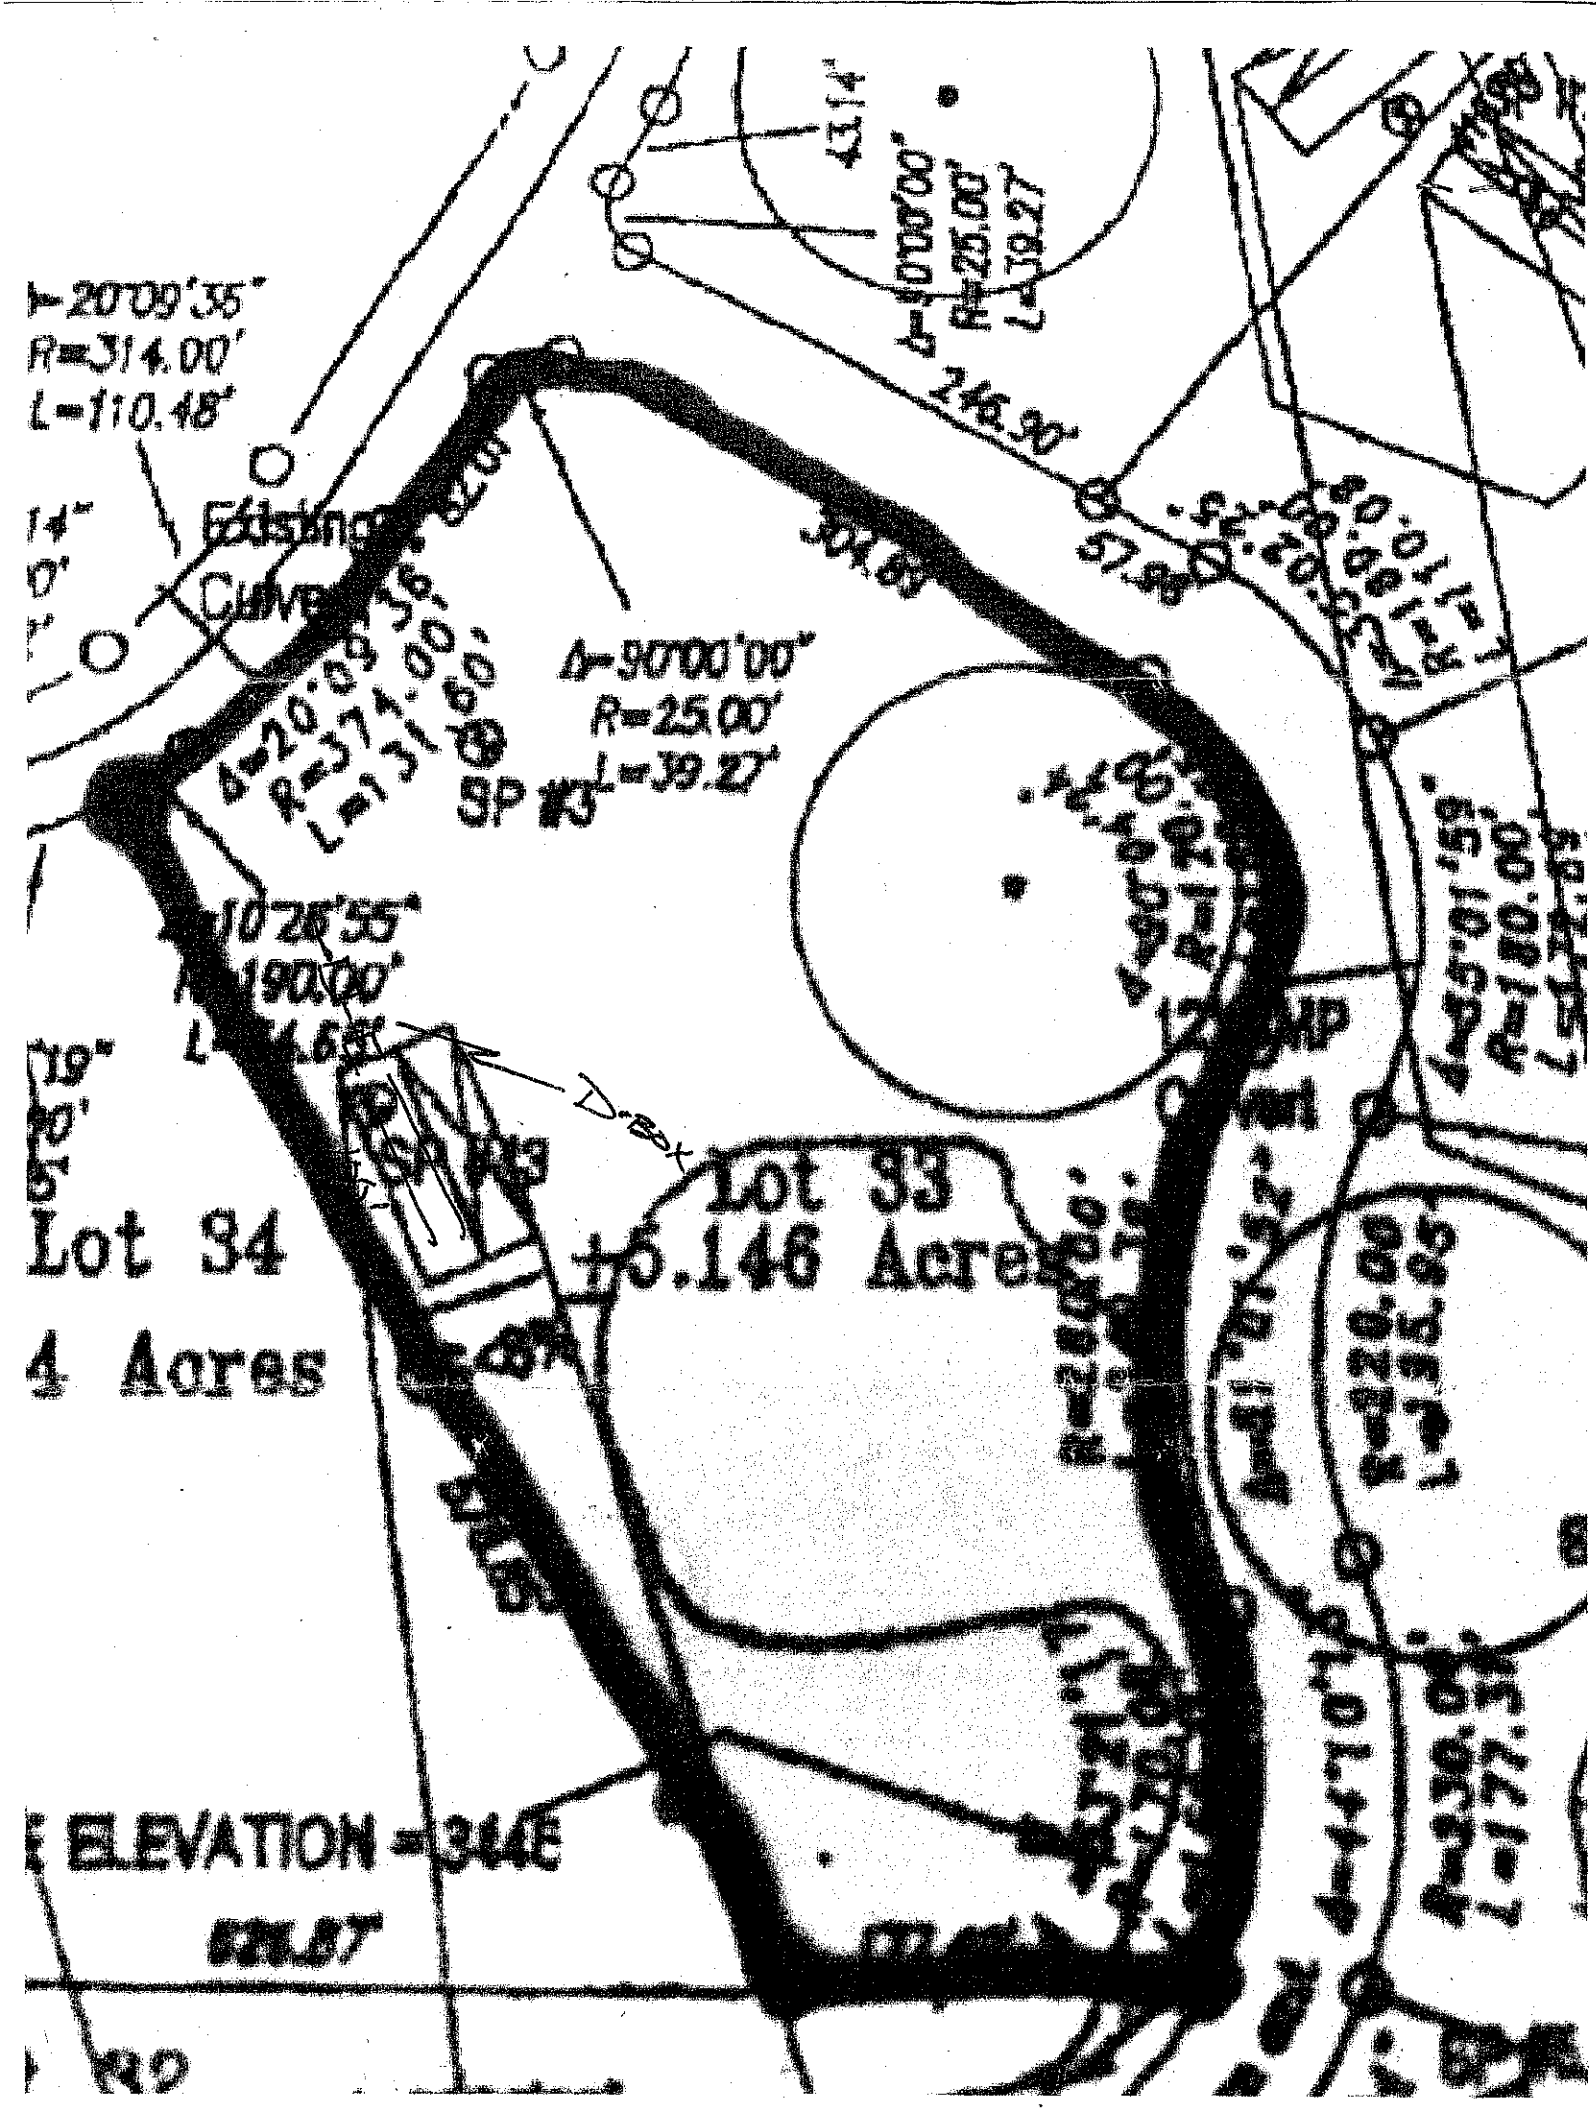
Title: Prop/owner

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Lot 34
4 Acres
Lot 33
±5.146 Acres
Δ=90°00'00"
R=25.00'
L=39.27'
Δ=20°09'35"
R=314.00'
L=110.48'
Δ=20°09'35"
R=371.00'
L=131.60'
SP #3
D-Box
ELEVATION = 344'
246.90'
204.85'
57.98'