LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 8/21/2019 Expiration Date: 8/21/2020

Property Owner: Dennis Bailey c/o:

Address: [redacted]

Telephone: (Home) (Work)

Installer: Tracy Webb License No. 89

xx New Installation ___ Existing System

___ Repair ___ Replacement ___ Extension ___ Other

Describe: Three 85' laterals using gravelless chambers. Size reduced per 0.5 app rate.

Parcel Description:

Legal: S23 T37 R27

Address or Location: Velvet Grove 3 Lot 12

Geo/Assessors code: 0000054444

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 255 lineal feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Tracy Webb, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: Tracy Webb *Date:* 9-2-19

Title: Webb Const Inc.

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442


DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT

N

Velvet Grove #3 Lot 12
Dennis + Linda Bailey

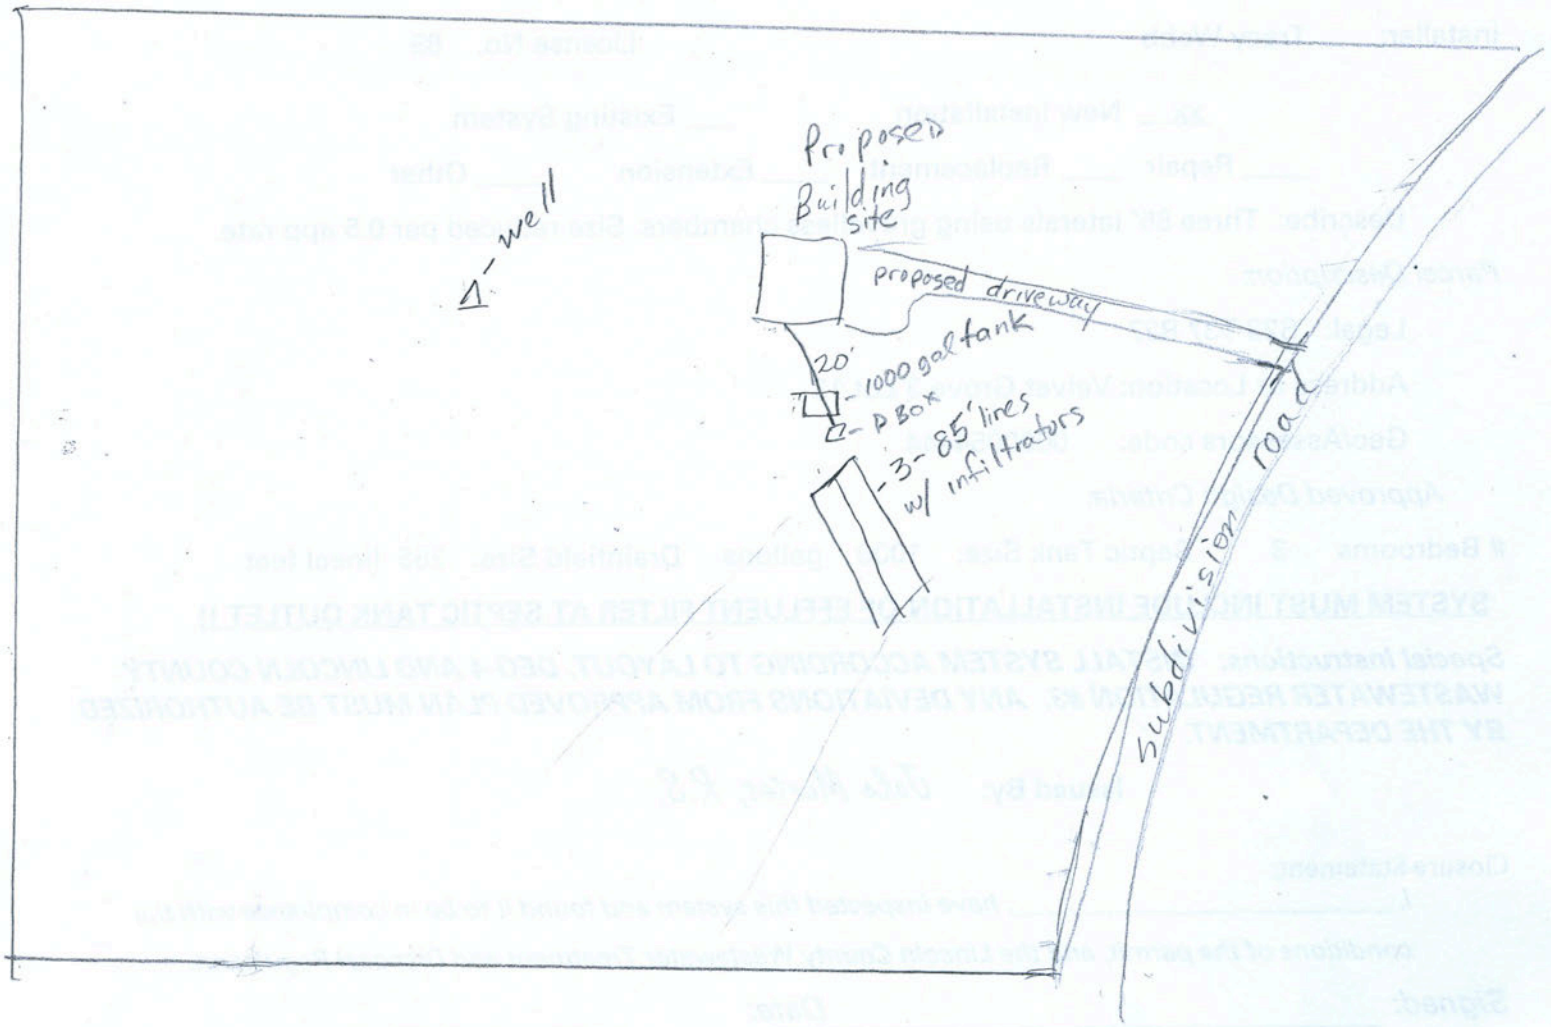

Δ well

S